



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण (सडक परिवहन और राजमार्ग मंत्रालय, भारत सरकार) National Highways Authority of India

(Ministry of Road Transport and Highways, Government of India)
परियोजना कार्यान्वयन इकाई - चेंगलपट्टु Project Implementation Unit - Chengalpattu
No. 41/8A, 2/285, वेलाचरी - तंबारम मेइन रोड, सन्तोषपुरम, मेडावक्कम, चेंगलपट्टु जिला, तमिलनाडु - 600 073
No. 41/8A, 2/285, Velachery - Tambaram Main Road, Sathosapuram, Medavakkam, Chennai, Chengalpattu District, Tamil Nadu - 600 073.
दूरभाष/Phone : 91-44-2278 0159 ई-मेल/E-mail : piuchengalpattu@nhai.org



NHAI/11020/32/2024/PIU.CPT/ 1865

19th September 2024

Invitation of Public Comments

Sub: NHAI, PIU-Chengalpattu- Highway Administration Tambaram to Tindivanam Section of NH-45 from Km.28/000 to Km.121/000 in the state of Tamil Nadu- Laying of 11KV from 110/33/11 KV SRI RAM SS to 33/11KV Perungalathur SS by TANGEDO (TNPDC) O&M/ Tambaram Division Open cutting method- Reg.

This has reference to the proposal received by NHAI from M/s. TANGEDCO (TNPDC) Laying of 5Nos of 11KV cable for a length of 1175m from Km. 28+875 to 30+050 on LHS in the State of Tamil Nadu. The details as hereunder:

i. Along Highway:

Sl. No.	Chainage		Side	Length (in Mtr)
	From	To		
1	28+875	29+480	LHS	625
2	29+500	30+050	LHS	550

The proposal layout enclosed herewith, please.

2. As per the guidelines issued by the Ministry vide letter No. RW/NH-33044/29/2015-S&R(R) dated 22.11.2016, the proposal submitted by M/s. TANGEDCO will be made available for 30 days seeking Public Comments / Objections and shall be furnished within 30 days from the day of closure of public objections.


In view of the above, comments of the public on the above proposal are invited and may be sent to the below mentioned address:

The Project Director

Project Implementation Unit-Chengalpattu
National Highways Authority of India
(Ministry of Road, Transport & Highways)
No. 41/8A, 2/285, Second Floor,
Velachery-Tambaram Main Road,
Santhosapuram, Medavakkam,
Chengalpattu District, Tamil Nadu.
Pin Code - 600 073.

Encl: Layout

Yours faithfully,

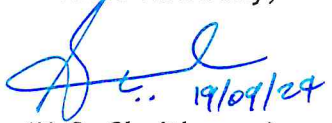


(M.S. Chaithanya)

Project Director.

Copy to:

1. NHAI website
2. The NIC, New Delhi - for uploading in the Ministry's website.
3. Regional Officer, NHAI, Chennai - for kind information.
4. Executive Engineer, O&M, TNPDC, Tambaram.

**SKETCH SHOWING FOR INTER LINKING CABLES FROM
110/33/ 11 KV SRI RAM SS TO 33/11 KV PERUNGALATHUR SS.**

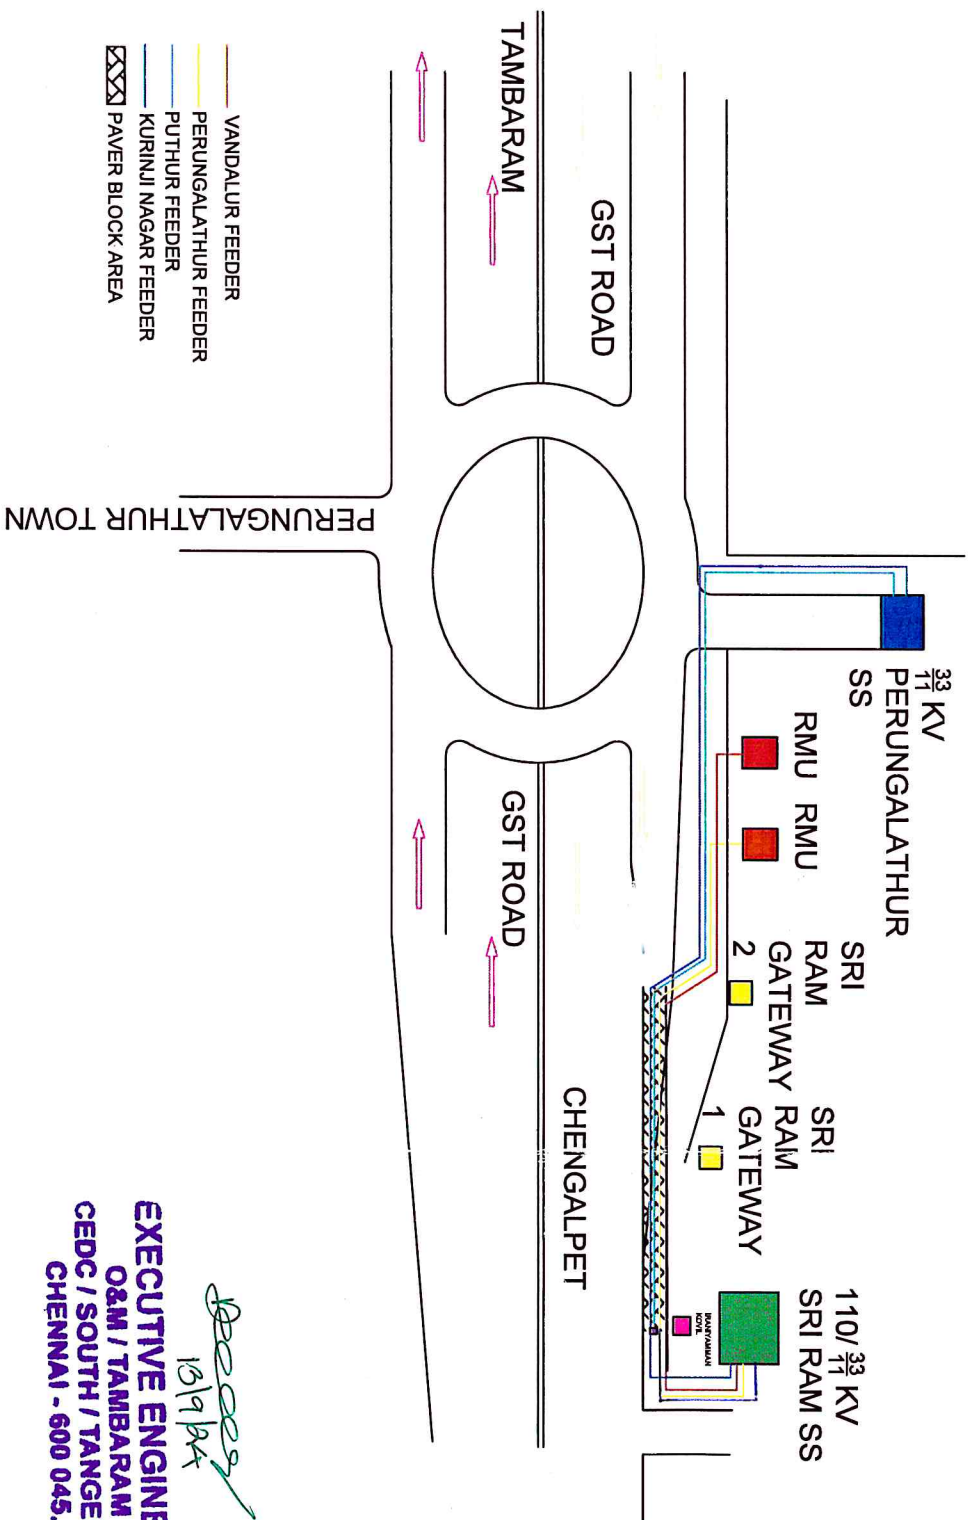

13/9/24
EXECUTIVE ENGINEER
O&M / TAMBARAM
CEDC / SOUTH / TANGEDCO
CHENNAI - 600 045.

TNPDCL

From

Er.S.K.Karuppasami,AMIE;M.Tech
Executive Engineer,
O&M/Tambaram,
TNPDCL,
Chennai-45

To

The Project Director,
National Highway Authority of India,
Perungulathur ROB,
Chengalpet

Lr.No: EE/O&M/Tambaram/F.Shifting of PGLR SS/D. ¹⁹⁰³/2024 dt. ¹³.09.2024

Sir,

Sub: Electricity –CEDC/south-II –Shifting of 33/11KV Perungalathur SS – due to ROB
in Perungulathur-cable laying work –along NH45-Permission requested –Reg.

Ref : 1. Letter No.59/2021/LC 32/Perungalathur ROB/JDO Dated.27.3.2024.
2. Memo No: CE/D/KPMR/EET/AEE/SFTY /F.Perungalathur SS/D.248
dt. 12.09.2024

In the above cited reference (1), the Highways Department has requested for the shifting of the Perungulathur 33/11KV substation due to the construction of the Perungulathur ROB and the Tambaram Eastern by pass road. The work has been taken and the completion of works will take some time.

In the meeting held in the Secretariat headed by the respected Chief Secretary of Tamil nadu, it was instructed to complete the above shifting work very urgently. Hence it has been proposed to transfer the 05 no's 11KV feeder loads of the Perungulathur 33/11KV SS to the Sriram property 110/11 KV SS in urgent manner.


For this it is proposed to lay the 11KV cables along the edge of the NH-45 from the Eraniamman kovil to the gate way company entrance below the paver black portion along the road side to a distance of 550 meters and then up to the Gandhi road junction , kamaraj nagar to a distance of 625 meters by open cut method.

INWARD		
NHAI, PIU-Chengalpattu		
Dy.No. <u>2294</u>	Date: <u>13/09/24</u>	
PD <u>[Signature]</u>	Priority <u>[Signature]</u>	
DM-T <u>[Signature]</u>	PA	LAO
P.KAR (S.E)	P.VR (S.E)	P.RS (S.E)
V.KUM (S.E)	M.ASH(S.E)	AC
YHE	IT Expert	DL

From Gateway company entrance to Gandhi road junction, Kamaraj nagar, the new cables will be laid along with the old cables which were taken away from the ground for the construction of the ROB by the high way department after the completion of pending drain work in the service road.

It is submitted that the new 5 No's cables could be not be laid under the HDD method as laying of the cable will cause heavy damage to the adjacent cables.

Hence it is requested to issue necessary permission for laying of the above cables in open cut method to complete the shifting early as requested by the State Highway department.


13/9/24
Executive Engineer
O&M / Tambaram.

Enclosed:

- 1.Undertaking
- 2.Check list
- 3.Sketch

Copy submitted to the Superintending Engineer/CEDC/South-II for information pl.

Copy submitted to the Chief Engineer/Distribution/Kanchipuram Region for information pl.