

**RW/BHP/MP/Transmission-Line(03)/2024-25****Government of India****Ministry of Road Transport & Highways
(Chief Engineer - Regional Office, Bhopal)**2nd Floor, Nirman Bhawan, Arera Hills, Bhopal-462011

PH: 0755-2551329, 0755-2571467, Email ID: ro.bpl-morth@gov.in

Date:18.09.2024**Invitation of Public Comments****Subject: Proposal for permission of overhead road crossing of 132 KV electrical transmission line of Khilchipur-RTS on under construction Khilchipur bypass on NH-752B in the state of Madhya Pradesh- reg.**

CE(NH), MPPWD, Bhopal vide letter no. NH/R/Power Grid/2024/628 dated 10.09.2024 forwarded therewith a proposal in this office for permission of overhead road crossing of 132 KV electrical transmission line of Khilchipur-RTS on under construction Khilchipur bypass on NH-752B in the state of Madhya Pradesh.

2. As per Ministry vide OM No. RW/NH-33044/29/2015/S&R(R) dated 22.11.2016, the Highways Administrator will make available the proposal seeking permission for utility laying for public comments for 30 days on ground of public interest.

3. In view of the above the comments of public are invited on captioned proposal and the same should reach to below mentioned address within 30 days beyond which no comments will be considered.

**The Highways Administration
O/o RO Highways Administration
Ministry of Road Transport & Highways
IInd Floor, Nirman Bhawan, Bhopal-462011.
Email: ro.bpl-morth@gov.in**

4. This issues with the approval of Highways Administration-cum Regional Officer, MoRT&H, Bhopal. (Computer no. – 242771).

**Signed by Shubham Kaushal
Ahirwar**

Date: 18-09-2024 13:38:08

Assistant Executive Engineer
For RO, MoRT&H, Bhopal

Copy to:

1. The Senior Technical Director, NIC, Transport Bhawan, New Delhi-110001 for uploading on Ministry's Website.
2. The CE(NH), MPPWD, Bhopal-for information.
3. The EE(NH), MPPWD, Division-Bhopal -for information and requested to furnish the recommendation in view of Ministry's circular No. RW/NH-33044/29/2015/S&R (R) dated 22.11.2016 along with verified fees viz. license fee etc. as per circular and their detailed calculations.



कार्यालय मुख्य अभियंता,
OFFICE OF THE CHIEF ENGINEER
राष्ट्रीय राजमार्ग परिक्षेत्र, लोक निर्माण विभाग
"निर्माण भवन" प्लॉट नं. 27-28 अरेरा हिल्स, भोपाल म.प्र.
NIRMAN BHAWAN 2nd FLOOR, BHOPAL M.P.

Email : cepwdnhzonemp@gmail.com ,

Phone/ Fax -0755 -2551570

Memo no. NH/R/Power Grid/2024 / 628

Bhopal, Date 10/09/2024

To,

The Chief Engineer-Regional officer
Ministry of Road Transport & Highway
Nirman Bhawan, Bhopal

Sub.:-Overhead crossing 132 KV electrical transmission line of Khilchipur-RTS under construction Khilchipur bypass road.

- Ref.:-**1.EE, EHT-C Dn. MPPTCL Bhopal memo no.73215/EHT-C/DN/964 dated 10.07.2024
2. MORT&H Ministry circular no. NH-III/P/20/77 dated 08.04.1982 and IRC 32-1969
3. EE, PWD NH Division Bhopal memo no. 2710/Technical/2024-25 dated 29.08.2024

Please refer to the memo cited under reference vide which Executive Engineer, PWD NH Division Bhopal has submitted the Proposal for Permission for Overhead crossing 132 KV electrical transmission line of Khilchipur-RTS under construction Khilchipur bypass road for necessary approval.

FDR of Rs. 36,000/- dated 16.08.2024, valid upto 16.08.2025 {Union Bank of India} is also deposited in favour of Executive Engineer, PWD NH Division Bhopal and license / lease rent of Rs. 56,371/- deposited on NTRP Portal on dated 23.08.2024 (Bharatkosh. Gov. in by Ref. no. 2308240041443).

Hence, the proposal for Permission for Overhead crossing 132 KV electrical Power transmission line received from EE, PWD NH Division Bhopal is enclosed herewith to accord the permission on condition of approval of drawing from EE before start of aforesaid work.

Encl: As above

Approved by Chief Engineer (NHs)

[Signature]
SUPERINTENDING ENGINEER
OFFICE OF THE CHIEF ENGINEER
NATIONAL HIGHWAY ZONE
M.P.P.W.D BHOPAL

Bhopal, Date 10/09/2024

Endt. No. NH/R/Power Grid/2024

Copy is forwarded to,

1. Executive Engineer, PWD NH Division Bhopal for information.

[Signature]
SUPERINTENDING ENGINEER
OFFICE OF THE CHIEF ENGINEER
NATIONAL HIGHWAY ZONE
M.P.P.W.D BHOPAL

कार्यालय कार्यपालन यंत्री लोक निर्माण विभाग रा.रा.संभाग भोपाल(मिसरोद)(म.प्र.)

email:- eepwdnhbhopal@gmail.com Phone No:- 0755. 2488956

पत्र क्रमांक / 2710 / तकनीकी / 2024-25

भोपाल दिनांक 29/8/24

प्रति,

मुख्य अभियंता,
लो.नि.वि.रा.रा.परिक्षेत्र
निर्माण भवन भोपाल

विषय:-

प्रस्तावित 132 के.व्ही. खिलचीपुर उपकेन्द्र से आर.टी.एस.खिलचीपुर 132 के व्ही.डी.सी.डी.सी. पारेषण लाइन के निर्माणधीन खिलचीपुर बाईपास रोड को ओवरहेड कॉस करने हेतु निर्माण की अनुमति बावत्।

संदर्भ:-

म.प्र.पॉवर ट्रांसमिशन कम्पनी लिमिटेड भोपाल का पत्र क्रं. 73215/अउदा-नि./1129 भोपाल दिनांक 29.08.2024

00

उपरोक्त विषयान्तर्गत लेख है कि रा.रा. 752-बी खिलचीपुर बायपास मार्ग कि.मी. 0+000 से 5+500 मार्ग में निर्माण कार्य प्रगतिरत है। जिसके अन्तर्गत प्रस्तावित 132 के.व्ही. खिलचीपुर उपकेन्द्र से आर. टी.एस.खिलचीपुर 132 के व्ही.डी.सी.डी.सी. पारेषण लाइन के निर्माणधीन खिलचीपुर बाईपास रोड को ओवरहेड कॉस करने हेतु निर्माण की अनुमति चाही गई थी, जिसके संबंध में इस कार्यालय के पत्र क्रं. 790 दिनांक 23.07.2024 द्वारा बी.जी.राशि रुपये 36000/- एवं लाईसेंस फीस राशि रुपये 56371/- जमा करने हेतु लेख किया गया था।

अतः संदर्भित पत्र द्वारा राशि रु0 36000/- की एफ.डी.आर. कार्यपालन यंत्री लो.नि.वि.रा.रा. संभाग भोपाल के नाम से बनाकर एवं लाईसेंस फीस राशि रुपये 56371/- का भारत कोष पोर्टल पर जमा करवा दी गई है। अतः प्रकरण आपकी ओर आवश्यक अनुमति हेतु प्रेषित है।

सहपत्र:- उपरोक्तानुसार

(6001)
कार्यपालन यंत्री

लो0नि0वि0रा0रा0, संभाग भोपाल

पृ0पत्र क्रमांक

तकनीकी./2024-25


भोपाल दिनांक

प्रतिलिपि:- कार्यपालन अभियंता अ.उ.दा.निर्माण संभाग म.प्र.पॉ.ट्रा.क.लि.भोपाल (म.प्र0)की ओर सूचनार्थ प्रेषित।

हच

कार्यपालन यंत्री
लो0नि0वि0रा0रा0, संभाग भोपाल

RPNO
2323
21/9/24



(Scan this for Deposit Details)

(Scan this for Terms & Conditions)

ARERA HILLS BHOPAL
TERM DEPOSIT ADVICE
(in lieu of Term Deposit Receipt)

Advice No: DAP5810000000000000000764289

Date: 20.08.2024

New

Dear Sir/Madam,

We have pleasure in confirming your deposit held with us, the details of which are as shown below.

Your FD account no. 581003030006311 Please quote this in all future correspondences.

Thank you for banking with us.

A Customer Names

1) EXECUTIVE ENGINEER PWD 2)
NH DIVISION BHOPAL

3)

CIF Number:

271701746

Mode of Operation:

AUTHORISED SIGNATORY

Scheme:

DRIC DEP REINVEST CERT

Maturity instructions:

Renewal

Frequency of Interest payment:

Half-Yearly

Credit Interest & maturity proceeds to account no.:

581001010050104

Nomination:

N

Nominee(s) Name/Reg no.:

Reverse Account No.:


113600030300185

TDR a/c No.	Tenure	Interest Rate	Principal Amt	Value Date	Maturity Date	Maturity Value
581003030006311	12 Months 0 Days	6.8	36000	16-08-2024	16-08-2025	38511

B Terms and Conditions for TDR

- (1) This term deposit advice is not transferable.
- (2) Please inform us of any change in your Resident/Non-Resident status as and when such change takes place. The status declaration on the account opening form shall remain in force until such time as a change is advised to us.
- (3) The account number given in the term deposit advice only needs to be quoted with your instructions to us in all future communication by the depositor/s. There is no need to physically send this term deposit advice.
- (4) Payment of interest is subject to Tax at Source (TDS) as per Income Tax rules in case of domestic deposits.
- (5) Please furnish proof of PAN to avoid TDS at higher rates, as per Income Tax rules.
- (6) If you are exempt from TDS, please furnish the duplicate form 15G/H as applicable in the month of April of each financial year. The facility for online submission of Form 15G/H is also available.
- (7) The Maturity date is recorded on the certificate to enable the depositors to receive the maturity on the due date. The Bank is not bound to give further intimation of the due date.
- (8) Interest on the deposits withdrawn before the maturity date will be paid at the rate applicable to the period for which the deposit has run or the contracted rate whichever is lower. The bank reserves the right to charge a penalty for pre-mature withdrawal or extension of deposit.
- (9) Term Deposit will be disposed off according to the maturity instructions given at the time of opening of the deposit. In case of auto renewal, the deposit will be renewed for the same duration for which it was originally kept, at the rate of interest prevailing on the date of renewal for that duration, if auto renewal instructions are given, the instructions will continue to be executed till terminated by deposit account holder/s.
- (10) Monthly interest is paid at a discounted rate.
- (11) Please note the above terms and conditions are subject to change from time to time.





bharatkosh.gov.in

Government of India Receipt Portal

RECEIPT

Transaction Ref.No. 2308240041443

Dated: Aug 23 2024 5:48PM

Received from MR. EXECUTIVE ENGINEER with Transaction Ref.No.
2308240041443

Dated Aug 23 2024 5:48PM the sum of INR 56371 (Fifty-Six Thousand Three
Hundred Seventy-One Only) through Internet based Online payment in the
account of

License fee for laying of utility services, , Proposal for over head crossing of EE
PWD NH DIVISION BHOPAL.

Disclaimer:- This is a system generated electronic receipt, hence no physical signature
is required for the purpose of authentication

Printed On: 23-08-2024 05:52:20

पत्र क्रमांक/२३७८ /तकनीकी. / 2024-25 भोपाल दिनांक २३/७/२५

प्रति,


कार्यपालन यंत्री
ईएचटी-सी.रा.संभाग
एम.पी.पी.टी.सी.एल.
बिजली नगर कालोनी
गोविन्दपुरा भोपाल.
ई-मेल eeeht.d2.bpl@mptransco.nic.in

विषय:- 132 KV Khilchipur-RTS Khilchipur transmission line, proposal for overhead crossing of under construction Khilchipur Bypass road. पर प्रस्ताव अनुमोदन हेतु जमा किये जाने वाली बैंक गारंटी की राशि के संबंध में।

संदर्भ:- आपका पत्र क्र. 7904 दिनांक 23.07.2024

000


उपरोक्त विषयातर्गत संदर्भित पत्र के द्वारा आपने लेख किया है कि आपके द्वारा भारत खिलचीपुर बायपास मार्ग पर 132 के.वी. लाइन के कार्य की अनुमति में बैंक गारंटी रु. 38000/- जमा किया जाना संभव नहीं है। जिसके तारतम्य में लेख है कि आप उक्त राशि 38000/- की एफ.डी.आर. कार्यपालन यंत्री, लो.नि.वि.रा.रा.संभाग भोपाल के नाम से बनवाकर इस कार्यालय में प्रस्तुत करें, साथ ही लाईसेंस कोश रु. 56371/- की राशि भारत कोष पोर्टल पर ऑनलाइन जमा करें, ताकि अनुमति की कार्यवाही को जा सकें।


कार्यपालन यंत्री,
लो.नि.वि.रा.रा.संभाग भोपाल

पत्र क्रमांक/२३७९ /तकनीकी. / 2024-25/ भोपाल दिनांक २३/७/२५

प्रतिलिपि:- 1. मुख्य अभियंता लोक निर्माण विभाग निर्माण भवन रा.रा.परिक्षेत्र की ओर सूचनार्थ प्रेषित।
2. अनुविभागीय अधिकारी लो.नि.वि.रा.रा.उपसंभाग भोपाल की ओर सूचनार्थ प्रेषित।

H.S. Barmale
23-7-24


कार्यपालन यंत्री,
लो.नि.वि.रा.रा.संभाग भोपाल

कार्यालय कार्यपालन यंत्री लोक निर्माण विभाग रा.रा.संभाग (मिसरोद) भोपाल(म.प्र.)

email:- eepwdnhbhopal@gmail.com Phone No:- 0755. 2488956

पत्र क्रमांक / 2308 / तकनीकी. / 2024-25 भोपाल दिनांक 16.07.24

प्रति,

✓ कार्यपालन यंत्री
ईएचटी-सी संभाग
एम.पी.पी.टी.सी.एल.
बिजली नगर कालोनी
गोविन्दपुरा भोपाल.
ई-मेल eeht.d2.bpl@mptransco.nic.in


विषय:- 132 KV Khilchipur-RTS Khilchipur transmission line, proposal for overhead crossing of under construction Khilchipur Bypass road. पर कार्य बंद करने के संबंध में।

संदर्भ:-
1. आपका पत्र क्र. 964 दिनांक 10.07.2024
2. मुख्य अभियंता रा.रा. भोपाल का पत्र क्र. 391 दिनांक 15.07.2024
3. अनुविभागीय अधिकारी रा.रा. उपसंभाग भोपाल का पत्र क्र. दिनांक 15.07.2024
000

उपरोक्त विषयावर्तित लेख है कि आपके द्वारा उक्त खिलचीपुर बायपास भाग पर 132 कीवी लाईन का कार्य बगैर अनुमति के किया जा रहा है। जिसके संबंध में संदर्भित पत्र क्रमांक 02 के द्वारा निर्देशित किया गया है कि उक्त कार्य तुरन्त बंद करे एवं अनुमति प्राप्त होने पर कार्य करना सुनिश्चित करें।


अतः संदर्भित पत्र क्रमांक 03 अनुविभागीय अधिकारी रा.रा. उपसंभाग भोपाल से प्राप्त संलग्न प्रपत्र अनुसार भारत सरकार सड़क परिवहन एवं राजमार्ग मंत्रालय की गाइड लाईन NH-36094/03/2023-SNR(T&D) दिनांक 24.04.2023 के अनुसार बैंक गारंटी रु. 36000/- की कार्यपालन यंत्री लो.नि.वि.रा.संभाग भोपाल के नाम से बनवाकर एवं लाईसेंस फीस रु. 56371/- लाईसेंस फीस भरवा कर अनुमति प्राप्त करें।

सहपत्र:- प्रपत्र


कार्यपालन यंत्री,
लो.नि.वि.रा.संभाग भोपाल

पत्र क्रमांक / 2309 / तकनीकी. / 2024-25 / भोपाल दिनांक 16.07.24

प्रतिलिपि:- 1. मुख्य अभियंता लोक निर्माण विभाग निर्माण भवन रा.रा.परिपत्र की ओर सूचनाएं भेजित।
2. अनुविभागीय अधिकारी लो.नि.वि.रा.संभाग भोपाल को ओर सूचनाएं कर लेख है कि उक्त कार्य तुरन्त बंद करवायें, एवं अनुमति प्राप्त करने के पश्चात ही कार्य करवाना सुनिश्चित करें।


कार्यपालन यंत्री,
लो.नि.वि.रा.संभाग भोपाल



MADHYA PRADESH POWER TRANSMISSION COMPANY LTD.

(A Govt. of M.P. Undertaking)

OFFICE OF EXECUTIVE ENGINEER EHT-CONSTRUCTION DIVISION

F-4, Transmission Administrative Building, Govindpura Bhopal 462023

Tel.: No. (0755) 2586428, e-mail: eeehtc.d2.bpl@mptransco.nic.in



का.अ./अ.उ.दा./नि./संभाग/ 790

भोपाल दि.- 23-7-24

प्रति,

कार्यपालन अभियंता,
लो.नि.वि. रा.रा. संभाग भोपाल

विषय :- 132 KV Khilchipur - RTS Khilchipur transmission line के प्रस्ताव अनुमोदन हेतु जमा किये जाने वाली बैंक गारंटी की राशि के संबंध में।

संदर्भ :- 01. इस कार्यालय का पत्र क्र. 964 दि. 10.07.2024

02. आपका पत्र क्रमांक/2308/तकनीकी/2024-25 भोपाल दि. 16.07.2024

उपरोक्त विषयांतर्गत लेख है कि खिलचीपुर बायपास मार्ग पर 132 के.व्ही. खिलचीपुर - आर.टी.एस. खिलचीपुर का निर्माण कार्य प्रस्तावित है। संदर्भित पत्र के माध्यम से आपके द्वारा भारत सरकार सड़क परिवहन एवं राजमार्ग मंत्रालय की गाइड लाइन NH-36094/01/2022-SNR (T&D) दिनांक 24.04.2023 के अनुसार बैंक गारंटी रु. 36000/- एवं लाइसेंस फीस रु. 56371/- अनुमति हेतु जमा करने का लेख किया गया है। उक्त संबंध में लेख है कि उक्त रु. 36000/- की राशि बैंक गारंटी के रूप में जमा किया जाना संभव नहीं है।

अतः बैंक गारंटी रु. 36000/- की राशि को डी.डी. के माध्यम से जमा करने हेतु अपनी सहमति प्रदाय करने का कष्ट करें जिससे इस कार्यालय के द्वारा अग्रिम कार्यवाही की जा सके।

कार्यपालन अभियंता
अउदा-नि. संभाग
म.प्र.पा.ट्रां.कं.लि. भोपाल

प्रतिलिपि :-

01. मुख्य अभियंता लोक निर्माण विभाग, निर्माण भवन रा.रा. परिक्षेत्र, भोपाल।
02. अधीक्षण अभियंता (अउदा-नि) वृत्त, म. प्र. पा. ट्रां. कं. लि. भोपाल।

कार्यपालन अभियंता
अउदा-नि. संभाग
म.प्र.पा.ट्रां.कं.लि. भोपाल

कार्यालय कार्यपालन यंत्री लोक निर्माण विभाग रा.रा.संभाग (मिसरोड) भोपाल(म.प्र.)

email:- eepwdnhbhopal@gmail.com Phone No:- 0755. 2488956

पत्र क्रमांक / 2308 / तकनीकी / 2024-25 भोपाल दिनांक 16.07.24

प्रति,

✓ कार्यपालन यंत्री
ईएचटी-सी संभाग
एम.पी.पी.टी.सी.एल.
बिजली नगर कालोनी
गोविन्दपुरा भोपाल.
ई-मेल eeeht.d2.bpl@mptransco.nic.in


विषय:- 132 KV Khilchipur-RTS Khilchipur transmission line, proposal for overhead crossing of under construction Khilchipur Bypass road. पर कार्य बंद करने के संबंध में।

संदर्भ:-
1. आपका पत्र क्र. 964 दिनांक 10.07.2024
2. मुख्य अभियंता रा.रा. भोपाल का पत्र क्र. 391 दिनांक 15.07.2024
3. अनुविभागीय अधिकारी रा.रा. उपसंभाग भोपाल का पत्र क्र. दिनांक 15.07.2024
000

उपरोक्त विषयावर्तित लेख है कि आपके द्वारा उक्त खिलचीपुर बायपास मार्ग पर 132 की वॉ लाईन का कार्य बगैर अनुमति के किया जा रहा है। जिसके संबंध में संदर्भित पत्र क्रमांक 02 के द्वारा निर्देशित किया गया है कि उक्त कार्य तुरन्त बंद करे एवं अनुमति प्रस्ताव ही कार्य करना सुनिश्चित करें।


अतः संदर्भित पत्र क्रमांक 03 अनुविभागीय अधिकारी रा.रा. उपसंभाग भोपाल से प्राप्त संलग्न प्रपत्र अनुसार भारत सरकार सड़क परिवहन एवं राजमार्ग मंत्रालय की गाइड लाईन NH-36094/01/2012 SNR(T&D) दिनांक 24.04.2023 के अनुसार बैंक गारंटी रु. 36000/- की कार्यपालन यंत्री लो.नि.वि.रा.संभाग भोपाल के नाम से बनवाकर एवं लाईसेंस फीस रु. 56371/- लाईसेंस फीस भरवा कर अनुमति प्राप्त करें।

सहपत्र:- प्रपत्र


कार्यपालन यंत्री
लो.नि.वि.रा.संभाग भोपाल

पत्र क्रमांक / 2309 / तकनीकी / 2024-25 / भोपाल दिनांक 16.07.24

प्रतिलिपि:- 1. मुख्य अभियंता लोक निर्माण विभाग निर्माण भवन रा.रा.परिक्षेत्र वी और सूचनाएं भेजित।
2. अनुविभागीय अधिकारी लो.नि.वि.रा.संभाग भोपाल को और सूचनाएं कर लेख है कि एका कार्य तुरन्त बंद करवायें, एवं अनुमति प्राप्त करने के पश्चात ही कार्य करवाना सुनिश्चित करें।



कार्यपालन यंत्री
लो.नि.वि.रा.संभाग भोपाल

Calculation of bank guarantee as per the north guidelines No. Circular F.No. RW/NH-36094/01/2022-

S&R(P&B) (E-208825) Dated 24.04.2023 for

Name of Project :- Grant of Permission for NH-752 B Crossing by 132 kv Khilchipur Traction Line proposal for crossing of Khilchipur Bypass at ch. 3+955 Village- Jalampura (District - Rajgarh

Sr.	Particular	Distance between Tower Conductor (Mtr.:	RoW Width (Mtr.)	Area of Utility Service (Mtr.)	Rate/mtr as per Ministry Guidelines Pare 6	Amount of Performance Bank Guarantee (Rs.)
		(A)	(B)	C = AxB	D	E= (Cx D)
1	Bank Gaurantee	8.0 m	45	360	100	36000
	8m As per Revenue Department Circular no. F-16-13/2017/7/2 Bhopal Dated 01.04.2019 for 132 kv double circuit (For <=300 mm dia/width)					


Sub.Divisional Officer
P.W.D. N.H. Sub. Division
Bhopal (M.P.)



OFFICE OF THE CHIEF ENGINEER
राष्ट्रीय राजमार्ग परियोजना, लोक निर्माण विभाग
NATIONAL HIGHWAY ZONE M. P. PUBLIC WORK DEPARTMENT
"निर्माण भवन" प्लॉट नं. 27-28 अरेरा हिल्स, भोपाल म.प्र.
NIRMAN BHAWAN 2nd FLOOR, BHOPAL M.P.

Email : cepwdnhzonemp@gmail.com

Phone/ Fax - 0755-2551570

Memo no. NH/R/Power Grid/2022 / 331

Bhopal, Date / 5/07/2024

To,

The Executive Engineer
MP PWD Nh Division, Bhopal

Sub : Overhead crossing 132 KV electrical transmission line of Khilchipur-RTS under Construction Khilchipur bypass road.

Ref:-1. EE, EHT-C Dn. MPPTCL, Bhopal memo no. 73215/EHT-C/DN/964 dated 10.07.2024
2. MORT&H, Ministry circular no. NH-III/P/20/77 dt. 8.04.1982 and IRC 32-1969

Please refer to the memo cited under reference vide which Executive Engineer, EHT-C Dn. MPPTCL, Bhopal has addressed a proposal to your self with a copy to this office reg. Permission of Overhead crossing 132 KV electrical transmission line of Khilchipur-RTS under Construction Khilchipur bypass road.

It is mentioned that the EE, EHT-C Dn. MPPTCL, Bhopal has intimated to start the construction of road crossing tower as well as overhead conductor stringing.

Hence, in view of above you are directed to take appropriate necessary action on referred letter (Ref. No. 1) to Stop the work and intimate to EE, EHT-C Dn. MPPTCL, Bhopal for getting permission for subjected work as per MORT&H, Ministry circular alongwith your comments immediately to this office.

Encl: As above

Approved by Chief Engineer (NHs)

SUPERINTENDING ENGINEER
OFFICE OF THE CHIEF ENGINEER
NATIONAL HIGHWAY ZONE
M.P.P.W.D BHOPAL

Bhopal, Date / 07/2024

Endt. No. NH/R/Power Grid/2022

Copy is forwarded to,

1. Executive Engineer, EHT-C Dn. MPPTCL; Administrative complex building, Bijli Nagar Colony, Govindpura, Bhopal Email eeehtc.d2.bpl@mpuransco.nic.in for information.

SUPERINTENDING ENGINEER
OFFICE OF THE CHIEF ENGINEER
NATIONAL HIGHWAY ZONE
M.P.P.W.D BHOPAL



OFFICE OF THE EXECUTIVE ENGINEER EHT (CONSTN) DN
M.P. POWER TRANSMISSION CO. LTD. BHOPAL -0755-2586428
(UNDERTAKING OF M.P. GOVT.)

Office: - Administrative Complex Building, Bijli Nagar colony, Govindpura, Bhopal-23
(0755)-2586428, E-mail- ceehtc.d2.bpl@mptransco.nic.in

No. 73215/EHT-C/DN/ 964

Bhopal Dt. 10/07/24

To,

The Executive Engineer
PWD (NH Division), Misrod
Hoshangabad Road, Bhopal

Sub: -132KV Khilchipur-RTS Khilchipur transmission line, proposal for overhead crossing of under construction Khilchipur Bypass road. **Permission thereof.**

Ref: - (1) MP Gazette Notification No. 31 dtd. 03.08.2022.
(2) This office letter No. 864 dtd. 01.07.2024.

Apropos to the above subject it is to intimate that, a proposal of 132KV Khilchipur-RTS Khilchipur transmission line overhead crossing to your under construction Khilchipur Bypass road was submitted for competent permission vide this office letter cited under ref.-2.

In the above context is to intimate that the construction work of the above 132KV Khilchipur -RTS Khilchipur transmission line was already notified to the public on dtd. 03.08.2022 vide the MP Gazette notification under reference-1, far prior to your Khilchipur Bypass road notification.

Here, it is to mention that, the construction of aforesaid transmission line is top most priority work of Central Govt. Indian Railway to feed the power supply to the 132KV Railway Traction Substation (RTS) Khilchipur and the above 132KV transmission line overhead crossing (to your under construction Khilchipur Bypass road) fulfill all the technical criterion of electrical clearances as per I.E. rules (drawing already submitted to you).

Therefore, looking to the top most priority of public interest project of Central Govt., we are going to start the construction of road crossing towers as well as overhead conductor stringing. It is for your intimation, please.

Copy to:



- 1- The Chief Engineer (NH) PWD M.P. Govt. Bhopal.
- 2- The Chief Engineer (EHT-C)/ (P&D) MPPTCL, Jabalpur.
- 3- The Superintending Engineer (EHT-C) Circle MPPTCL, Bhopal.

52-
Executive Engineer
EHT-C Dn., MPPTCL, Bhopal.


Executive Engineer
EHT-C Dn., MPPTCL, Bhopal.

132 KV DCDS 3 PHASE 6WIRE LINE FROM 132KV SUB STATION KHILCHIPUR TO PROPOSED 132KV RAILWAY TSS KHILCHIPUR

LOCATION
AP2
TOWER TYPE
E60 + 6 m
WEIGHT SPAN HOT = 254.22 m
LEFT = 139.75 m RIGHT = 114.47 m
WIND SPAN = 198.0 m
WEIGHT SPAN COLD = 283.26 m
LEFT = 195.94 m RIGHT = 87.32 m

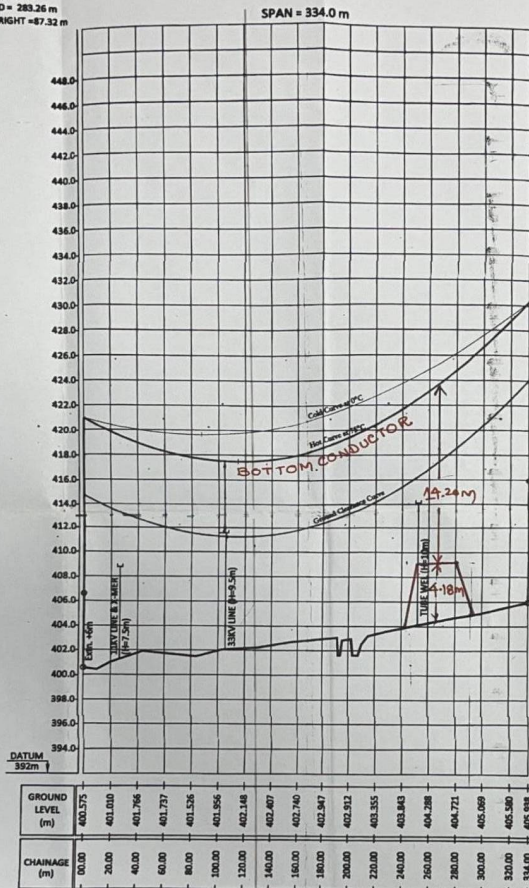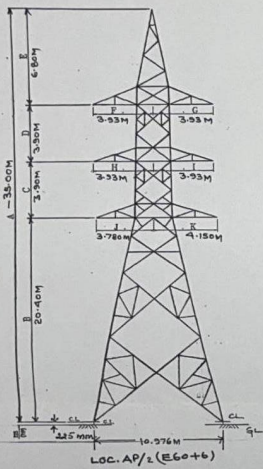

LOCATION
AP3
TOWER TYPE
E30 + 10 m
WEIGHT SPAN HOT = 342.20 m
LEFT = 219.53 m RIGHT = 122.67 m
WIND SPAN = 322.0 m
WEIGHT SPAN COLD = 352.64 m
LEFT = 246.68 m RIGHT = 105.96 m

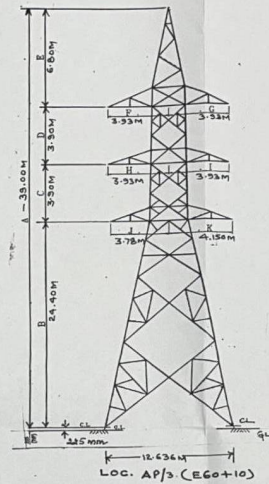

M.P. POWER TRANS. CO. LTD.

EHT CONST. DIVISION BHOPAL.

SURVEYED & DRAWN BY
R.K. SINGH
SURVEYOR

Only

CHECKED BY
AE
EHTCO. DN. BHOPAL

Snop

CHECKED BY
EE
EHTCO. DN. BHOPAL

L

SCALE:- HR- 1cm=20m
VR- 1cm=2m

