

भारत सरकार
सडक परिवहन और राजमार्ग मंत्रालय
क्षेत्रीय कार्यालय, भुवनेश्वर
प्लॉट संख्या - 184 (फायर स्टेशन चौक के पास)
बरमुन्डा, भुवनेश्वर-751003
दूरभाष : (0674) 2960994 & 2952994
ई-मेल : robbsr.morth@gmail.com



Government of India
Ministry of Road Transport & Highways
Regional Office, Bhubaneswar
Plot No. - 184 (Near Fire Station Square)
Baramunda, Bhubaneswar-751003
Ph. No.: (0674) 2960994 & 2952994
E-mail: robbsr.morth@gmail.com

No. RO/BBSR/Utility Services/NH-57/BBSR/138/2025 - 2226

Date: 24th Dec, 2025

Invitation of Public Comments

Sub: Permission for laying of 33 KV UG cable along NH-57 from km 296/100 to km 297/100 (Khordha Grid to Gurujanga PSS) i.e from Chandichia Temple Chowk to Khordha Post Office and across NH-57 at km 296/100 by TPCODL - reg.

1. Superintending Engineer, National Highway Division, Bhubaneswar vide letter dated 28.11.2025 has submitted a proposal on the mentioned subject as detailed below:

Sl. No.	NH Chainage	Available RoW (m)	Carriageway width (m)	Dia of pipe (mm)	Depth of laying of utility from GL	Length (km)	Methodology
1	Km 296/100 to 297/100 (RHS)	12.0 m	7.0	200	2.00 m	1.00	HDD
2	Km 296/100 (Crossing)	12.0 m	7.0	200	2.00 m	0.012	HDD

2. As per Ministry's OM No. RW/NH-33044/29/2015/S&R(R) dated 22nd November, 2016 the Highway Administrator will put out the application in the public domain for 30 days for seeking claims and objections on grounds of public inconvenience, safety and general public interest, if any.

3. In view of the above, comments of public for claims/objections, if any, on the above proposal are invited online as well as in hard copy. The strip plan/location details are enclosed herewith. The same should reach to the below mentioned address within 30 days from the date of uploading it in the website, beyond which no objection will be considered.

Address:

The Regional Officer,
Ministry of Road Transport & Highways,
Plot No -184, Near Fire Station Sq.,
Baramunda, Bhubaneswar - 751003.

Yours faithfully,


(Sudhansu Sekhar Sahu)
Senior Technical Assistant
For Regional Officer

Copy to:

- 1) The Senior Technical Director, NIC, Transport Bhawan, New Delhi - 110001- along with strip chart for uploading on the Ministry's website.
- 2) General public with request to furnish comments, if any, to the above mentioned address or by e-mail to "robbsr.morth@gmail.com"



डाकूरी संख्या 2427
 तारीख 28/11/2025
 सडक परिवहन और यात्रेमार्ग मंत्रालय
 क्षेत्रीय कार्यालय, भुवनेश्वर

TEL -0674-2972908-(0)
 eenh_bbsr @ yahoo.co.in

OFFICE OF THE SUPERINTENDING ENGINEER
 NATIONAL HIGHWAY DIVISION BHUBANESWAR
 PLOT NO-184, NAYAPALLI, PO-BARAMUNDA, BHUBANESWAR

No. 7967 Dt. 28-11-2025
 WE

To

The Regional Officer,
 MoRT&H, Bhubaneswar.

Sub: - Permission for Laying of 33KV UG Cable 1Rx3Cx400sqm from 132/33KV Khordha Grid to Gurujanga 33/11KV PSS from Chandichua Temple Chowk to Khordha Post Office along/across NH-57 reg.

Sir,

In inviting a reference to the subject cited above, it is to submit herewith the following documents alongwith the site inspection report in the prescribed format duly signed by the all concerned as received from the Bhubaneswar-II Circle, TPCODL, Bhubaneswar for favour of information and necessary approval.

1. A strip plan showing across/along with chainages, LHS/RHS of road NH-57 alongwith cross section drawing is enclosed.
2. A site inspection report in the prescribed proforma duly signed by the all concerned is enclosed.
3. The Highest Bench Mark value issued by the Sub-Registrar, Khordha is enclosed herewith.
4. Calculation sheet for Performance Bank Guarantee & License fees are enclosed herewith.

Yours faithfully,

Encl:- As above

Superintending Engineer
 N.H. Division, Bhubaneswar

Memo No. 7968 / Dt. 28-11-2025

Copy to the HOG Projects Bhubaneswar-II Circle, TPCODL, Bhubaneswar for information and necessary action.

Superintending Engineer
 N.H. Division, Bhubaneswar

Memo No. 7969 / Dt. 28-11-2025

Copy to the Asst. Executive Engineer, NH Sub-Division, Khordha for information and necessary action.


Superintending Engineer
 N.H. Division, Bhubaneswar


01/11/25

Sr. TA


Encloser to site inspection report for laying of 200 mm HDPE pipe for 33 KV Line Crossing Khordha Chandichua chhak to NH 57.

Sl.no	NH NO	NH changing from km to km	side of laying (Lsh /Rsh/crossing)	Available ROW	Carriageway width	Embankment	Dia of utility including casing	Methodology(OPEN TRENCH/HDD)	Depth of Laaying from Ground Level	Width of Trench
1	NH-57	296/100	CROSSING	12MTR	7M	AVG 1 MTR	200MM	HDD	2000MM	
2		296/100 TO 297/100	ALONG THE ROAD RSH	12 MTR	7M	AVG 1 MTR	200MM	HDD	2000MM	

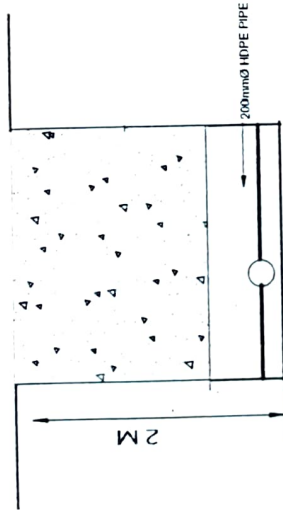

Junior Engineer
 N.H. Section, Khordha


Assistant Executive Engineer
 N.H. Sub-Division Khordha

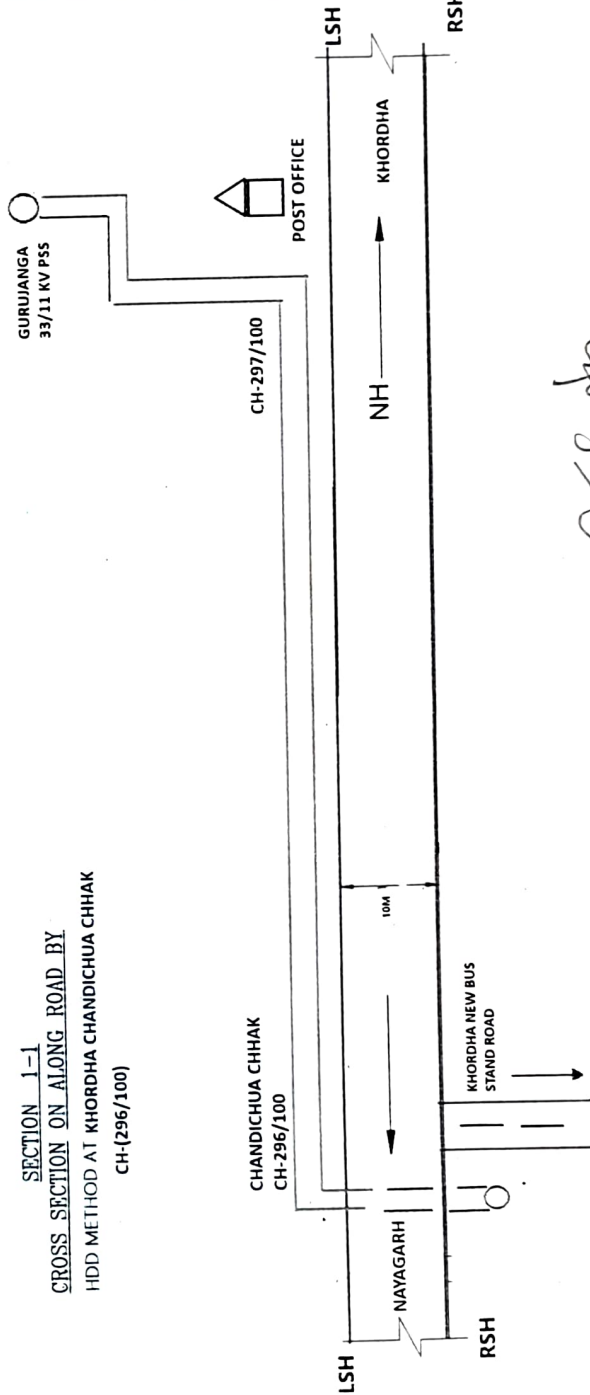

Trupti Sundar Mohanty
 HOG-Projects


Superintending Engineer
 N.H. Division, Bhubaneswar

PROPOSED NH CROSSING
GAP TO ALONG THE NH
PIPE LINE LAID



SECTION 1-1
CROSS SECTION ON ALONG ROAD BY
HDD METHOD AT KHORDHA CHANDICHUA CHHAK
CH-(296/100)



Dr. Subhankar
Dr. Subhankar

Truph...
HOG-projects

Assistant Executive Engineer
N.H. Sub-Division Khordha

Engineer
N.H. Section, Khordha

DATE: 2024.08.27

PROOF CHECKED BY: [Signature]

APPROVED BY: [Signature]

NOTES:
1. ALL DIMENSIONS ARE IN MM

NO.	REVISION	DATE	BY	CHKD BY	APPD BY
1					
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					

Calculation of License Fees (33 kv UG Cable at Chandikanto Post Office)

Sl no	Block	Mouza	NH	Chainage	Side of laying (LHS,RHS ,Crossing.)	Length(mt)	Width/ Dia	Utilised NH land Area (Sqm)	Circle Rate(Acre)	Circle Rate(sqm)	License fee for Month	License fee for five years	License Fee (33%) for public utilities
1	khordha	Jajarsingh	57	296.100	Crossing	12	0.3	3.6	45173700	11162.268	334.868	20092.083	6630.387
1	khordha	Jajarsingh	57	296.100 to 297.100	Along The Road LHS	1000	0.3	300	45173700	11162.268	27905.671	1674340.252	552532.283
													559162.671
												Say as	559163.000


Junior Engineer
NH Section, Khordha



Assistant Executive Engineer
NH Sub Division, Khordha


Superintending Engineer
NH Division, Bhubaneswar


Calculation for Performance Bank Guarentee as per utilized area of NH-57.(33 kv UG Cable at chandichua to post office khordha town)

Sl No.	Pipe Dia (mm)	Length	Rate	Amount
1	200	12	100	1200.00
2	200	1000	100	100000.00
			TOTAL	101200.00

As per guidelines of Ministry circular on 22.11.2016,perfoormance bank guarentee based on route meter valid 01 year initially as per rate Rs 100/mt for dia < 300mm and Rs 250/mt for dia > 300mm pipe.


22/10/25
Junior Engineer
NH Section,Khordha


22/10/25
Assistant Executive Engineer
NH Sub Division,Khordha


28/11
Superintending Engineer
NH Division,Bhubaneswar



OFFICE OF THE SUB-REGISTRAR, KHORDHA

Email: sr.khordha@gmail.com
Phone: 06755221920/220212

Letter No. 2187

Date: 23/9/2025

To

The TPCODL,
Bhubaneswar-II-Circle

Sub: Submission of Highest Bench Mark Value

Ref: Your letter no-TPCODL/BBSR2/25-26/081 Dt 19.09.2025

Sir,

With reference to your letter on the subject cited above, I am to send herewith the highest bench mark value of the mouza-Jajarsingh-124 for the year 2024-26 for favour of your reference.

Mouza

Highest Bench Mark Value(Per Acre)

Jajarsingh: 124

Rs 4,51,73,700/-

Yours faithfully

M. 23.9.25

Sub-Registrar
SUB-REGISTRAR
KHORDHA

TPCODL

Ref: TPCODL/PROJECTS/KHD/25-26/75

Dated:- 08.09.2025

To
The Executive Engineer
NH Division,
Plot No.-184, Nayapalli,
Bhubaneswar

Subject: Regarding Permission for Laying of 33kV UG Cable 1Rx3Cx400Sqmm from 132/33kV Khordha Grid to Gurujanga 33/11kV PSS from Chandichua temple Chowk to Khordha Post Office along NH-57 under OERC Capex Scheme Fy25-26

Dear Sir,

With reference to above-mentioned subject, we would like to intimate you that a proposal for laying of 33kV UG Cable 1Rx3Cx400Sqmm from Khordha 132/33kV Grid to Gurujanga 33/11kV PSS along NH-57 from Chandichua Temple Chowk to Khordha Post Office have been approved under OERC Capex Fy25-26 to mitigate the low voltage issue and provide reliable power supply in Khordha, Jatni, Janla area.

We are hereby submitting the Single Line Diagram for laying of 33kV UG Cable. Hence, it is requested to kindly grant your permission for laying of 33kV UG cable along NH-57 from above mentioned route for improvement in reliability of power supply for Khordha, Jatni & Janla area.

An early action in this regard will be highly solicited.

Thanks & Regards,


HOG - Projects
BBSR-II Circle
Mob - 7008366152
Email - trupti.mohanty@tpcentralodisha.com

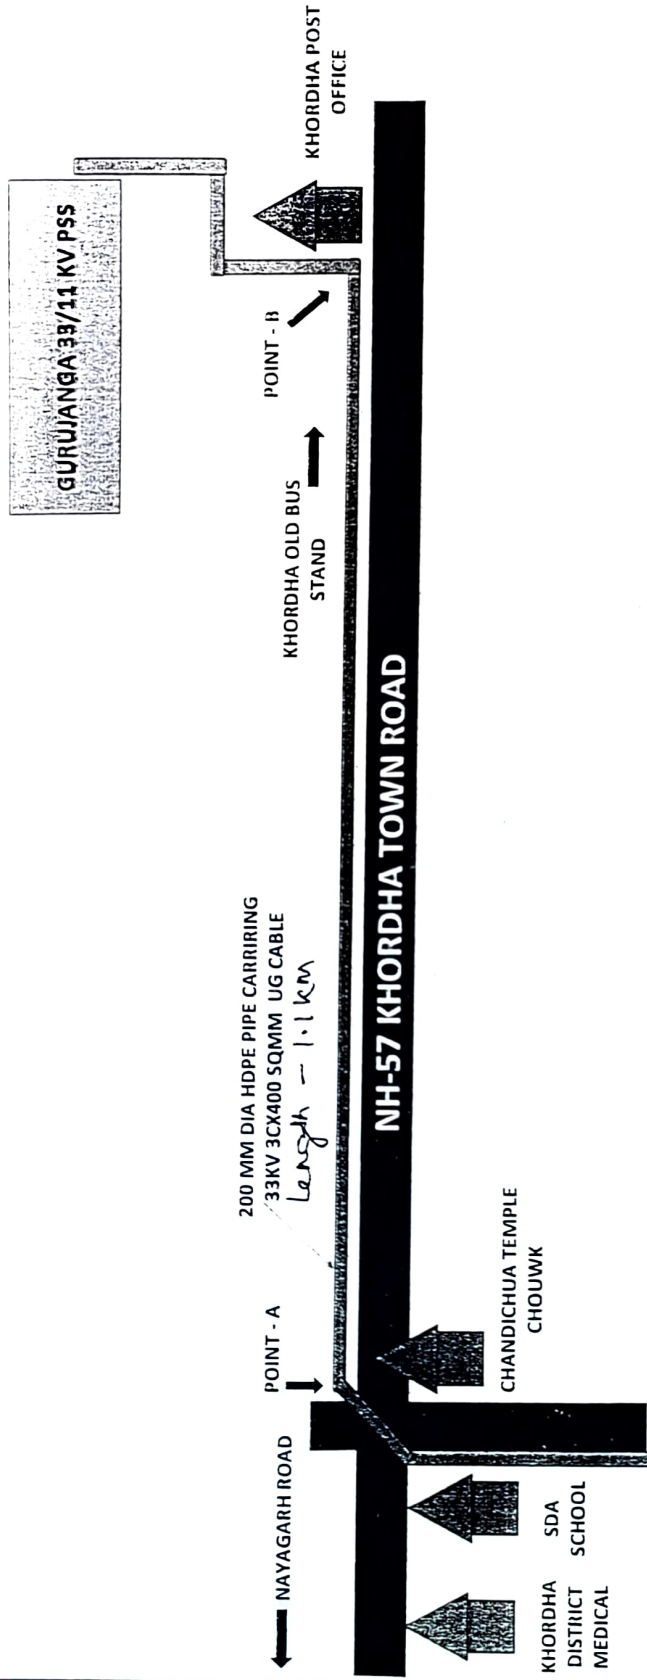
C.C:-

1. Assistant Executive Engineer, NH Sub-Division, Khordha
2. Circle Head, TPCODL, BBSR-2
3. Head-Projects, TPCODL, BBSR-2, Paradeep & NED
4. Executive Engineer, TPCODL, Khordha

TP CENTRAL ODISHA DISTRIBUTION LIMITED
(A Tata Power and Odisha Government Joint Venture)
Corporate Office: IDCO Towers, 2nd Floor, Janpath, Bhubaneswar - 751022
Registered Office: GRIDCO A/W Building, Janpath, Bhubaneswar, Khordha, Orissa - 751022. Tel.: 0674 2541575
Web: www.tpcentralodisha.com. E-mail: tpcodl@tpcentralodisha.com. CIN : U40100OR2020SGC032901

2/9/2025

SCHAMATI DIAGRAM OF UG CABLE LAYING ALONG SIDE KHORDHA NH-57 TOWARDS GURUJANGA PSS



Trupti Sundar Mohanty
 Trupti Sundar Mohanty
 HOG-Projects