



No. RO/BBSR/Utility Services/NH-326/SNBD/141/2026 -2506

Date: 22<sup>nd</sup> Jan, 2026

Invitation of Public Comments

**Sub: Proposal for laying of UG XLPE power cable through HDD method across NH-326 at km 200/100 near Tumbiguda junction for power supply to Rayagada Urban Area by TPSODL, Rayagada - reg.**

1. Superintending Engineer, NH Division, Sunabeda vide letter dated 07.01.2026 has submitted a proposal on the mentioned subject as detailed below:

Across the NH:

Sl. No.	NH Chainage	Available RoW (in mt)	Carriageway width (in mt)	Depth of laying of utility from GL	Methodology
1	200/100	25.0 m	7.0 m	3.00 m	HDD


2. As per Ministry's OM No. RW/NH-33044/29/2015/S&R(R) dated 22<sup>nd</sup> November, 2016 the Highway Administrator will put out the application in the public domain for 30 days for seeking claims and objections (on grounds of public inconvenience, safety and general public interest, if any).

3. In view of the above, comments of public for claims/objections, if any, on the above proposal are invited online as well as in hard copy. The strip plan/location details are enclosed herewith. The same should reach to the below mentioned address within 30 days from the date of uploading it in the website, beyond which no objection will be considered.

Address:

Regional Officer,  
 Ministry of Road Transport & Highways,  
 Plot No -184, Near Fire Station Sq.,  
 Baramunda, Bhubaneswar - 751003.

Yours faithfully,

  
 (Sudhansu Sekhar Sahu)  
 Senior Technical Assistant  
 For Regional Officer

To:

- 1) The Senior Technical Director, NIC, Transport Bhawan, New Delhi - 110001- along with strip chart for uploading on the Ministry's website.
- 2) General public with request to furnish comments, if any, to the above mentioned address or by e-mail to "[robbsr.morth@gmail.com](mailto:robbsr.morth@gmail.com)"

Copy to:

- 1) The Superintending Engineer, National Highway Division, Sunabeda.



Office of the Superintending Engineer  
National Highway Division, Sunabeda.  
e-mail- [eenhsunabeda@ymail.com](mailto:eenhsunabeda@ymail.com)  
Phone No. 06853-291784

No. 92 /Dated: 07/01/26

To

The Regional Officer,  
Ministry of Road Transport & Highways,  
Plot No. 184, In front of C.R.P.F. Stadium,  
Baramunda,  
At/Po: Bhubaneswar,  
Dist: Khurda.

Sub: Submission of documents for seeking permission for laying of underground XLPE Power cable (25 meter by HDD method) at Tumbiguda junction for reliable power cable supply in Rayagada Urban Area.


Sir,

In inviting a kind reference to the subject cited above, it is submit herewith the application alongwith drawing as received from Executive Engineer, RE Division, TPSODL, Rayagada for seeking permission for laying of underground XLPE Power cable (25 meter by HDD method) at Tumbiguda junction for reliable power cable supply in Rayagada Urban Area.

This is for favour of kind information and necessary action.

Yours faithfully,

Encl: As above.

  
Superintending Engineer,  
N.H. Division, Sunabeda.

Memo No. 93 /Dated: 07/01/26.

Copy submitted to the Executive Engineer, R.E. Division, TPSODL, Rayagada for information and necessary action with reference to his letter no.2594 dated. 19.12.2025.

  
Superintending Engineer,  
N.H. Division, Sunabeda.

Please encircle  
08/01/26

Fr. TA

# TPSODL

OFFICE OF THE EXECUTIVE ENGINEER, RAYAGADA ELECTRICAL DIVISION, RAYAGADA,  
SERIGUDA, RAYAGADA, E-MAIL: [ee\\_reo@tapsouthernorodisha.com](mailto:ee_reo@tapsouthernorodisha.com), Ph no- (06856)235100

Lr-No-2594

19-12-25

To  
The Superintendent Engineer  
NH Division, Sunabeda, Koraput

**Subject: Request for approval of laying underground XLPE power cable (25 mtr by HDD method) at Tumbiguda Junction for reliable power supply in Rayagada urban area**

Sir,

With reference to the above subject, I would like to bring to your kind notice that 11 kv underground (UG) cable laying is proposed to strengthen and improve the power supply system in Rayagada Municipality area. The new 11 kv UG line cannot be laid through overhead means due to site constraints; hence, underground laying is planned across Tumbiguda junction.

The following details are submitted for consideration during the UG cable crossing:

- **Location:** From Balaji Sweets to SBI SME Branch
- **Length of road to be crossed:** 25 meters
- **Chainage:** 200.100
- **Method of UG cable laying:** HDD (Horizontal Directional Drilling) method
- **Depth of cable laying:** 3 meters (10 feet)
- **GPS Coordinates:**
  - o Balaji Sweets – 19.187139, 83.415524
  - o SBI SME Branch – 19.187174, 83.415659
- **Safety Measures:** Cable will be laid through HDPE pipe. After completion, route markers will be installed indicating cable specifications and depth of laying.

Therefore, I kindly request you to accord approval for laying underground XLPE power cable (25 mtr by HDD method) in the interest of the general public of Rayagada to ensure a reliable and quality power supply in the urban area.

Thanking you sir.

Encl:-as above.

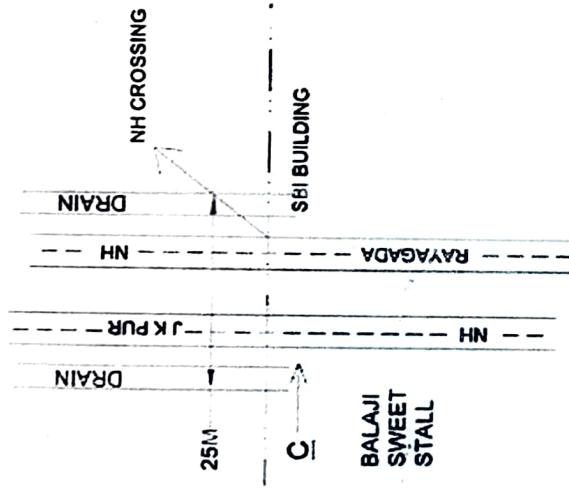
Yours faithfully,  
  
Executive Engineer, Elec.  
R.E.Division, Rayagada.

CCto:

1. Collector & District magistrate, Rayagada.
2. Chief-Technical services, TPSODL, Berhampur.
3. SE, EC, Rayagada.
4. HOG-Projects, Rayagada Circle
5. SDO, Electrical Sub division, Rayagada.
6. Section In Charge.ESO, Rayagada No-2

TP SOUTHERN ODISHA DISTRIBUTION LIMITED  
(A Tata Power and Odisha Government Joint Venture)  
Regd/Corp Office: Karnapalli, Couripeta, Berhampur, Ganjam, Odisha-750004, CIN: U40300OR2020SGC035195

Crossing at ch. 200.100 of NH-326



CLIENT NAME  
TATA POWER SOUTHERN  
DISTRIBUTION LIMITED (TPSOL)

CONTRACTOR M/s S K MOHAPATRA

PROJECT	DRAWING NAME	REV NO:	DRAWN BY	REV DATE	CHECKED BY	SCALE
11KV UG CABLE	SKM/TPSOL/GRC/RED/11KVUG CABLE 2003	00	AS			NTS



11KV UG CABLE  
TUMBIGUDA JUNCTION  
SKM/TPSOL/GRC/RED/11KVUG

11KV UG CABLE  
TUMBIGUDA JUNCTION  
SKM/TPSOL/GRC/RED/11KVUG

11KV UG CABLE  
TUMBIGUDA JUNCTION  
SKM/TPSOL/GRC/RED/11KVUG

Chennai Region Project  
Lead Engineer Project  
12-2001

Sub-Divisional Officer  
RAYAGADA ELECTRICAL SUB DIVISION  
TPSOL/RAYAGADA

LEGENDS		DESCRIPTION	QUANTITY
11MGS	Role		
	Cable Reel		
	11KV UG Cable Asper:	25 mtr	
	Length		
	Project Manager (Elect)		
	Sub-Divisional Officer		
	RAYAGADA ELECTRICAL SUB DIVISION		
	TPSOL/RAYAGADA		

11/11/26

Superintending Engineer  
N.H. Division, Sunabeda

11/11/26

11/11/26

11/11/26

11/11/26

11/11/26