

भारतीय राष्ट्रीय राजमार्ग प्राधिकरण

(सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार)

NATIONAL HIGHWAYS AUTHORITY OF INDIA

(Ministry of Road Transport and Highways, Govt. of India)

क्षेत्रीय कार्यालय \ REGIONAL OFFICE

ई-2/167, अरेरा कॉलोनी, हबीबगंज रेल्वे स्टेशन के पास, भोपाल (म.प्र.) 462 016

E-2/167, Arera Colony, Near Habibganj Railway Station, Bhopal (M.P.)-462 016

दूरभाष/Phone : 0755-2426638, फैक्स/Fax : 0755-2426698, ई-मेल/E-mail : robhopal@nhai.org



भारतमाला
प्रगति के पथ पर अग्रसर
BHARATMALA
ROAD TO PROSPERITY

NHAI/RO-MP/KTN/Jal Nigam/2020/38295

Date: 20.02.2020

Invitation of Public Comments

Sub: Regarding Permission for crossing 33KV cables across NH-30 between Ch. Km 279+737 and Ch. Km 279+683 from 132/33 KV Amarpatan substation to 33/6.6 KV sub-station at Markandey Ghat, Ramnagar pertaining to Satna -Bansagar MVRWSS.

Ref: PD, PIU-Katni letter no. NHAI/PIU-Katni/NH-7/Package-I/File-MP Jal Nigam/2019/4187 dated 28.01.2020

Vide above reference Proposal for Permission for crossing 33KV cables across NH-30 between Ch. Km 279+737 and Ch. Km 279+683 from 132/33 KV Amarpatan substation to 33/6.6 KV sub-station at Markandey Ghat, Ramnagar pertaining to Satna -Bansagar MVRWSS.

2. As per Ministry OM No. RW/NH-33044/29/2015/S&R (R) dated 22.11.2016, the Highways Administrator will make available the proposal seeking permission for utility laying for public comments for 30 days on ground of public interest.

3. In view of the above the comments of public are invited on captioned proposal (copy of application is enclosed) and the same should reach to below mentioned address till 21.02.2020 beyond which no comments will be considered.

The Highway Administrator
O/o Regional Officer,
National Highways Authority of India
E-2/167, Arera Colony,
Near Habibganj Railway Station,
Bhopal (MP)-462016
E-mail ID:robhopal@nhai.org

4. This issues with the approval of Highways Administrator-cum Regional Officer, NHAI-Bhopal



(Anand Prasad)
Manager (Tech.)


Copy to:

1. The Senior Technical Director, NIC, Transport Bhawan, New Delhi-110001 for uploading on Ministry's Website
2. The PD, PIU-Katni for information
3. The GM, MP Jal Nigam, PIU-Satna-for information.

DETAILS OF 33KV HT TRANSMISSION LINE FROM 132/33 KV SUBSTATION AT AMARPATAN TO 33/6.6 KV SUBSTATION AT MARKANDEY GHAT, NEAR SUKHWARI VILLAGE, RAMNAGAR (INTAKE WELL & WTP)

1	1.1	Name of the company asking for permission	Madhya Pradesh Jal Nigam Maryadit ,PIU-SATNA
	1.2	Full Address	House no 64, Lane no.1, Line no.3, Virat Nagar, Satna, M.P.(485001) H.Q.- MPJNM, 2 nd Floor, D Wing, Vindhyanchal Bhawan, Madhya Pradesh(462004)
	1.3	Telephone no. & Fax	9826463816(G.M.) 0755-2579034, 2579874
	1.4	Details and purpose of Erecting Poles	33 KV underground cable crossing for WTP, SATNA MVRWSS
2		Any other details regarding underground crossing of line	
	2.1	Situation of crossing	NH 30
	2.2	Distance of proposed structure from centre of the road	
	2.3	Span of the crossing	60m, Near Amarpatan 70m(Pole to Pole)
3		Detail regarding road alignment	
	3.1	Name of Road	Rewa-Katni-Jabalpur
	3.2	Category of road	NH 30


General Manager
MPJNM PIU SATNA



	3.3	Ground clearance		
4		Cable used to cross the National Highway with complete technical details of cable		Proposed 2 R, 3C x 240SQ MM, 33 KV XLPE cable
5		Certification		
	5.1	This is certified that no Government Road shall be occupied by		Confirm
	5.2	This is to certify that the work shall be done in accordance with Government Rules and Regulations		Confirm
	5.3	This is to certify that all required cost and fees as per Rules and Regulation' of the Government will deposited timely.		Confirm



Attachment-I

Enclosure to Ministry of Road Transport & Highways letter No.RW/NH-33044/
29/2015) 542(R) dated 22.11.16.



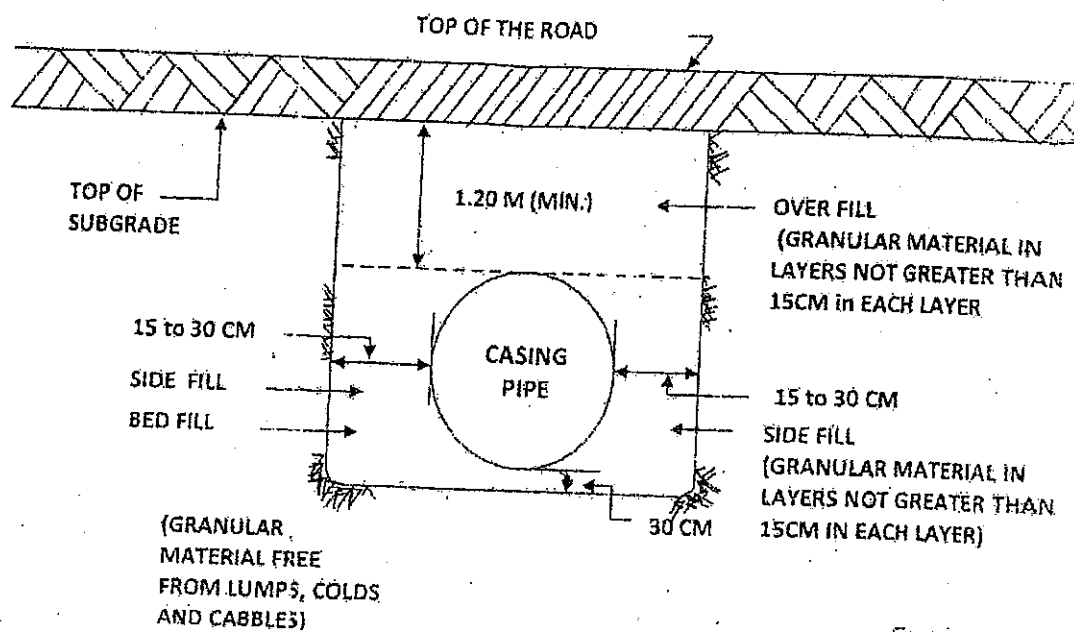


Figure not to scale

FIGURE-1 INSTALLATION OF CASING PIPE FOR
CROSSING THE ROAD

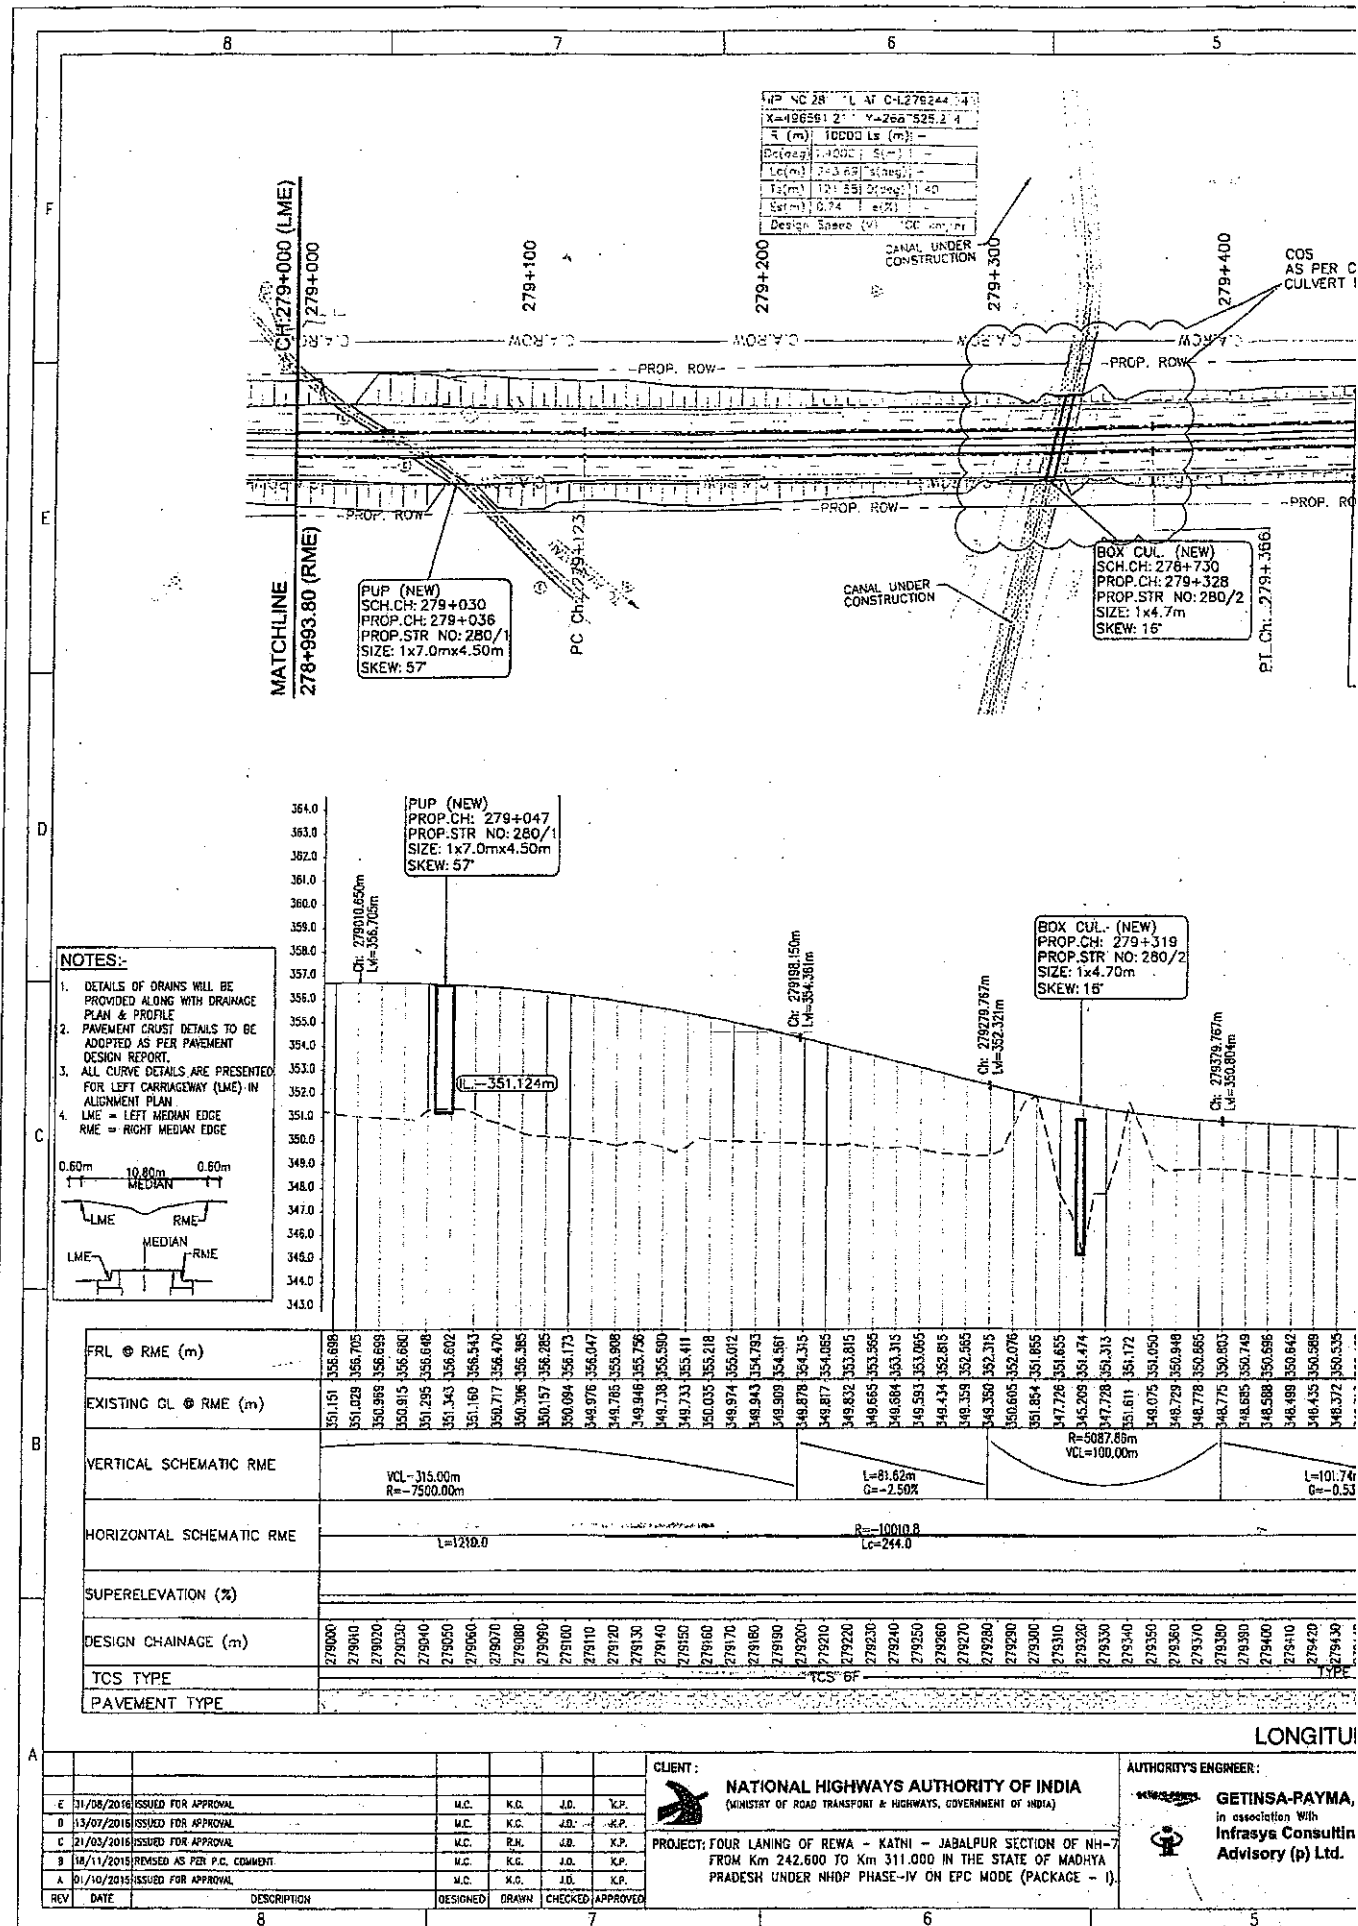

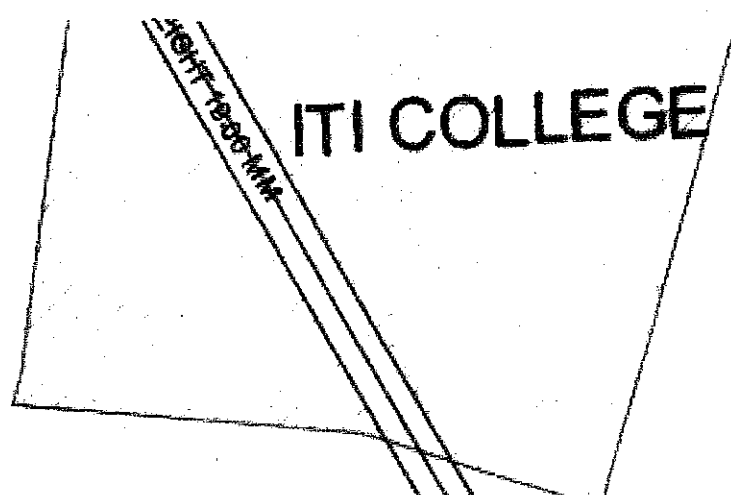

ITI COLLEGE

TO MAIHAR

NH30
CHAINAGE:
(279+737)

CC. ROAD

CC. ROAD


TO MAIHAR

X = 496012.936
Y = 2687765.667



General Manager
MPJNM PIU SATNA

LGC.NO.: P19/1
E- 496101.730
N- 2687748.951



33kV U/G CABLE NH-30 ROAD CROSSING DRAWING COMING UNDER AMARAPATAN S/S TO WTP ROUTE

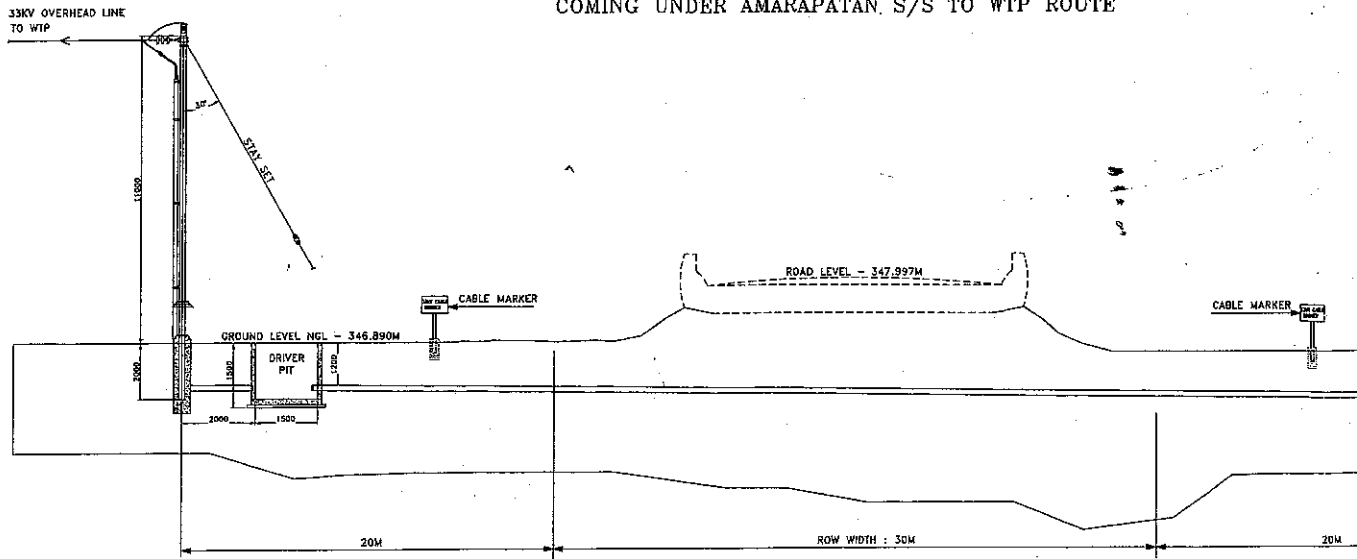

LONGITUDINAL SECTION

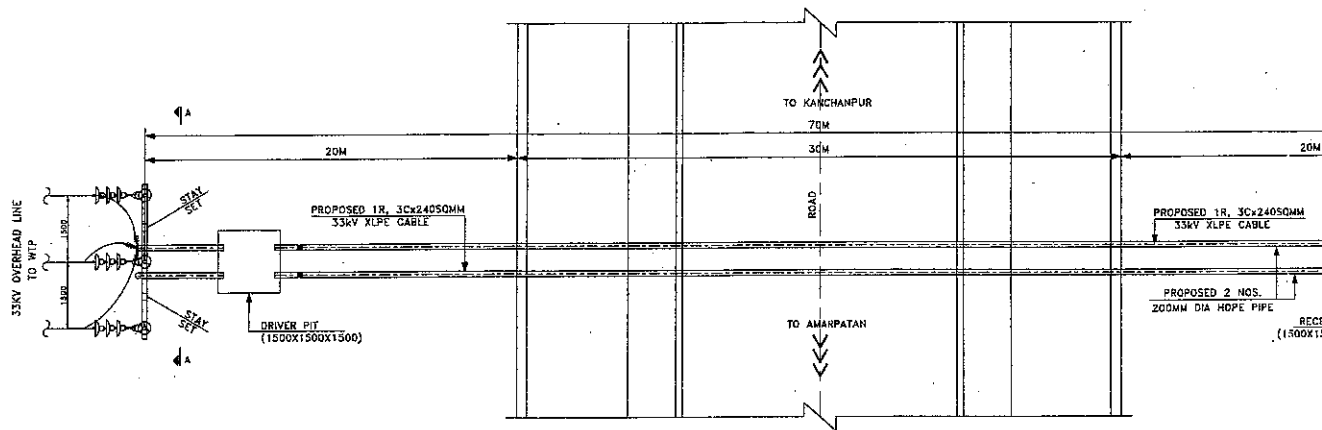

ROAD CROSSING - PLAN

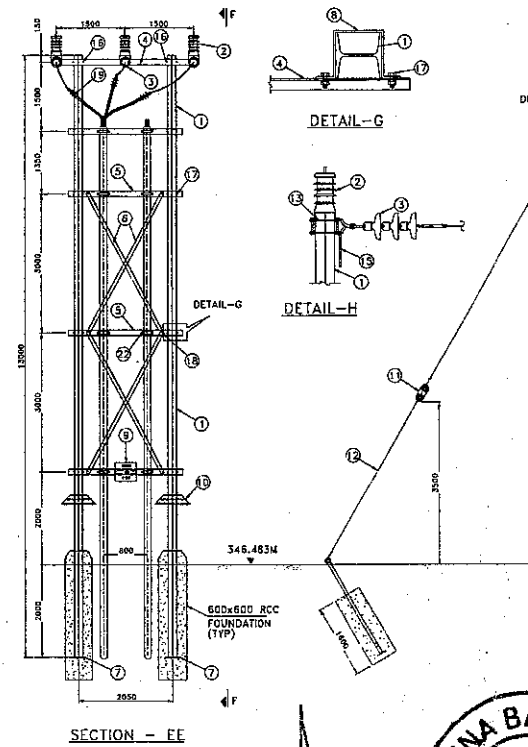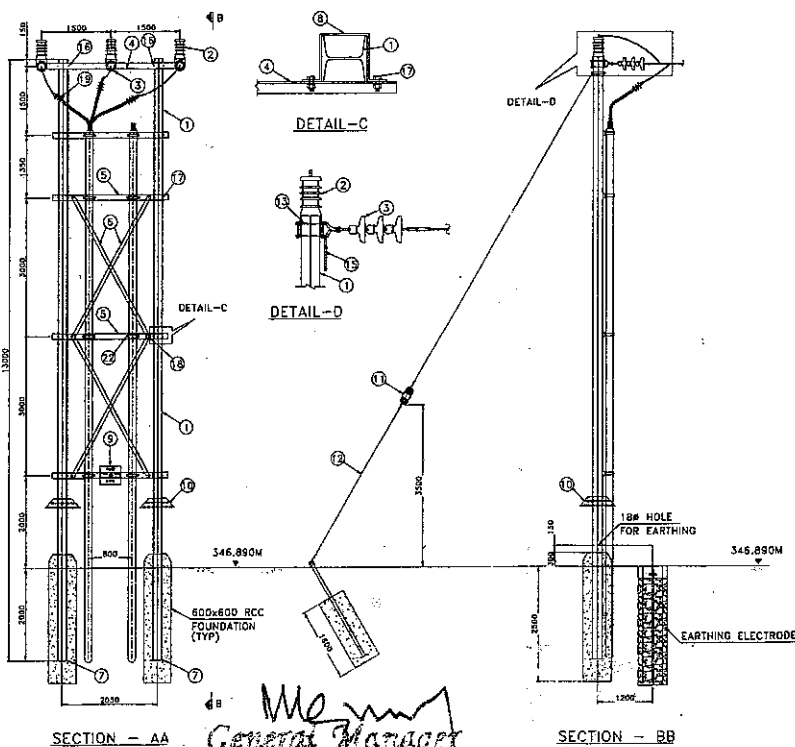

Mo
General Manager
MDPMM PU SATNA

