

| | | |
|--|---|--|
| <p>भारत सरकार सड़क परिवहन एवं राजमार्ग मन्त्रालय</p> |  | <p>Telephone: 0771 - 2436637, Telefax: 0771- 2436637</p> |
| <p>क्षेत्रीय कार्यालय एन.एच. कैम्पस, पेंशन बाड़ा रायपुर, छत्तीसगढ़ . 492 001</p> | | <p>Government of India Ministry of Road Transport & Highways Office of the Regional Officer, NH Campus, Pension Bada, Raipur, Chhattisgarh – 492 001</p> |
| <p>No. RO/CG/NH-06/RGH-PLR/Km.232-233/18-19/10/ 680</p> | | <p>Dated 27.11.2018</p> |

Invitation of public comments

Sub: Proposal for issue of NOC for Overhead Crossing of National Highway (NH-06) by +/- 800kV HVDC Raigarh-Pugalur Transmission Line (Part-2) between Km Mile stone 232-233.

The Project Director, NHAI, PIU, Dhamtari vide letter No. PD/DMT/Gen/EHT Line Permission/PP/1421 dated 31.10.2018 forwarded therewith a proposal in this office for accommodating/laying of Overhead crossing of 800 kV HVDC transmission line by Power Grid Corporation of India Ltd, Durg vide letter No. WRTS-I/Durg/TLC/RGH-PLR/NHXing NOC/6243/2623 dated 04.08.2018 i.e. the applicant on above mentioned subject.

2. As per Ministry OM vide No. RW/NH-33023/29/2015/S&R(R) dated 22.11.2016, the Highway Administration will make available the proposal seeking permission for utility services for public comments for 30 days on ground of public interest.

3. In view of the above, the comments of public are invited on captioned proposal and the same should reach to below mentioned address till 27.12.2018 beyond which no comments will be considered.

The Regional Officer,
Regional Office, M/oRT&H
NH Campus, Pension Bada,
Raipur, Chhattisgarh – 492 001
Email Id: eloraipur@rediffmail.com

4. This is issued with the approval of Highway Administration-cum Regional Officer, MoRT&H, Raipur.

M. Rizwan
(Md. Rizwan Siddiqui)
Assistant Engineer
For Regional Officer

Copy to:-

- Senior Technical Director, NIC, Transport Bhawan, New Delhi – 110001 for uploading on Ministry's website.
- The Project Director, National Highways Authority of India, House No.F-5, Shivraj Greens, Sihawa Road Dhamtari – 493773.
- The Chief Manger (TLC), Power Grid Corporation of India Limited, Near Square Water Tank, Padmanabhpur, Durg-491001.

M. Rizwan
(Md. Rizwan Siddiqui)
Assistant Engineer
For Regional Officer



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण

(सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार)

National Highways Authority of India

(Ministry of Road Transport and Highways, Govt. of India)
कार्यालय परियोजना निदेशक, परियोजना कार्यान्वयन ईकाई, धमतरी
(Office of Project Director, Project Implementation Unit, Dhamtari)
ब्लॉक एफ-5, शिवराज ग्रीन्स, सिहावा रोड, धमतरी-493773 (छ.ग.)
(Block F-5, Shivraj Greens, Sihawa Road, Dhamtari - 493773 (C.G.))

Email: piudhamtari@nhai.org

dhamtaripiu@gmail.com

Phone: 07722233433



BHARATMALA
ROAD TO PROSPERITY

PD/DMT/Gen/EHT Line Permission/PP/1421

Date 31.10.2018

To,
The Regional Officer,
Ministry of Road Transport & Highways
NH Campus, Pension Bada,
Raipur- 492001 (Chhattisgarh)

Sub: Proposal for issue of NOC for Overhead Crossing of National (NH-06) by +/- 800KV HVDC Raigarh-Pugalur Transmission line (Part-2) between Km. Milestone 232-233- Reg.

Ref:- 1. Your letter No. RO/CG/NH-06/RGH-PLR/Km.232-233/18-19/10/399/
dt.07.08.2018
2. Power Grid Corporation letter No.WRTS-I/Durg/TLC/RGH-PLR/NHXing
NOC /6243/2623 dt.04.08.2018


Sir,

Reference may please be made to your letter under reference wherein the proposal for accommodation of utility service (Transmission line) across the National Highway has been forwarded to this office for examination in light of Ministry's Guidelines dt.22.11.2016.

2. The proposal has been examined in compliance with the guidelines of Ministry vide Circular No. RW/NH-33023/29/2015/S&R(R) dt.22.11.2016

3. The following documents were submitted by the applicant:

- (viii) Duly filled in check list.
- (ix) Signed copies of Agreement regarding granting of ROW permission for laying utility services on National Highway, 03 Nos. of Undertaking, Affidavit-1 No.
- (x) A certified copy of Power Line Crossing details between AP 0 to AP 1 showing the route and crossing of 800 KV Power Line.
- (xi) Tower Spotting data and SLD.
- (xii) The agency has furnished an undertaking that, the agency will pay license fee, rent & security whenever required by NHA/MORTH.
- (xiii) The agency has furnished an undertaking that, they will confirm all standard conditions of NHA's guidelines while executing the work, while executing the work, all safety measures will be ensured and they will be solely responsible if thereby any accident or mis-happenings at site due to their acts.
- (xiv) The agency has furnished an undertaking that, (a) they shall strictly follow Ministry of Road Transport & Highways guidelines dated

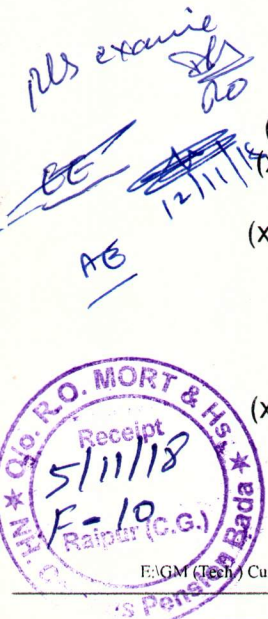

E:\GM (Tech) Cum PD\Dhamtari PIU\Access Permission\Access Permission.docx


[Handwritten signature]

मुख्यालय : जी-5 एवं 6, सेक्टर-10, द्वारका, नई दिल्ली-110075, दूरभाष : 011-25074100/200
HQ : G-5 & 6, Sector-10, Dwarka, New Delhi- 110075, Telephone No. 011-25074100/200

22/11/2016m (b) they shall ensure that there is not traffic disruption during the execution of work.

4. In view of above the above, the proposal forwarded originally along with all documents as per MoRT&H circular No.RW/NH-33044/29/2015/S&R (R) Dated 22.11.2016 for further necessary action.

Encl: As above

Yours Sincerely,

(S.Choudhury)
Project Director

Copy to: Chief Manager (TLC), Power Grid Corporation of India Limited, Near Square Water Tank, Padmanabhpur, Durg - 491001

पावर ग्रिड कारपोरेशन ऑफ इंडिया लिमिटेड

(भारत सरकार का उद्यम)

POWER GRID CORPORATION OF INDIA LIMITED

(A Government of India Enterprise)



पावरग्रिड

Durg TLC Office

Near Square Water Tank, Padmanabhpur, Durg - 491001

Telephone : 0788-2211135, 2320011

Ref: WRTS-I/Durg/TLC/RGH-PLR/NHXing NOC/6243/ 2623

Date- 04.08.2018

To,

The Regional Officer

Ministry of Road Transport and Highway Authority,
NH Campus Pension Bada,
Raipur, (C.G.)-492001

Sub: - Request for issue of NOC for Overhead Crossing of National Highway (NH-06) by +/-800kV HVDC RAIGARH-PUGALUR TRANSMISSION LINE (Part-2) between Km Mile stone 232-233.

Reference : Earlier proposal submitted to PIU, Dhamtari vide letter ref. no. WRTS-I/Durg/TLC/RGH-PLR/NHXing NOC/6243/
Date- 26.05.2017

Dear Sir,

With reference to the subject matter, it is to mention that +/-800kV HVDC RAIGARH-PUGALUR TRANSMISSION LINE is being constructed by Powergrid Corporation of India Limited under Transmission System associated with HVDC Bipole link between Western region (Raigarh, Chhattisgarh) and Southern region (Pugalur, Tamil Nadu).

Vide reference letter no. WRTS-I/Durg/TLC/RGH-PLR/NHXing NOC/6243/ Dated - 26.05.2017, earlier the subject proposal was submitted to PIU, Dhamtari on 30.05.2017. However, upon substantial delay it has been informed by PIU, Dhamtari that as per revised guidelines dated 22.11.2016, the proposal is to be submitted to Regional Officer, MoRT&H, NH Campus, Pensionbada, Raipur.

In view of above, the said proposal as per revised guidelines is once again submitted alongwith all the necessary documents furnished in 03 sets :-

| S. No | Name of NH | Mile stone of crossing & Nearest Village | Crossing Details of the Powerline | Vertical clearance of bottom conductor from the road at crossing span | Angle Of Crossing |
|-------|------------|---|---|---|-------------------|
| 1 | NH-06 | Mile Stone 232-233 Kms. near Paragaon village, Tahsil-Arang, Dist-Raipur. | Loc. No AP 0/0 (D+0) - 119 mtr AP 1/0 (B+0) - 101 mtr | 25.12 Mtrs | 79°30'16" |

It is to mention that both crossing towers are located outside NHAI Boundary and necessary clearance between top of road and bottom conductor of our line have been ensured, as per the applicable rules. The profile drawing of the crossing section bearing all details is enclosed herewith for your reference.

Accordingly, it is requested to kindly issue NOC for subject overhead crossing proposal. Since, our line is targeted for completion by Dec-2018 and is being monitored regularly by Ministry of Power under PRAGATI Portal; your kind cooperation will be highly appreciable.

Thanking you,

Encl:

- Prior approval of GOI, MoP letter.
- Crossing Plan & profile, Tower Schedule.
- Check list of crossing details.
- Affected area calculation and sketch.
- Tower spotting data & SLD.
- Undertaking I, II & III & Affidavit
- Agreement (Original).



Yours faithfully,

(S.K. Gautam)
Ch. Manager (TLC), Durg
Mob. No. 9423162321
POWERGRID, DURG


स्वहित एवं राष्ट्रहित में ऊर्जा बचाये / Save Energy for Self and Nation

पंजीकृत कार्यालय: बी. 9-कुतुब इंस्टीट्यूशनल एरिया, कटवरिया सराय, नई दिल्ली - 110016

Registered Office: B-9, Qutub Institutional Area, Katwaria Sarai, New Delhi - 110016,

दूरभाष /Tel : 91-11-26560112 / 26560121, फैक्स /Fax: 91-11-22571848/ 571760, तार - 'नेटग्रिड' Gram: 'NATGRID'

TW02 for ± 800 kV HVDC Raigarh– Pugalur Transmission Line
PLAN FOR NH. NO. (6) SIX LEN ROAD CROSSING RAIPUR - ARANG ROAD
NEAR VILLAGE PARAGAON, TAHSIL:- ARANG, DIST.-RAIPUR

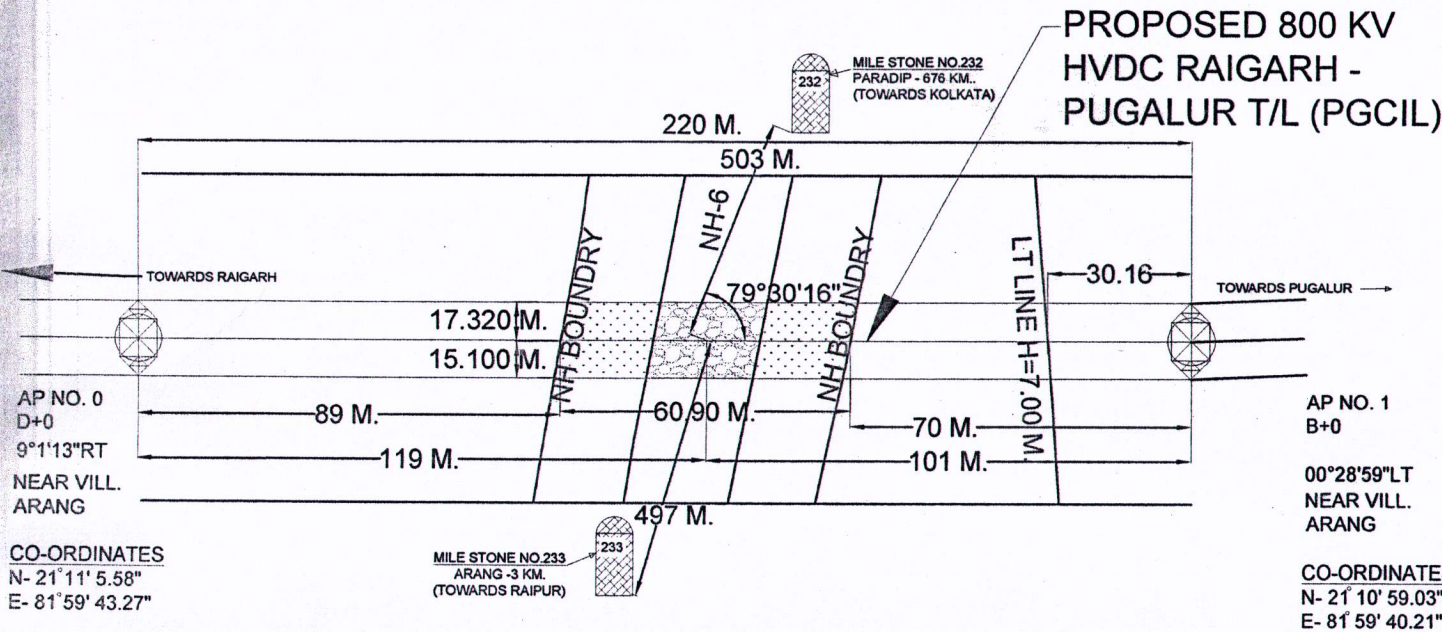

NOTE :-

1. CLEARANCE IN BETWEEN BOTTOM CONDUCTOR OF 800 KV HVDC RAIGARH - PUGALUR TRANSMISSION LINE & ROAD SURFACE = 25.12 M.
2. WIDTH OF OVER HEAD CONDUCTORS (17.32+15.10)=32.420 M.
3. WIDTH OF NH OUTER BOUNDARY(ROW)=60.90 M.
4. APPLICABLE AREA FOR LICENSE FEES=32.42x60.90=1974.378 Sq. MTR.

| | | | |
|--|--|---|---|
| CLIENT | POWER GRID CORPORATION OF INDIA LTD. | | |
| CONTRACTOR | KEC INTERNATIONAL LIMITED RAIPUR | | |
| WORKS ORDER :- | W. O. A772/773 | NOA NO. | CC-CS/651-WR1/TW-3570/3/G10/NOA-II/7269 DATED- 31.03.2017 |
| PROJECT :- | 800 KV HVDC RAIGARH - PUGALUR T/L (Part-II) CHATTISGARH FOR WIND ZONE - 3 (44 M/Sec) | | |
| TITLE:- | PLAN FOR NATIONAL HIGHWAY NO. 6 (SIX LEN ROAD) RAIPUR - ARANG NH ROAD CROSSING. | | |
| FOR KEC INTERNATIONAL LIMITED | FOR POWER GRID CORPORATION OF INDIA LTD. | | |
| Devesh Sr. Surveyor KIC | N. Jodidar Sr. Manager Projects KEC International Ltd. | PRL 31.07.2018 N.S. Grewal Manager (TLC) | G. K. Gautam Chief Manager (TLC) POWER GRID CORP. OF INDIA LTD. |
| SURVEYED & DRAWN BY | CHECKED BY | SUBMITTED BY | CHECKED BY |
| FOR NHAI | | | |
| CHECKED BY | RECOMMENDED BY | APPROVED BY | |
| SCALE | NOT TO SCALE | DATE: | SECTION :- AP 0 - AP 1 |
| DRAWING NO. : 800 KV HVDC/R-P/T/L/NH-6/PLAN-01 | | SHEET NO. : 2 OF 2 | REV |