

भारतीय राष्ट्रीय राजमार्ग प्राधिकरण

(सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार)

National Highways Authority of India

(Ministry of Road Transport and Highways, Government of India)

श्रेणीय कार्यालय : 41-29-45A, सर्वे नं: 373/2A, कोदंडरामालयम्, चलासानी नगर,

रानीगारीतोटा, कृष्णालंका, विजयावाडा - 520 013, आन्ध्र प्रदेश

Regional Office : D.No. 41-29-45A, RS.No. : 373/2A, Kodandaramalayam, Chalasani Nagar,

Ranigari Thota, Krishna Lanka, Vijayawada - 520 013, Andhra Pradesh.

फोन / Tel : 0866-2483910, ई-मेल/e-mail: rovijayawada@nhai.org, nhairovja@gmail.com

वेब/ web: www.nhai.gov.in



Ref: NHAI/RO-VJA/UTS/NCL Industries/33KV/2025-26/3157

29.07.2025

INVITATION OF PUBLIC COMMENTS

Sub: NHAI, RO - Vijayawada - Permission for Erection of 33KV Overhead Line over M+12 Towers (9 Nos.) & 12.5m Spun Poles (30 Nos.) from Tallapalem to Narasingibilli from Km.758.695 to Km.760.790 (LHS) and Crossing (HDD) at Km.760.790 along NH-16 (Total Length is 2133m) for extending of 33KV power supply to M/s. NCL Industries Limited located at Survey No.4586 of Gaitulapalem (V) Survey No.168, 172 & 173 of Tallapalem (GP) Kasimkota Mandal, Anakapalli District in the State of Andhra Pradesh - Public comments - Reg.

The Project Director, PIU - Rajamahendravaram submitted a proposal of M/s. NCL Industries Limited, Tallapalem for according Permission for Erection of 33KV Overhead Line over M+12 Towers (9 Nos.) & 12.5m Spun Poles (30 Nos.) from Tallapalem to Narasingibilli from Km.758.695 to Km.760.790 (LHS) and Crossing (HDD) at Km.760.790 along NH-16 (Total Length is 2133m) for extending of 33KV power supply to M/s. NCL Industries Limited located at Survey No.4586 of Gaitulapalem (V) Survey No.168, 172 & 173 of Tallapalem (GP) Kasimkota Mandal, Anakapalli District in the State of Andhra Pradesh.

As per MoRT&H guidelines vide letter No.RW/NH-33044/29/2015/S&R® dated 22nd November 2016, the Highway Administration will put out the application in the Ministry's website for 30 days seeking claims and objections (on grounds of public inconvenience, safety and general public interest).

In view of the above, the comments of public, if any, on the above-mentioned proposal is invited on below mentioned address.

Regional Officer - Vijayawada,
National Highways Authority of India,
Regional Office, Dr. No.41-29-45A, R. S. No.373/2A
Near Kodandaramalayam, Chalasani Nagar,
Ranigarithota, Krishnalanka, Vijayawada - 520 013.
Email: rovijayawada@nhai.org

(R.K. Singh, IES)
CGM (Tech.) & Regional Officer



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण
(सड़क परिवहन और राजमार्ग मंत्रालय, भारत सरकार)
National Highways Authority of India
(Ministry of Road Transport & Highways, Govt. of India)
परियोजना कार्यान्वयन इकाई - टोयोटा शोरूम के बाजू, राजमार्ग २१६ ए,
दिवानचेरुवु, राजमहेंद्रवaram - ५३३ १०२. आ.प्र.
PROJECT IMPLEMENTATION UNIT - Adjacent to Toyota Showroom,
NH-216A, Diwancheruvu, Rajamahendravaram - 533102, A.P.
द रा / Phone : 0883 - 2431170 ई ईल / e-mail: raj@nhai.org / piurajahmundry@gmail.com



No: NHAI/PIU-RJY/NCL Limited/33kv line/2025/24

Date: 05.04.2025

To
The Regional Officer,
National Highways Authority of India,
Krishnalanka,
Vijayawada - 520 013

Sir,

Sub: **NHAI, PIU, Rajamahendravaram** - Permission for Erection of 33KV Overhead Line over M+12 Towers (9 Nos.) & 12.5m Spun poles (30 Nos.) from Tallapalem to Narasingibilli from Km.758.695 to 760.790 (LHS) and crossing (HDD) at 760.790Km along NH-16 (Total Length is 2095m+38m=2133m) for extending of 33kvpower supply to M/s. NCL Industries Limited located at Sy.No.4586 of Gaitulapalem(V) Sy.no.168,172&173 of Tallapalem (GP) Kasimkota Mandal, Anakapalli district, Andhra Pradesh - **Provisional Permission - Approval - Reg.**

Ref: 1) M/s NCL Industries Limited letter no.: NCLIL/CEMVSP/NH-16 / 2024-25 dated 19-02-2025 (Received on 20-02-2025)
2) M/s. NCL Industries Limited letter no.: NCL/NH-16/EL/Tallapalem/01 dated: 03-04-2025 (Received on 04-04-2025).
3) This office e-mail dated: 04-04-2025.
4) Independent Engineer's letter no.: MSV-SIT/116/RJY-TOT/2025/NHAI/791, dated 28-03-2025.
5) Concessionaire, M/s. Ankapalli Tollways Pvt Ltd letter no. AATPL/NHAI/2023-24/1945 dated: 05-04-2025

1. It is to submit that M/s. NCL Industries Limited, Tallapalem vide reference 1st & 2nd cited submitted a proposal seeking permission for Erection of 33KV Overhead Line over M+12 Towers (9 Nos.) & 12.5m Spun poles (30 nos.) from Tallapalem to Narasingibilli from Km.758.695 to 760.790 (LHS) and crossing (HDD) at 760.790Km along NH-16 (Total Length is 2095m+38m=2133m) for extending of 33kvpower supply to M/s. NCL Industries Limited located at Sy.No.4586 of Gaitulapalem(V) Sy.no.168,172&173 of Tallapalem (GP) Kasimkota Mandal, Anakapalli district, Andhra Pradesh in accordance with the guidelines issued vide Revised MORT&H Circular/ Guidelines Dt. 22.11.2016 and also as per the Revised Check List issued by MORT&H, Vijayawada Dt. 13.04.2017.

20
05/04/2025

Building a Nation, Not Just Roads

का लि : 1-5 ब 6, सेक्टर-10, द्वारका, नई दिल्ली - 110 075, द रा : 91-1125074100 / 25074200 वेबसाइट: <http://www.nhai.gov.in>
ate Office : G-5 & 6, Sector-10, Dwarka, NEW DELHI - 110 075, Phone : 91-1125074100 / 25074200 Website: <http://www.nhai.gov.in>

2. As per the Revised Circular Guidelines, the Agency submitted an undertaking duly stating that they will submit Performance Bank Guarantee as demanded by NHAI. The applicant has furnished that they will relocate utilities at their own cost for further six laning.

3. The above proposal has been forwarded to the IE, M/s. MSV International INC, in Association with Sri Infotech, for verification at site and feasibility report to Concessionaire M/s. Ankapalli Tollways Pvt. Ltd. for consent vide reference 3rd cited.

4. IE, M/s. MSV International INC, in Association with Sri Infotech, vide reference 4th cited recommended the proposals stating that permission may be granted to the applicant for erection of 33 KV overhead line over M-12 towers & 12.5m spun poles at the above location. A copy of the report submitted by the IE is enclosed for ready reference.

5. The Concessionaire, M/s. Ankapalli Tollways Pvt Ltd., have submitted their consent for erection of 33KV Overhead Line subject to the provisions of clause 11.3.1 of Contract Agreement.

6. The applicant has submitted the Methodology for erection of 33 KV Overhead Line Over M+12 Towers (9 Nos.) & 12.5 m Spun Poles (30 Nos.) along the National Highway-16 at the edge of RoW / Utility corridor from Km. 758.695 To Km.760.790 (LHS), Crossing (HDD) at Km.760.790 on NH-16 and one Pole at RHS (Total Length is 2095m+38m=2133m) for extending of 33 KV Power Supply to M/S NCL Industries Limited.

7. The proposal has been verified by the Undersigned as per the MORT&H revised Circular/ Guidelines Dt. 22.11.2016 and also as per the Revised Check List issued by the MORT&H Dt. 13.04.2017 and found in order. The Certificate in the prescribed format as per the MORTH Guidelines Dt. 22.11.2016 is enclosed herewith.

8. The License Fee for a period of 5 years (60 months) is worked out as Rs. 56,371/- as per MORT&H circular dated 17.04.2023 and also submitted Bank Guarantee Rs. 100/- per running meter of an amount 2,13,300/-. The Specification Report along with Calculation Sheet is enclosed herewith.

9. The proposal submitted by the Agency is herewith submitted along with the following:

- | | |
|------------------------------------|------------------|
| (1) Proposal along with enclosures | (2) Check List |
| (3) License Deed. | (4) Undertakings |
| (5) Methodology | (6) Diagrams |

10. With the above, the proposal submitted by M/s. NCL Industries Limited, Tallapalem for seeking permission for Erection of 33KV Overhead Line over M+12 Towers (9 Nos.) & 12.5m Spun poles (30 Nos.) from Tallapalem to Narasingibilli from

80
5/4/25

Km.758.695 to 760.790 (LHS) and crossing (HDD) at 760.790Km along NH-16 (Total Length is $2095\text{m}+38\text{m}=2133\text{m}$) for extending of 33kvpower supply to M/s. NCL Industries Limited of Tallapalem (GP) Kasimkota Mandal, Anakapalli district, Andhra Pradesh, at license fee of Rs. 56,371/- for 5 years and performance bank guarantee of Rs. 2,13,300/-

Encl: As above

Yours faithfully

Handwritten signature in blue ink, appearing to read 'D. Surendra Nath', with a date '05/09/2018' written below it.

(D. Surendra Nath)
Project Director

Ref: NCL/NH-16/EL/Tallapalem/01

Date:03/04/2025

To
The Project Director,
National Highways Authority of India,
PIU-Rajahmundry,
Sy.No. 560/3, Adjacent to Toyota Show room,
NH-216A, Diwancheruvu,
RAJAHMUNDY-533102..

Ref: 1) NHAI Your Office E mail dated.01.04.2024
2) MSV_SIT/116/RJY-TOT/2025/NHAI/791 Dated.28.03.2025

Dear Sir,

Sub:- Revised Proposal submitted - Permission for Erection of 33 KV Overhead Line Over M+12 Towers & 12.5 m Spun Poles along the National Highway – 16 (Kolkata to Chennai Section) at the edge of ROW/Utility Corridor from Tallapalem to Narasingibilli i.e. from Km. 758.695 To Km.760.790 (LHS), Crossing (HDD) at Km.760.790 on NH-16 and one Pole at RHS (Total Length is 2095m+38m=2133m) for Extending of 33 KV Power Supply to M/S NCL Industries Limited located at Sy.No.4,5&6 of Gaitulapalem (V), Sy No. 168, 172 & 173 of Tallapalem (GP), Kasimkota Mandal, Anakapalli District, Andhra Pradesh. -Laying Permission Regarding.

With reference to the above, We are submitted revised proposal for Erection of 33 KV Overhead Line Over M+12 Towers & 12.5 m Spun Poles along the National Highway – 16 (Kolkata to Chennai Section) at the edge of ROW/Utility Corridor from Tallapalem to Narasingibilli i.e. from Km. 758.695 To Km.760.790 (LHS), Crossing (HDD) at Km.760.790 on NH-16 and one Pole at RHS (Total Length is 2095m+38m=2133m).

"APEPDCL" for Extending of 33 KV Power Supply from 132/33 KV Narsingibilli Substation to M/S NCL Industries Limited located at Sy.No.4,5&6 of Gaitulapalem (V), Sy No. 168, 172 & 173 of Tallapalem (GP), Kasimkota Mandal, Anakapalli District, Andhra Pradesh.

We request you to kindly grant "**No Objection Certificate**" for Laying of Electrical overhead lines and return us one copy of drawing duly sealed and signed as a token of your permission.

Thanking you,

Yours truly,

For M/s. NCL Industries Limited.

MARUPUDI KIRAN



INWARD		
No:	138	
Date:	04/04/25	
Time:	3:29	
M(T)	PS	
SE-I	ACCT.	
SE-II	LAO	

Survey No. 168, 172 & 173, Tallapalem (V) Kasimkota Mandal, Visakhapatnam-531031 Andhra Pradesh


Regd. & Corporate Office: 7th Floor, NCL Pearl, Near Rail Nilayam, S.D. Road, Secunderabad-500 026 Telangana India.

(Senior General Manager) Phone: 91-40-2980 7868/69 Fax: 91-40-2980 7871 E-mail: ncl@nclind.com | Website : www.nclind.com

Enclosure: As above



PERMISSION FOR ERECTION OF 33 KV OVERHEAD LINE OVER M+12 TOWERS
& 12.5 M SPUN POLES ALONG THE NATIONAL HIGHWAY - 16
(KOLKATA TO CHENNAI SECTION) AT THE EDGE OF ROW/UTILITY CORRIDOR
FROM TALLAPALEM TO NARASINGIBILLI I.E. FROM KM. 758.695 TO KM.760.790 (LHS),
CROSSING (HDD) AT KM.760.790 ON NH-16 AND ONE POLE AT RHS (TOTAL LENGTH
IS 2095M+38M=2133M) FOR EXTENDING OF 33 KV POWER SUPPLY TO
M/S NCL INDUSTRIES LIMITED LOCATED AT SY.NO.4,5&6 OF GAITULAPALEM (V),
SY NO. 168, 172 & 173 OF TALLAPALEM (GP), KASIMKOTA MANDAL, ANAKAPALLI DISTRICT, ANDHRA PRADESH.

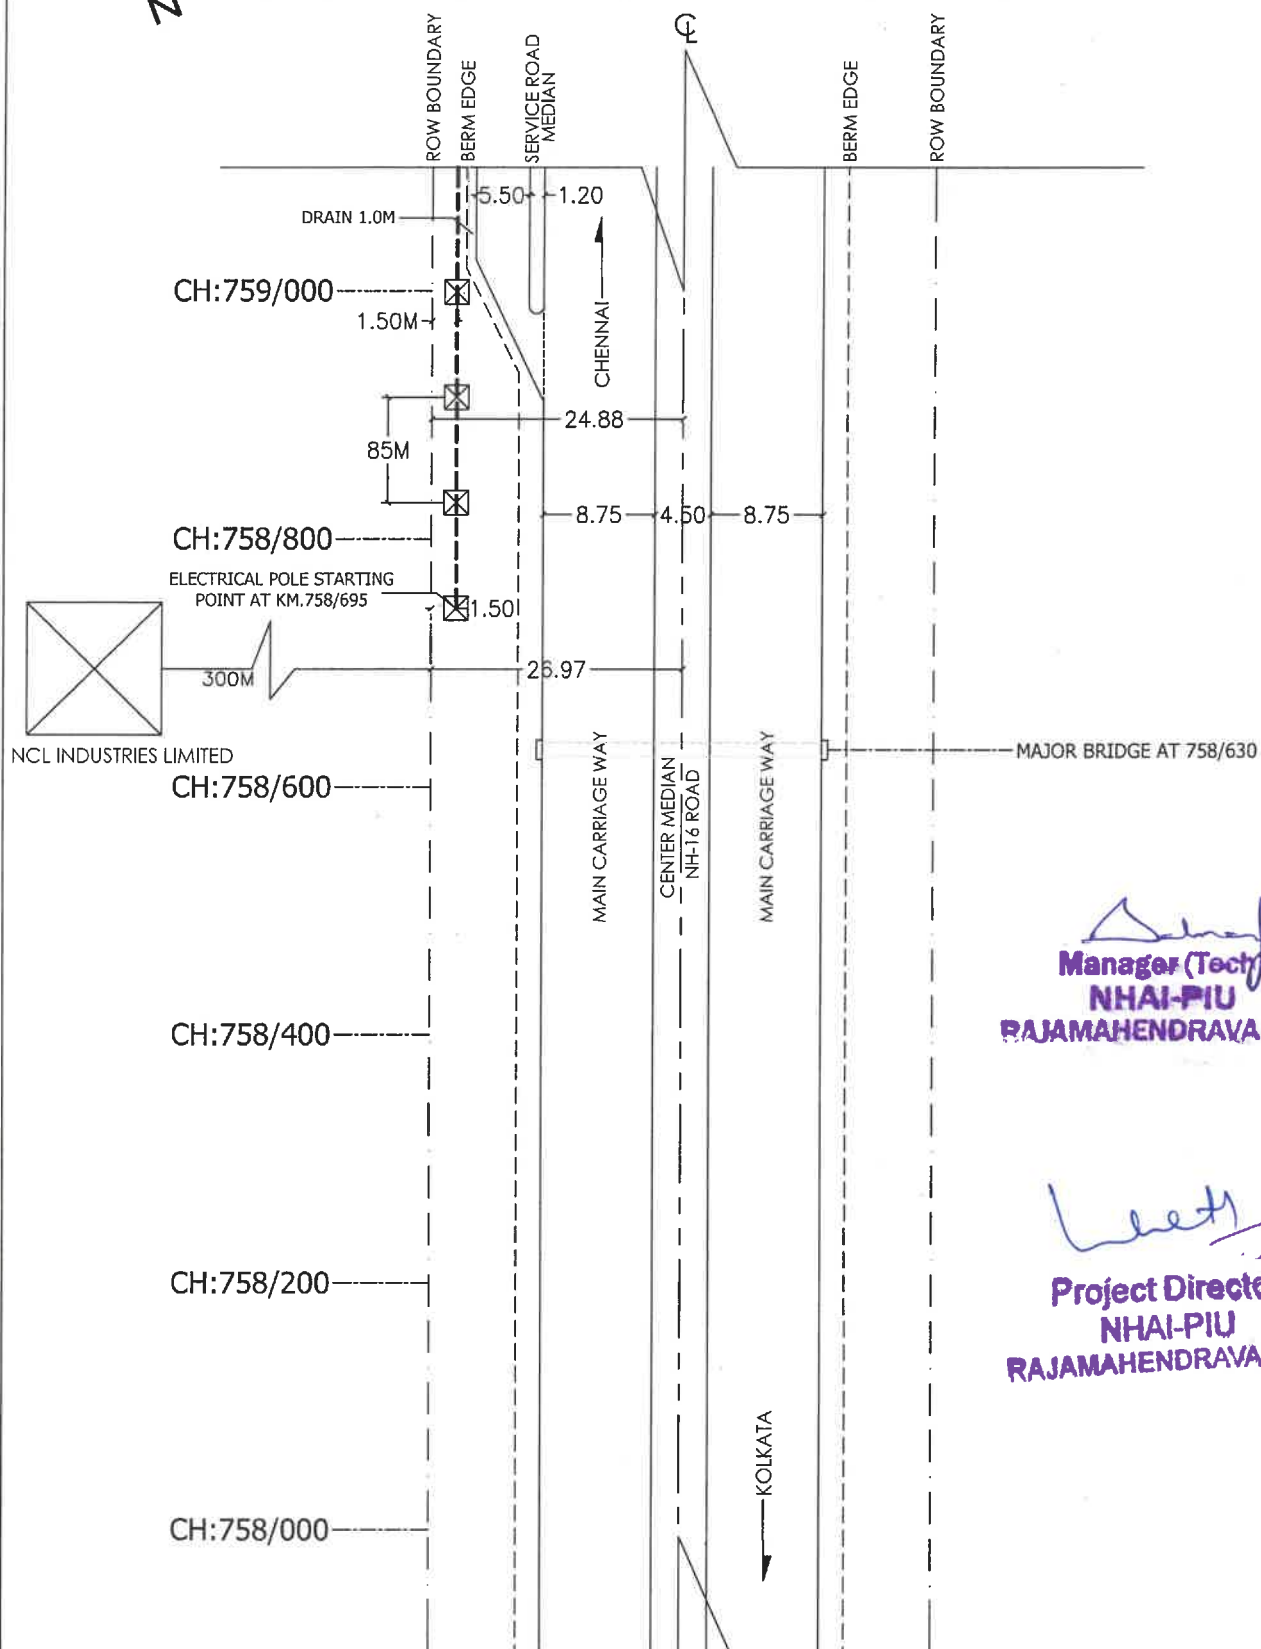

[Signature]
Manager (Tech)
NHAI-PIU
RAJAMAHENDRAVARAM

[Signature]
Project Director
NHAI-PIU
RAJAMAHENDRAVARAM

LEGEND:

RIGHT OF WAY(ROW): - - - - -
MAIN CARRIAGE WAY: = = = = =
ROAD CENTER LINE: ————
PRO. ELECTRICAL LINE: - - - - -
PRO. M+12 TOWER: ☒
PRO. 12.5M DIA POLE: ○

SCALE:


ALONG-1:2500

ACROSS-NTS

ALL DIMENSIONS ARE IN METERS



PERMISSION FOR ERECTION OF 33 KV OVERHEAD LINE OVER M+12 TOWERS
& 12.5 M SPUN POLES ALONG THE NATIONAL HIGHWAY - 16
(KOLKATA TO CHENNAI SECTION) AT THE EDGE OF ROW/UTILITY CORRIDOR
FROM TALLAPALEM TO NARASINGIBILLI I.E. FROM KM. 758.695 TO KM.760.790 (LHS),
CROSSING (HDD) AT KM.760.790 ON NH-16 AND ONE POLE AT RHS (TOTAL LENGTH
IS 2095M+38M=2133M) FOR EXTENDING OF 33 KV POWER SUPPLY TO
M/S NCL INDUSTRIES LIMITED LOCATED AT SY.NO 4,5&6 OF GAITULAPALEM (V),
SY NO. 168, 172 & 173 OF TALLAPALEM (GP), KASIMKOTA MANDAL, ANAKAPALLI DISTRICT, ANDHRA PRADESH.

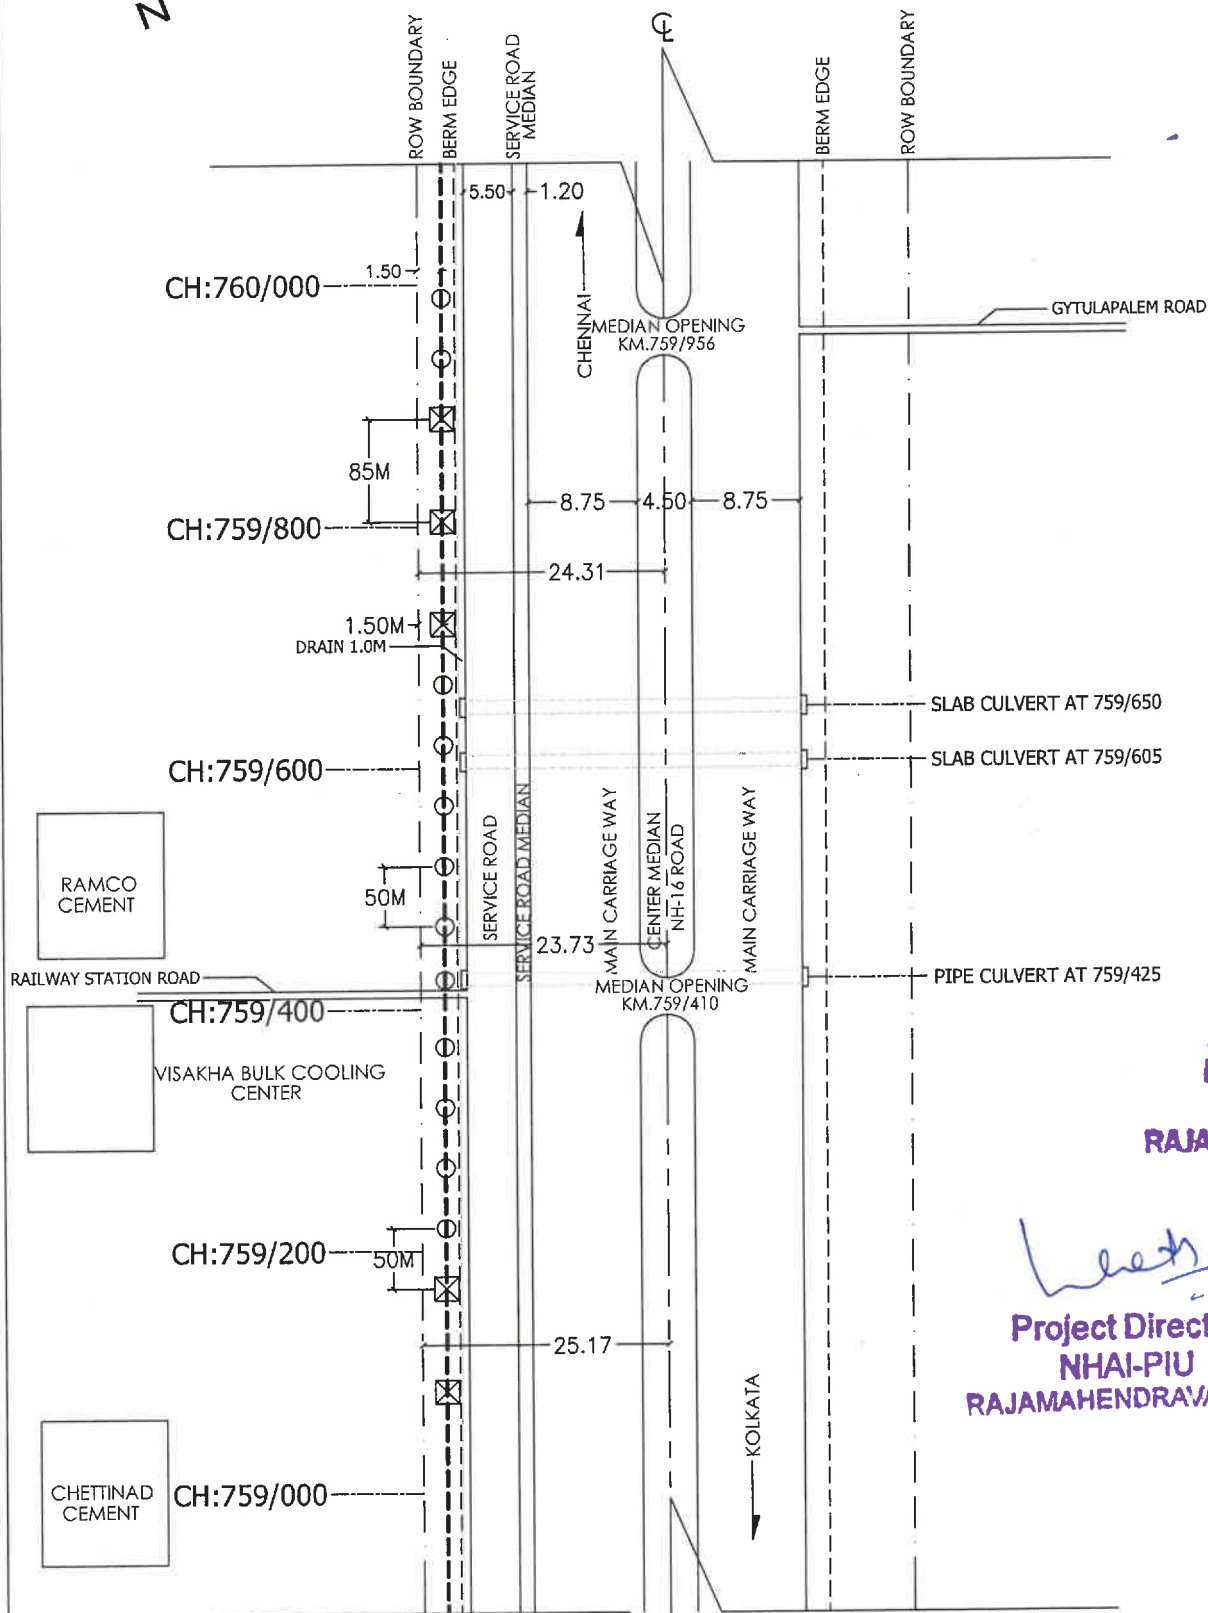

Selvaraj
Manager (Tech)
NHAI-PIU
RAJAMAHENDRAVARAM

Leeth
Project Director
NHAI-PIU
RAJAMAHENDRAVARAM

LEGEND:

RIGHT OF WAY(ROW): - - - - -
MAIN CARRIAGE WAY: = = = = =
ROAD CENTER LINE: ————
PRO. ELECTRICAL LINE: - - - - -
PRO. M+12 TOWER: ☒
PRO. 12.5M DIA POLE: ○

SCALE:

ALONG-1:2500

ACROSS-NTS

ALL DIMENSIONS ARE IN METERS




PERMISSION FOR ERECTION OF 33 KV OVERHEAD LINE OVER M+12 TOWERS
& 12.5 M SPUN POLES ALONG THE NATIONAL HIGHWAY - 16

SHEET No.3



(KOLKATA TO CHENNAI SECTION) AT THE EDGE OF ROW/UTILITY CORRIDOR
FROM TALLAPALEM TO NARASINGIBILLI I.E. FROM KM. 758.695 TO KM.760.790 (LHS),
CROSSING (HDD) AT KM.760.790 ON NH-16 AND ONE POLE AT RHS (TOTAL LENGTH
IS 2095M+38M=2133M) FOR EXTENDING OF 33 KV POWER SUPPLY TO

M/S NCL INDUSTRIES LIMITED LOCATED AT SY.NO.4,5&6 OF GAITULAPALEM (V),
SY NO. 168, 172 & 173 OF TALLAPALEM (GP), KASIMKOTA MANDAL, ANAKAPALLI DISTRICT, ANDHRA PRADESH.

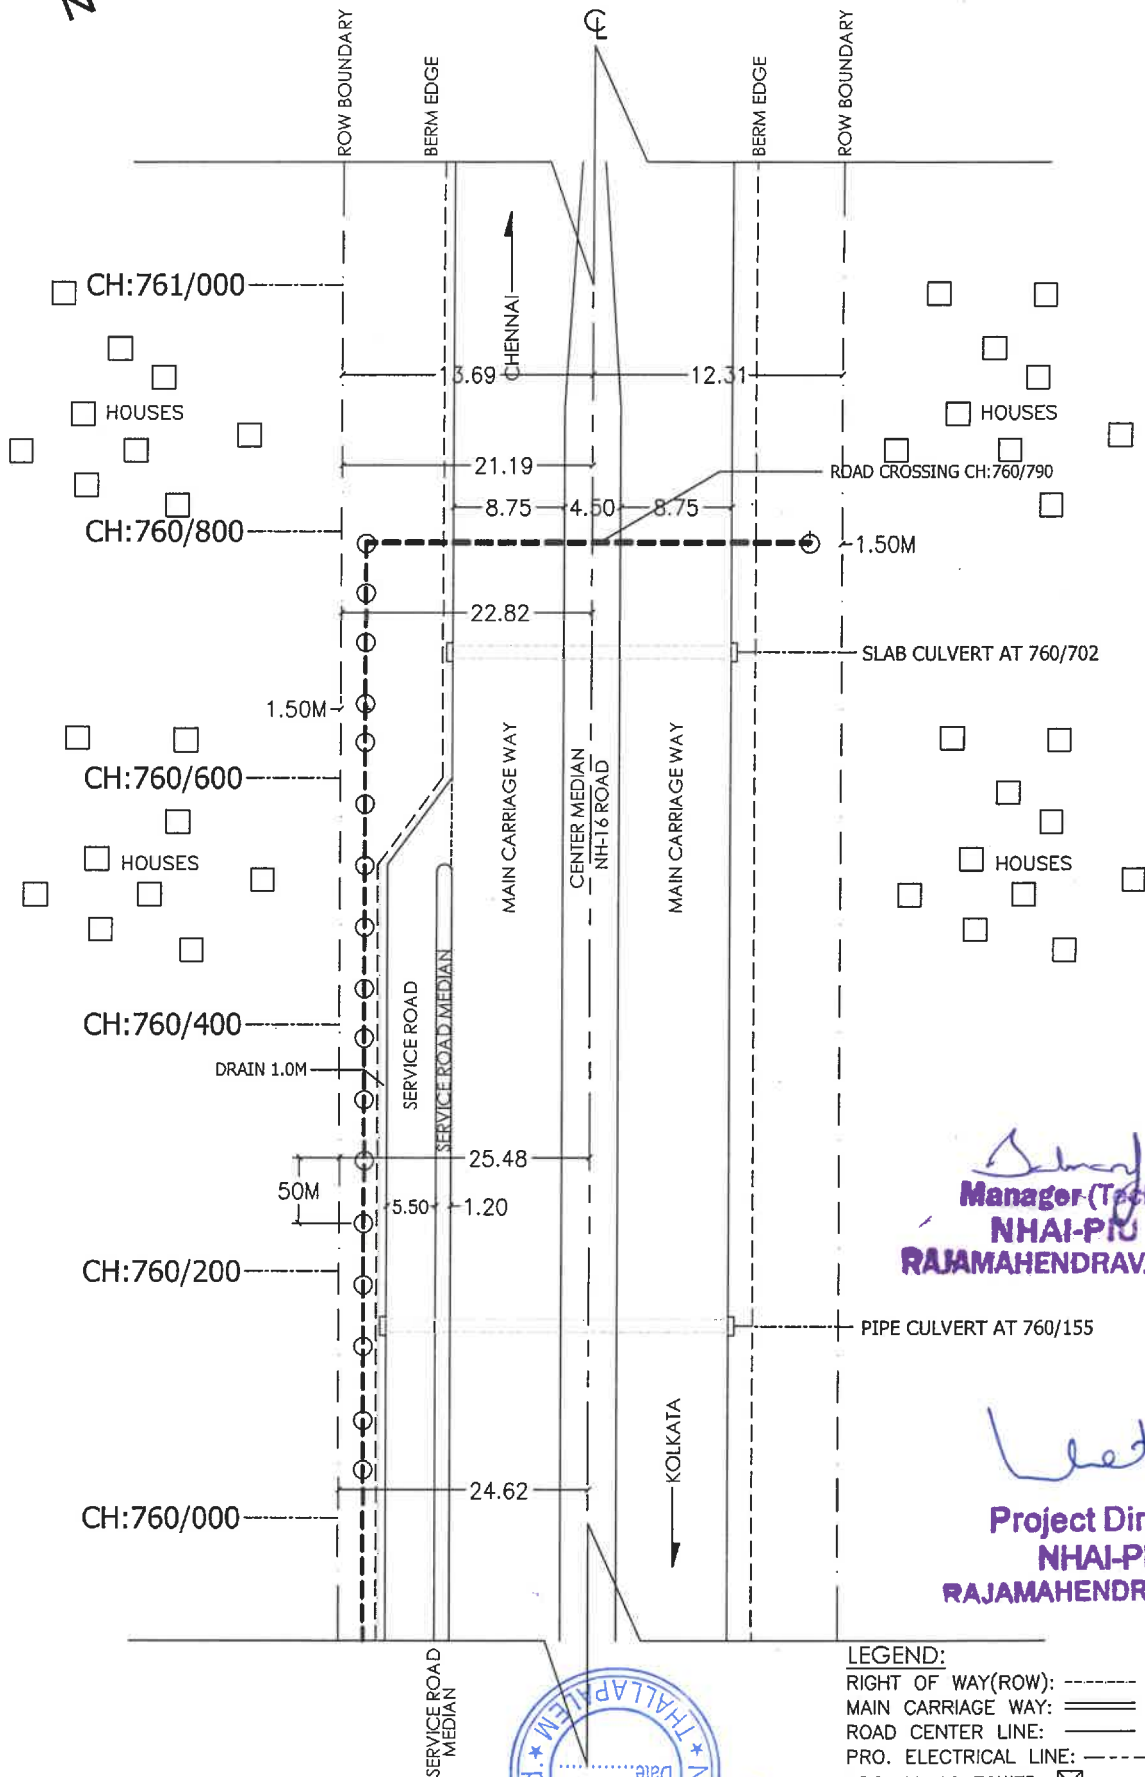

[Signature]
Manager (Tech)
NHAI-PIU
RAJAMAHENDRAVARAM

[Signature]
Project Director
NHAI-PIU
RAJAMAHENDRAVARAM

LEGEND:

- RIGHT OF WAY(ROW): - - - - -
- MAIN CARRIAGE WAY: = = = = =
- ROAD CENTER LINE: ————
- PRO. ELECTRICAL LINE: - - - - -
- PRO. M+12 TOWER: ☒
- PRO. 12.5M DIA POLE: ○

SCALE:

ALONG-1:2500

ACROSS-NTS

ALL DIMENSIONS ARE IN METERS

