



Government of India
Ministry of Road Transport & Highways
Office of the Chief Engineer - Regional Officer (Civil)
No. 32, 2nd Floor, KSCFL Building, Race Course Road, BENGALURU-560 001
Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No.RW/BNG/PER.CASES/ SMG DVN/2021

Dated: 14.10.2025

Notice inviting Public Comments for obtaining permission for laying of electrical 11KV HT UG Cable supply from MUSS (Alkola) to Kotegangur Coaching Depot along NH-69 (NH-206) Km 156.100 to 158.110 in Shimoga city Limit, Honnavar-Chittor section in the state of- Karnataka Regarding NH Along & crossing road permission by South Western Railways using HDD method- Reg.

Reference: The EE, NH, Shimoga Letter No. EE/NHD/AMG/AE-1/NH-69/UG cable/NOC/2025-26/984 dated 16.09.2025.

The Executive Engineer, NH Division, Shimoga vide letter cited under reference above, has submitted proposal seeking Permission laying of electrical 11KV HT UG Cable supply from MUSS (Alkola) to Kotegangur Coaching Depot along NH-69 (NH-206) Km 156.100 to 158.110 in Shimoga city Limit, Honnavar-Chittor section in the state of- Karnataka Regarding NH Along & crossing road permission by South Western Railways using HDD method.


2. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and dated 17.04.2023 is generally found in order.

4. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

The Chief Engineer- Regional Officer (Civil)
Ministry of Road Transport & Highways
No.32, 2nd Floor, Race Course Road, Bangalore-560 001
Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765

Encl:As above


(Sandesh.K)

Asst. Engineer(C)
for RO-MoRTH Bengaluru

Copy to: (i) The Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001
for uploading on Ministry's website.
(ii) The Executive Engineer, National Highway Division Shivamogga, for
information.


(Sandesh.K)
Asst. Engineer(C)
for RO-MoRTH Bengaluru

FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject: Proposed laying of electrical 11KV HT UG Cable supply from MUSS (Alkola) to Kotegangur Coaching Depot along NH-69 (NH-206) Km 156.100 to 158.110 in Shimoga city Limit, Honnavar-Chittor section in the state of- Karnataka Regarding NH Along & crossing road permission by South Western Railways using HDD method- Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	a) Application No.	
	b) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	c) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

Handwritten signature



GOVERNMENT OF KARNATAKA
PUBLIC WORKS DEPARTMENT, NATIONAL HIGHWAYS

Office of the Executive Engineer, National Highway Division, 1st floor, Lokopayogi
Bhavan, Balaraja uras road, Shimoga,

Email : eenhdsmsg@gmail.com

No: EE/NHD/SMG/AE1/NH-69/UGCable/NOC/2025-26

984

Date: 16/09/2025

To,

The Regional Officer,
Ministry of Road Transport & Highways,
No.32, 2nd Floor, KSCFL Building,
Race Course Road,
Bengaluru - 560 001

O/o. THE CE-RO
MORT&H, BENGALURU

Diary No.: 1867

Date: 22-09-2025

22/9/25

on file
Plz noc

Sir,

Sub:- Resubmitting and Compliance of proposal for laying of electrical 11KV HT UG cable supply from MUSS to Kotegangur coaching depot NH-69 (NH 206) Km 156.100 to 158.110 in Shivamogga City limit, Honnavara-Chittoor section in the state of Karnataka, Regarding NH along & crossing road permission using HDD method-Reg.

Ref :- 1) Chief Engineer, RO MoRTH letter No:- RW/BNG/GENL/PERCASES/SMG DVN/2020/2251 Dated:-05.03.2025.

2) Assistant Executive Engineer, National Highway sub Division, Shivamogga letter No: AEE/NHSD/Smg/NH-69/ Electrical/Permission/2025-26/236 Date: 15-09-2025

With reference to the above subject, the proposal was submitted for obtaining permission to lay an 11 kV HT underground electrical cable to supply power from MUSS to Kotegangur Coaching Depot along NH-69 (Old NH-206) at Km 156.110, within the Shivamogga city limits, Honnavara-Chittoor Section, Karnataka.

For the above proposal is examined and the following observations are made by the Chief Engineer, RO MoRTH vide letter ref (1) and the proposal was returned. Accordingly the Assistant Executive Engineer, National Highway sub Division, Shivamogga have submitted the compliance to the Observations and submitted to this office vide letter ref (2) as below along with all checklists, certificates, and drawings duly signed and enclosed.


Si. No	Observations	Compliance
1	The Proposal needs to be examined /recommended in light of any improvement work sanctioned /proposed in the above said stretch.	The chainage mentioned in the proposal have inspected found that there is no work sanction for improvement .
2	The Executive Engineer Shivamogga is requested to verify the details of available ROW to lay the proposed 11Kv HT UG cable. Further it is also requested to verify all the details mentioned in the checklist and all pages of the check list needs to be signed by the Executive Engineer, NH Division Shivamogga.	The Executive Engineer, Shivamogga inspected the site & observe the proposal for laying the 11kV HT underground cable along NH-69 (Old NH-206), from chainage 156.100 km to 158.110 km, has sufficient Right of Way (ROW) of 30.00 meters.
3	All the undertakings mentioned in the checklist as per the Ministry norms needs to be submitted in original copies duly signed by the competent Authority.	Copy enclosed.
4	Linear and cross sectional drawing showing carriageway width, shoulders, drainage, existing utility pipelines /cables, for every 1 km length duly certified by the EE, NH Division, Shivamogga needs to be submitted.	Copy enclosed.

Si. No	Observations	Compliance
5	The License Agreement in original (two sets) and 1 copy as per the Ministry's guidelines dated 22.11.2016 needs to be submitted with seal of authorized signatory in all pages and witness signature. The Agreement is to be made between "The Regional Officer, MoRT&H Bangalore" (Authority) and the license, leaving date/month/year blank without any topographical errors along with witness signature.	Copy enclosed.
6	The details of various safety clearances from the respective authorities such as Directorate of Electricity and any other statutory clearances as applicable which must be obtained before applying to the Highway administration and same needs to be enclosed along with the Proposal.	MESCOM Copy enclosed.

Hence the proposal is resubmitted alongwith necessary corrections made as per the direction of RO, MoRTH letter vide ref (1) along with the compliance report and requested to issue necessary permission for laying of electrical 11KV HT UG cable supply from MUSS to Kotegangur coaching depot NH-69 (NH 206) Km 156.100 to 158.110 in Shivamogga City limit, Honnavara-Chittoor section in the state of Karnataka.


Encl: Corrected Proposal in Triplicate.

Yours faithfully,

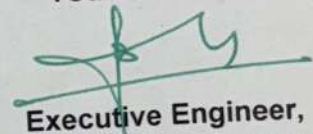

Executive Engineer,
National Highways Division
Shimoga

21,
76,7
6,1
23
23
23

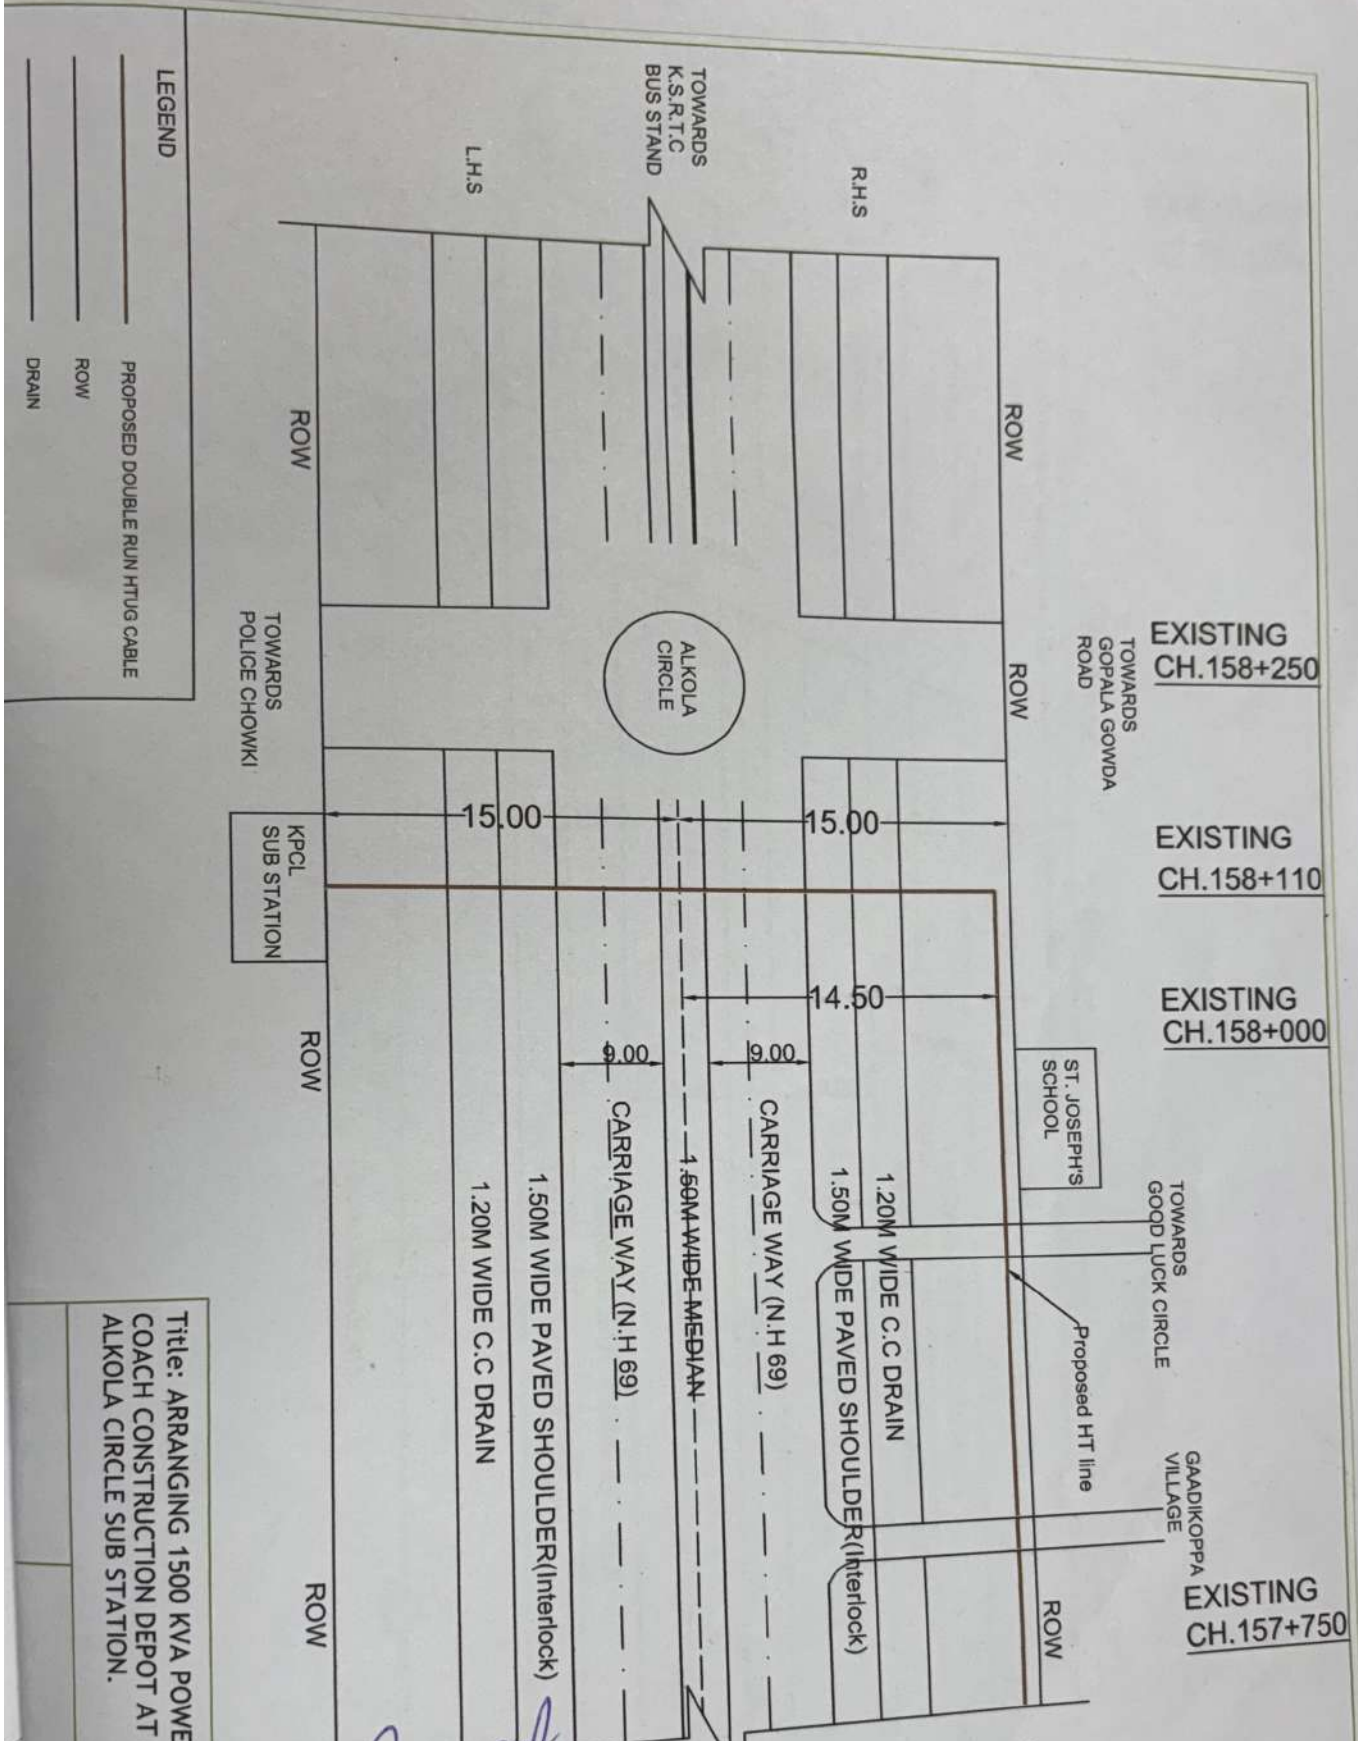

LEGEND

- PROPOSED DOUBLE RUN HTUG CABLE
- ROW
- DRAIN

Title: ARRANGING 1500 KVA POWER SUPPLY TO RAILWAY COACH CONSTRUCTION DEPOT AT KOTEGANNGUE FROM ALKOLA CIRCLE SUB STATION.

Assistant-Executive Engineer
National Highway Sub-Division
SHIMOGA.

Executive Engineer
National Highway Division
Shivamogga.

Deputy Chief Electrical Engineer
(Construction Distribution)
निर्माण / Construction
दक्षिण पश्चिम रेलवे
South Western Railway
बंगलूर छावनी - 560046
Bangalore Cantonment 560046

वरिष्ठ खंड इंजीनियर विद्युत निर्माण
Sr. Section Engineer Electrical Construction
द.प. रेलवे, दावणगेरे.

AXEE/CN/BNC

EXISTING
CH.157+750

EXISTING
CH.156+870

EXISTING
CH.156+500

LEGEND

PROPOSED DOUBLE RUN HTUG CABLE

ROW

DRAIN

Title: ARRANGING 1500 KVA POWER SUPPLY TO RAILWAY
COACH CONSTRUCTION DEPOT AT KOTEGANNGUE FROM
ALKOLA CIRCLE SUB STATION.

Assistant-Executive Engineer
National Highway Sub-Division
SHIMOGA

Executive Engineer
National Highway Division
Shivamogga.

उप मुख्य विद्युत अभियंता
Deputy Chief Electrical Engineer
(विद्युत वितरण)
(Construction Distribution)
निर्माण / Construction
दक्षिण पश्चिम रेलवे

South Western Railway
बंगलूर छावनी - 560046
Bangalore Cantonment 560046

वरिष्ठ खंड इंजीनियर विद्युत निर्माण
Sr. Section Engineer Electrical Construction

द.प. रेलवे, दावणगेरे.
S.W. Railway, Davangere.


AXEE/CN/BNG

EXISTING
CH.156+500

EXISTING
CH.156+100

EXISTING
CH.156+060

TOWARDS
HARSHA FERN

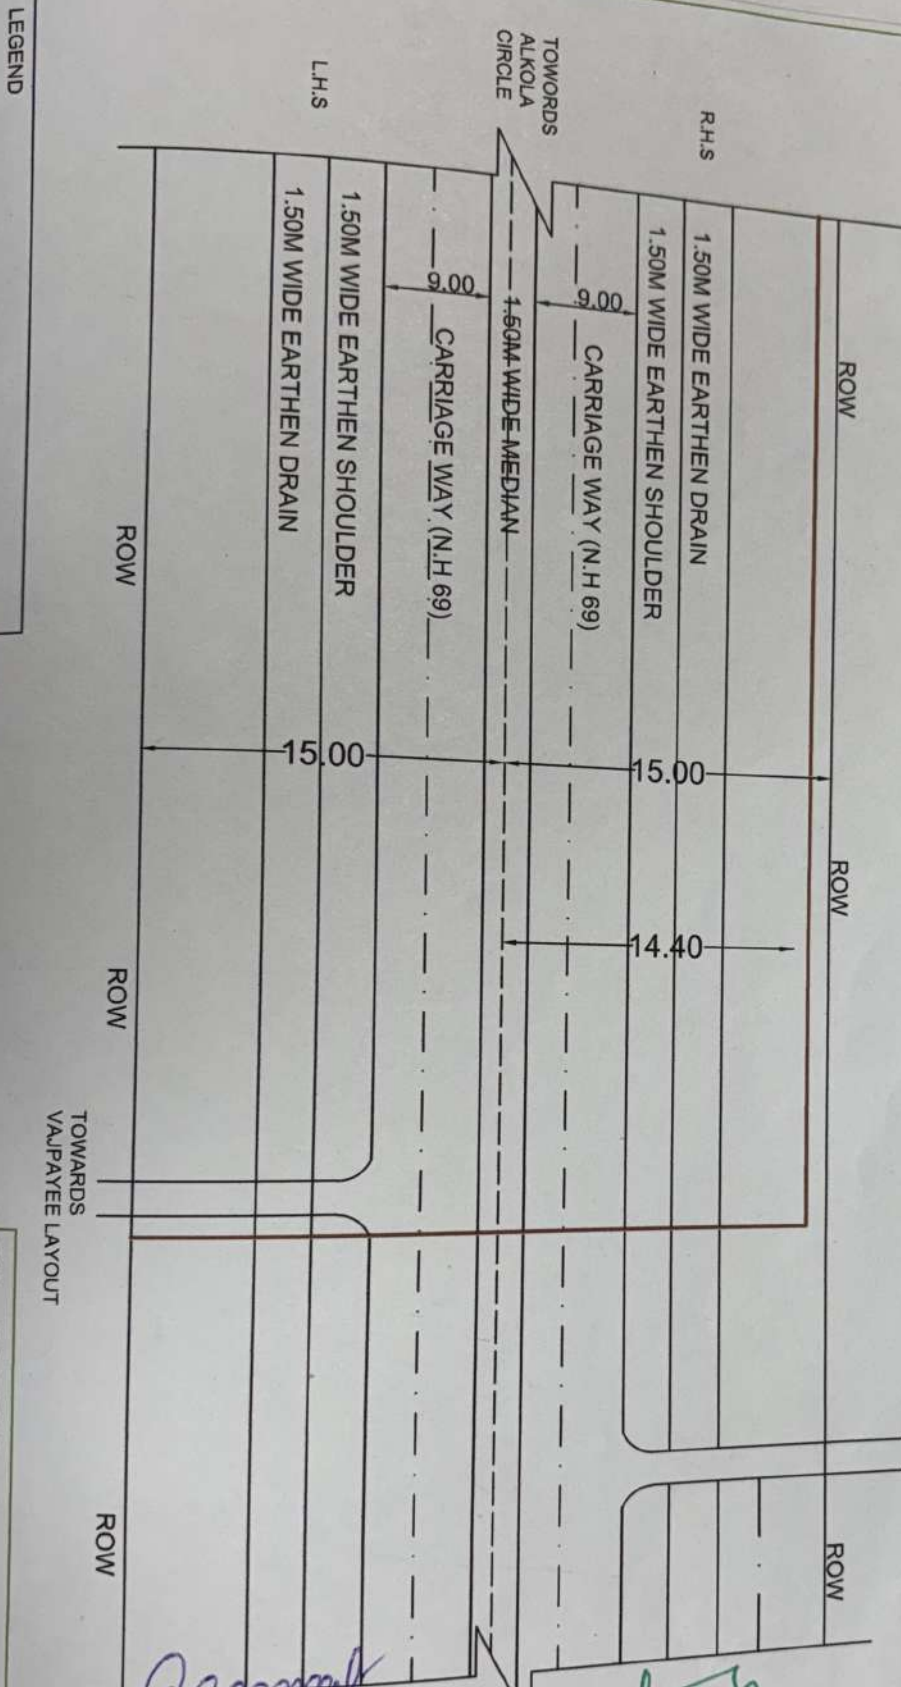

LEGEND

PROPOSED DOUBLE RUN HTUG CABLE
ROW
DRAIN

Title: ARRANGING 1500 KVA POWER SUPPLY TO RAILWAY
COACH CONSTRUCTION DEPOT AT KOTEGANNGUE FROM
ALKOLA CIRCLE SUB STATION.

Assistant-Executive Engineer
National Highway Sub-Division
SHIMOGA.

Executive Engineer
National Highway Division
Shivamogga.

उप मुख्य विद्युत अभियंता
Deputy Chief Electrical Engineer
(कृषि विनियम)
(Traction Distribution)
निर्माण / Construction
दक्षिण पश्चिम रेलवे
South Western Railway
बंगलूर छावनी - 560046
Bangalore Cantonment 56004

वरिष्ठ खंड इंजीनियर विद्युत निर्माण
Sr. Section Engineer Electrical Construction

द.प. रेलवे, दावणगेरे.
S.W. Railway, Davangere.

AXEE/CN/BNC