



Government of India
Ministry of Road Transport & Highways
Office of the Chief Engineer-Regional Officer
No. 32, 2nd Floor, KSCFL Building,
D. Devaraj Urs Road, (Race Course Road), BENGALURU-560 001
Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No. RW/BNG/PER.CASES/BNG. DVN/2019/1064

Dated: 28.12.2020

Notice Inviting Public Comments on proposal seeking permission for laying of 66 KV underground electrical cable by M/s. BMRCL, Bangalore from Km 452.500 to 456.800 of NH 948 through Open trench / HDD method (550 mts. from Km 454.00 to 454.550) and 03 nos. crossings of village road at Km 452.500, Km 455.740 & Km 456.340 through HDD method.

Reference: Your letter Nos. EE/NHD/BNG/AE-1/BMRCL/2020-21/1336 dated 23.10.2020.

The Executive Engineer, NH Div, Bengaluru vide letter cited under reference above (Annexure I), has submitted the proposal seeking Permission for laying of 66 KV underground electrical cable by M/s. BMRCL, Bangalore from Km 452.500 to 456.800 of NH 948 through Open trench / HDD method (550 mts. from Km 454.00 to 454.550) and 03 nos. crossings of village road at Km 452.500, Km 455.740 & Km 456.340 through HDD method.

2. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and is generally found in order.

3. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

The Chief Engineer-Regional Officer
Ministry of Road Transport & Highways
No.32, 2nd Floor, Race Course Road, Bangalore-560 001
Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765

Enclosed: As above.

Copy to: (i) The Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.
(ii) M/s. BMRCL, 3rd Floor, BMTCL Complex, K.H.Road, Shanthinagar, Bangalore - 560027 for information.


(S.Sadananda Babu)
Superintending Engineer

For Chief Engineer - Regional Officer


(S.Sadananda Babu)
Superintending Engineer
For Chief Engineer - Regional Officer

ಕಾರ್ಯನಿರ್ವಾಹಕ ಅಭಿಯಂತರರವರ
ಕಛೇರಿ ರಾಷ್ಟ್ರೀಯ ಹೆದ್ದಾರಿ ವಿಭಾಗ,
ಬೆಂಗಳೂರು.
e-mail- executive_engi@yahoo.com



ಕರ್ನಾಟಕ ಸರ್ಕಾರ

Annexure I

Office of the Executive Engineer
National Highways Division, ,
No.13/4 , 4th Floor CFC
Building Nrupathunga Road
Bangalore -560001
Ph No -080-22211207

No.EE / NHD/BNG/AE-1/BMRCL/2020-21/1336

Date- 23/10/2020

To,

The Chief Engineer (RO),
MoRT&H, No.32, 2nd Floor,
KSCFL Building,
D.Devaraj Urs Road (Race course Road)
Bangaluru-560001.

O/o. THE CE-RO
MORT&H, BENGALURU

Diary No.: 1418

Date: 04/11/20

Sir,

Sub: - Permission for laying of 66KV UG cable for Bangalore Metro Rail
Phase-II Project -Reg

Ref: 1. Executive Director (Traction), Bangalore Metro Rail Corporation Ltd
Bangalore letter no.4889 dated: 11.09.2020
2. Assistant Executive Engineer, National Highway sub-division,
Bangaluru, letter no.154 dated:15.10.2020

With reference to above subject, the proposal to Issue of permission for laying of 66KV UG cable for Bangalore Metro Rail Phase-II Project at various location by availing Power supply from KPTCL from Km 452.500 to Km456.800 of NH-209 Dindigal-Bangalore section, by open trenching method was received by the Executive Director (Traction), Bangalore Metro Rail Corporation Ltd in this office vide letter under ref (1).

The land rent is calculated for the length of about 4.30 KM by considering the guidance values, obtained from the competent authority which is amounting to Rs.7,71,420.00 per annum. Performance security in the form of Bank Guarantee of Rs.4,30,000.00 at the rate Rs.100/Rmt.

The Assistant Executive Engineer, NH sub division, Bengaluru has verified the proposal in accordance with the norms laid down by the Ministry's circular no.RW/NH-33044/29/2015/S&R(R) dated 22nd November 2016 and submitted the proposal vide letter under ref (2).

The Executive Director (Traction), Bangalore Metro Rail Corporation Ltd, Bangalore has submitted necessary check list, drawings with ROW, distance of the pipe line being laid from the centreline of the carriage way and cross sections.

Hence, the proposal for laying of 66KV UG cable for Bangalore Metro Rail Phase-II Project from Km 452.500 to Km456.800 of NH-209 Dindigal-Bangalore section by

open trenching method is here with submitted for obtaining concurrence from the competent Authority.

Encl: As above

Yours faithfully,



Executive Engineer,
N.H.Division, Bengaluru ✓



FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject: Permission for laying of 66 KV underground electrical cable by M/s. BMRCL, Bangalore from Km 452.500 to 456.800 of NH 948 through Open trench / HDD method (550 mts. from Km 454.00 to 454.550) and 03 nos. crossings of village road at Km 452.500, Km 455.740 & Km 456.340 through HDD method - Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	p) Application No.	
	q) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	r) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

TOWARDS BANGALORE



Earthen Shoulder




BMRCL 66 KV Single Circuit UG Cable Line of 630 Sq mm dia. each

Sl. No.	Starting Chainage	Ending Chainage	Length in Km
1	452.5	454	1.5

3.3 B1
ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ ಅಭಿನಯರ
ರಾಷ್ಟ್ರೀಯ ಹೆದ್ದಾರಿ ಅಭಿವೃದ್ಧಿ
ಪ್ರಾಧಿಕಾರ.


EXISTING 66 KV UG CABLE LAYING PLAN FROM SOMANAHALLI SUB-STATION TO MTR JUNCTION

ANNEXURE A

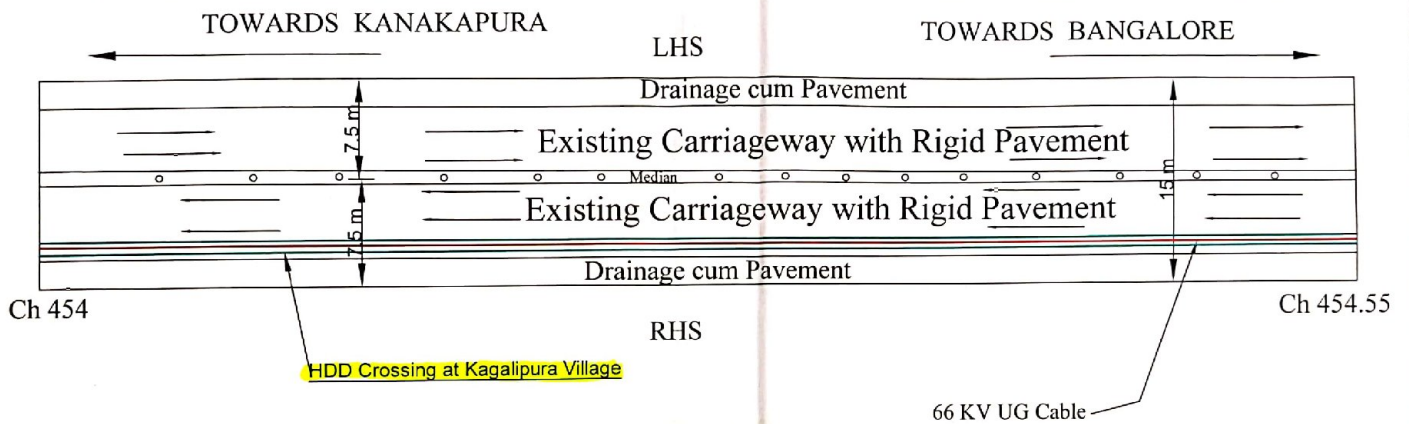


ANNEXURE B

CROSS SECTIONAL DETAILS OF 66 KV UG CABLE LINE (HDD Method)



BMRL 66 KV Single Circuit UG Cable Line of 630 Sq mm dia. each

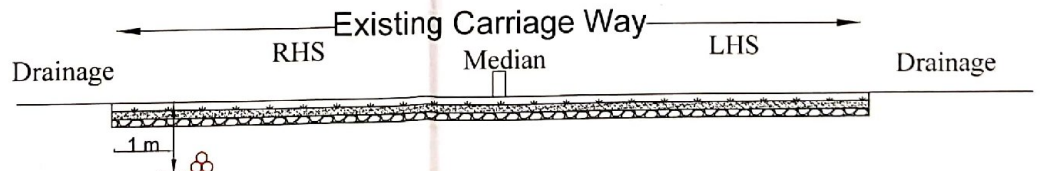


Sl. No.	Starting Chainage	Ending Chainage	Length in Km
1	454	454.55	0.55


3.3.81
 ಸಹಾಯಕ ಕಾರ್ಯಪಾಲಕ ಕಂಪೌಂಡರ್
 ರಾಜ್ಯದ ಸಾರ್ವಜನಿಕ ಕಾರ್ಯದ
 ಇಲಾಖೆ, ಬೆಂಗಳೂರು

EXISTING 66 KV UG CABLE LAYING PLAN FROM SOMANAHALLI SUB-STATION TO MTR JUNCTION


ANNEXURE-A

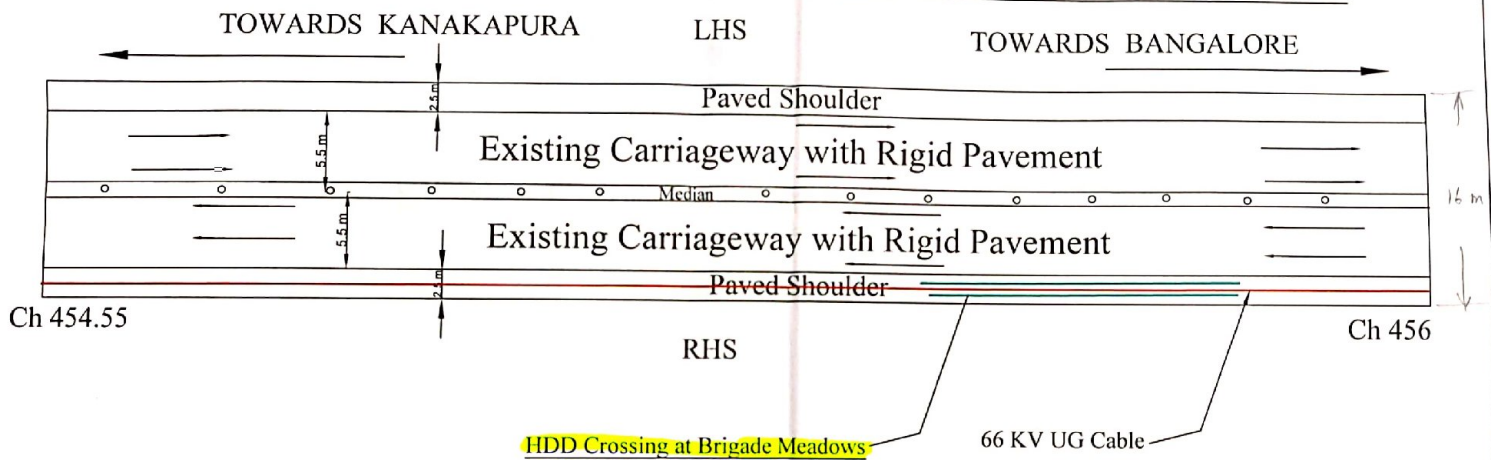

CROSS SECTIONAL DETAILS OF 66 KV UG CABLE LINE (Open Trench Method)



BMRL 66 KV Single Circuit UG Cable Line of 630 Sq mm dia. each

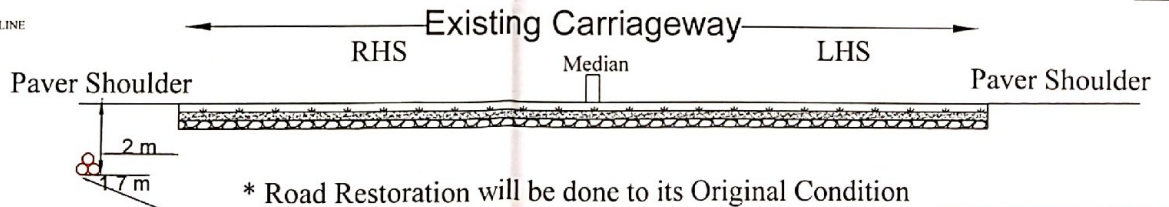


Sl. No.	Starting Chainage	Ending Chainage	Length in Km
1	454.55	456	1.45

S. Y. B. L.


ಸಹಾಯಕ ಕಾರ್ಯದರ್ಶಿ ಕಾರ್ಯದರ್ಶಿ

ರಸ್ತೆ ಸಂಸ್ಕರಣೆ ಮತ್ತು ಮರಣ


18/06/2020

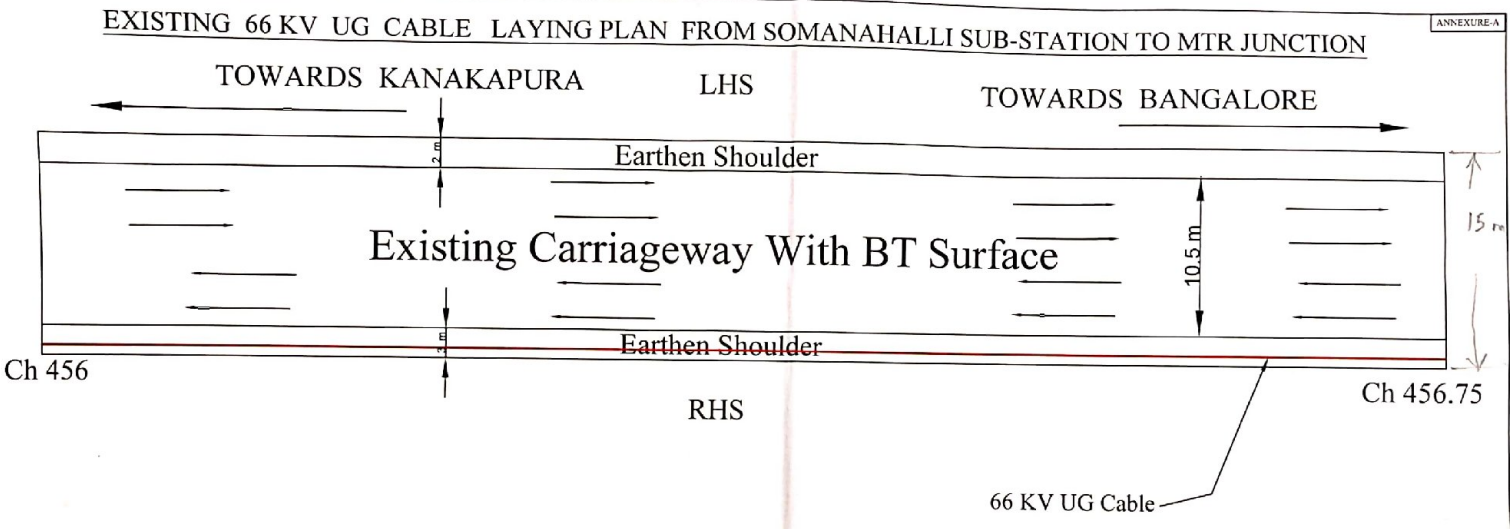

CROSS SECTIONAL DETAILS OF 66 KV UG CABLE LINE
(Open Trench Method)



BMRCL 66 KV Single Circuit UG Cable Line of 630 Sq mm dia. each

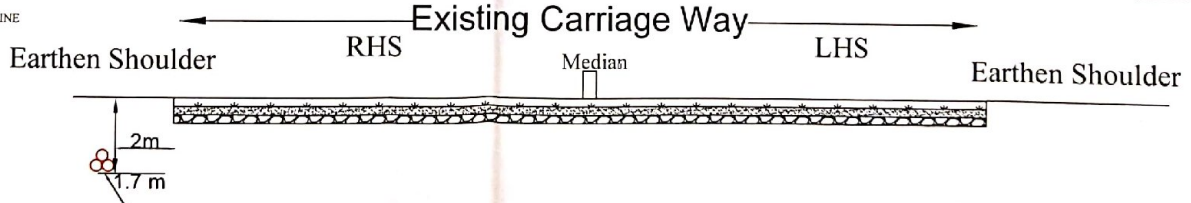

Sl. No.	Starting Chainage	Ending Chainage	Length in Km
1	456	456.75	0.75

Handwritten signature and text in Kannada script.