



Telefax: 040-23393206

:04023378549

**GOVERNMENT OF INDIA
MINISTRY OF ROAD TRANSPORT & HIGHWAYS**

**REGIONAL OFFICE;
Quality Control Building,
Errum Manzil,
Hyderabad-500082
Dated: 06.06.2019**

No.RW/HYD/Misc-24(D)/utility services

1173

**Notice Inviting Public Comments on Laying of 33KV electrical overhead
lines along NH-44 from Km 74.600 to 75.800**

Sub: Proposal for permission for laying of 33KV electrical overhead lines for M/s Mission Bhageeratha from Telangana State Southern Power Distribution Company Limited at Pollepally (V), Jadcherla(M), Mahabubnagar(D) in the State of Telangana abutting NH-44 at km.74/600 to km.75/800 (LHS)- Reg.

Ref: i) The Project Director, PIU, NHAI, Hyderabad letter No. NHAI/PIU-HYD/Hyd-Ban/Electrical/2019/437 dated 25.04.2019

The Proposal is for permission for laying 33KV electrical overhead lines for M/s Mission Bhageeratha from Telangana State Southern Power Distribution Company Limited at Pollepally (V), Jadcherla(M), Mahabubnagar(D) in the State of Telangana abutting NH-44 at Km.74/600 to km.75/800 (LHS).

2. The proposal has been examined as per Ministry Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and is generally found in order

3. In view of above, as per Ministry's guidelines Para 4, public comments are invited on the above proposal seeking claims and objections (on grounds of public inconvenience, safety and general public interest) within 30 days on public portal i.e. website of Ministry of Road Transport and Highways (www.morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

The Chief-Engineer-Regional Officer
Regional Office, MoRT&H
Quality Control Building, 2nd floor,
Errum Manzil Colony
Hyderabad - 500082
Email Id: rohyd_morth@nic.in

Yours faithfully,

(G R Choudhary)

Executive Engineer

For Regional Officer cum Highway Administrator

Copy to:-

- I. Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.
- II. The Project Director, Project Implementation Unit, National Highway Authority of India, 24A & 38A, Administrative Staff College of India (ASCI), College Park Campus, Road No.3, Banjara Hills, Hyderabad-500034.



(G R Choudhary)

Executive Engineer

For Regional Officer cum Highway Administrator

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways

Sub: Proposal for permission for laying of 33KV electrical overhead lines for M/s Mission Bhageeratha from Telangana State Southern Power Distribution Company Limited at Pollepally (V), Jadcherla(M), Mahabubnagar(D) in the State of Telangana abutting NH-44 at Km.74/600 to km.75/800 (LHS)- Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments


Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	a) Application No.	
	b) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	c) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	


Subject: Laying of 33 KV electrical overhead line in erecting from Km 74/600 to Km 75/800 on LHS on NH -44 (Hyderabad -Bangalore) in the state of Telangana by "Southern Power Distribution Company Telangana Ltd" for "Mission Bhageeratha".

SPECIAL ANNEXURE FORM TO ACCOMPANY PROPOSALS SUCH AS LAYING OF UTILITLY SERVICES ALONG NATIONAL HIGHWAYS

1	Type of Utility	Electrical Line
1A	In case any other at Sl. No. 1, Mention the type of utility	NA
2	Category of utility	Mission Bhageeratha
3	Whether license fee calculation verified by executive Engineer / Project Director and authorized representative of utility Service is enclosed or not.	YES
3A	Weather verified supporting document for prevailing circle rate for land per unit area enclosed and checked or Not	YES
4	Weather Performance Bank Guarantee calculation as per Ministry guidelines dated 22.11.2016 by executive Engineer / Project Director and authorized representative of utility Service is enclosed or not.	YES
5	Whether the proposal mention details about the various safety clearances from the respective authorities such as Directorate of Electricity, Chief Control of Explosives, Petroleum and explosives Safety Organization, Oil industry safety Directorate, State Central Pollution Control Board and any other statutory clearances as applicable or not	YES
6	Whether verified linear diagram indicating all road feature like the Centre line, Carriageway edge, earthen shoulder, service Road (if any) , drain (if any), ROW etc. By Executive Engineer of concerned Division / Project Director of PIU have been enclosed or not	YES
7	Whether draft license deed in original signed by Authorized representative of Utility service along with two witness is enclosed or not	YES
8	Whether proposal of utility service confirm the guideline issued vide Ministry letter No. RW/NH-33044/29/2018 S&R dated 22.11.2016 or not	YES


Divisional Engineer Elect.
Operation / TSSPDCL.
JADCHERLA


Project Director
NHAI, PIU
HYDERABAD.

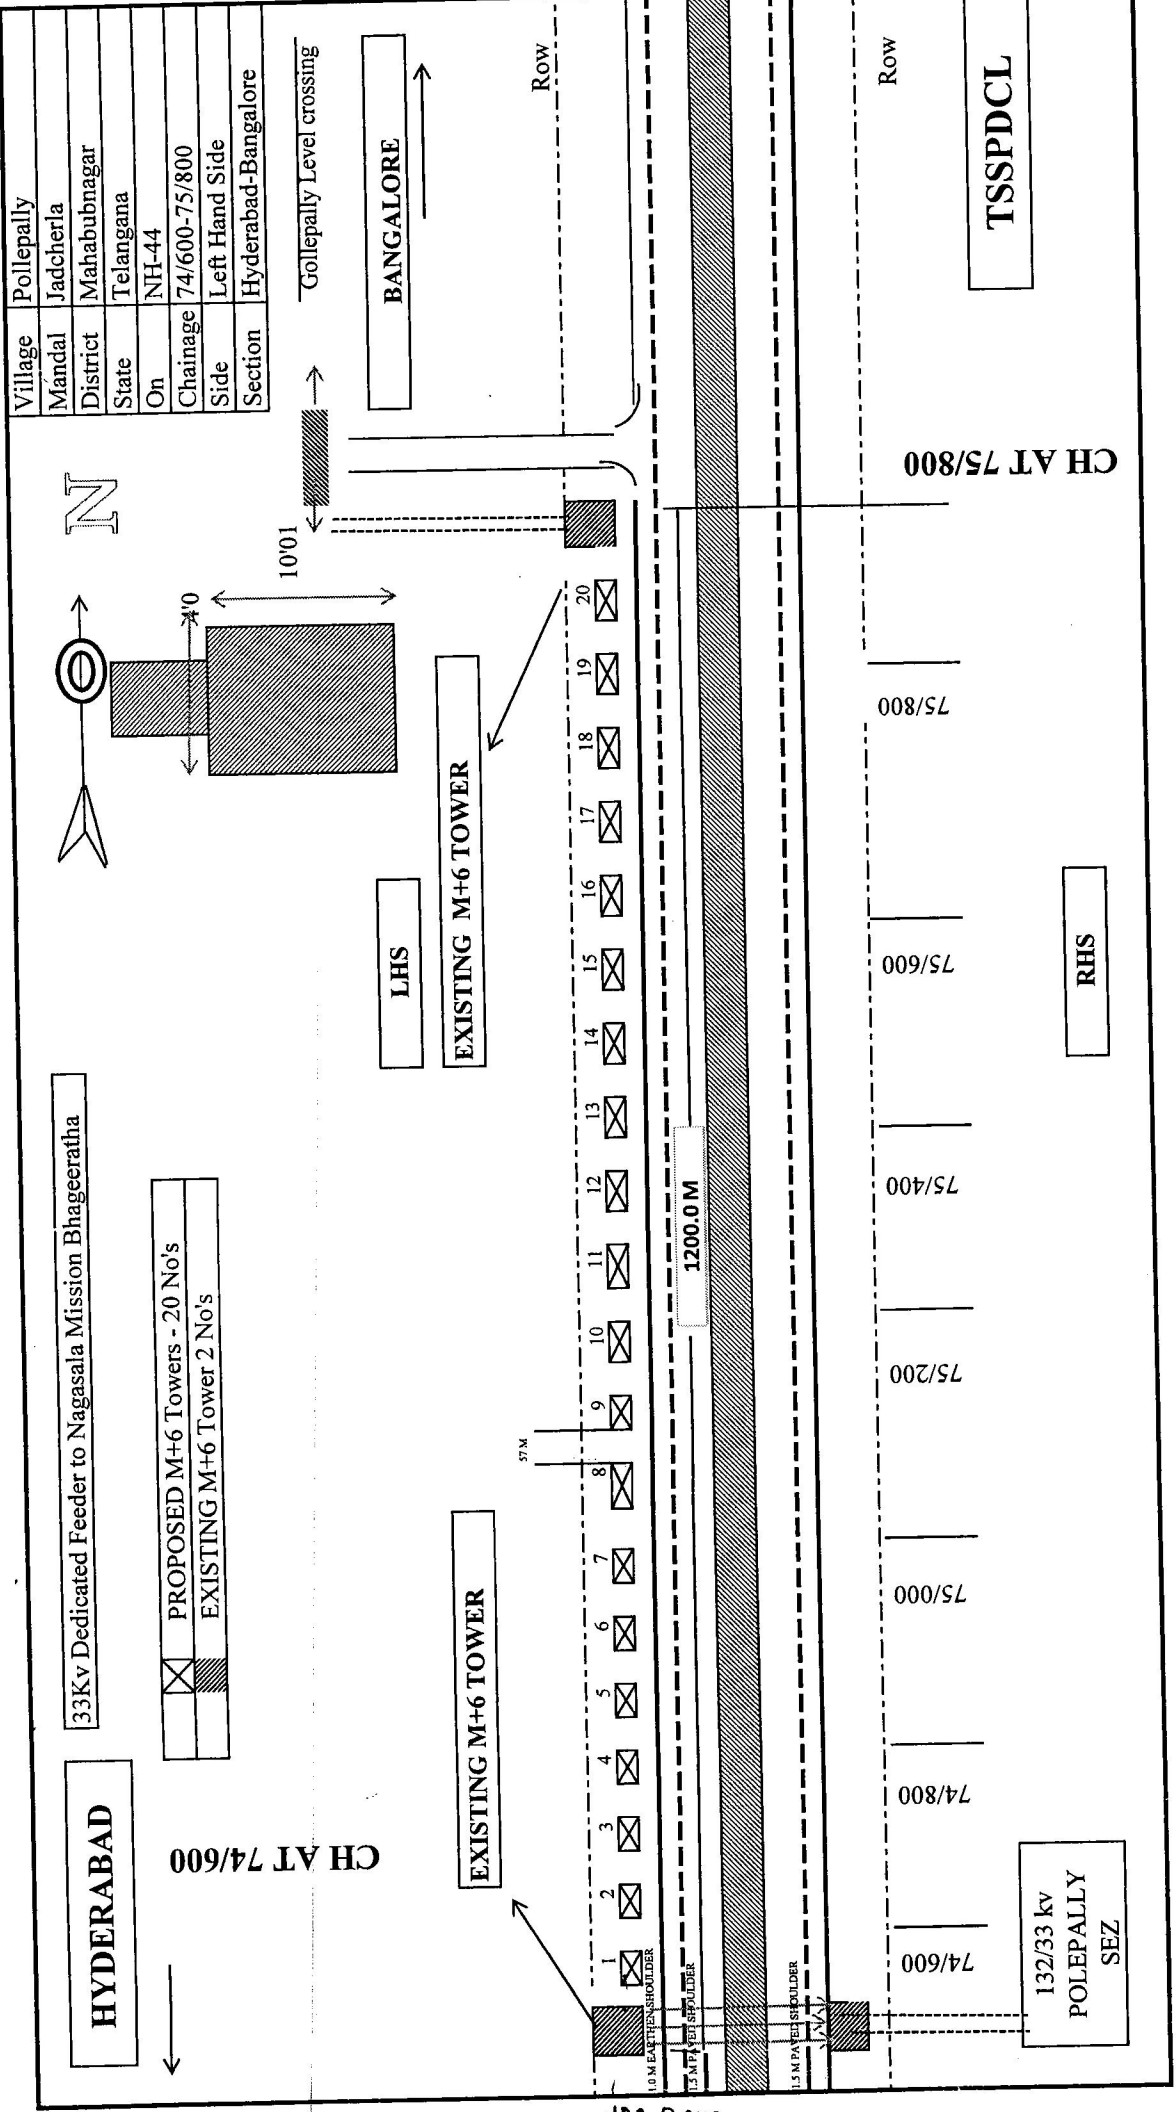

Project Director
NHAI, PIU
HYDERABAD,

Divisional Engineer Elect.
Operation / TSSPDCL.
JADCHERLA

- 1) Foundation Of Tower 4'0X4'0X10'00"
- 2) Height Of The Tower from Ground Level 16.5 Mtrs
- 3) Tower to Tower Distance 57 Mtrs
- 4) No. Of Towers 20 Nos