



Government of India
Ministry of Road Transport & Highways
Office of the Regional Officer, (Civil)

No. 32, 2nd Floor, KSCFL Building, Race Course Road, BENGALURU-560 001
Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No. RW/BNG/PER.CASES/MNG.DVN/2013

Dated: 20.12.2022

Notice Inviting Public Comments on proposal seeking permission to laying of water pipeline for drinking water scheme along NH 275 from Kabaka Km 10.200 to Km 10.850 on LHS (650 m), from Km 10.850 to Km 11.100 on LHS (250 m), from Km 11.100 to Km 11.400 on LHS (300 m), from Km 11.400 to Km 12.000 (600 m) on LHS, Km 12.000 to Km 12.400 (400 m) on LHS, from Km 12.400 to Km 13.600 (1200 m) on LHS, Km 13.600 to Km 14.150 on LHS (550 m), from Km 14.150 to Km 16.200 on LHS (2050 m), and from Km 16.200 to Km 16.450 on RHS (250 m), from Km 16.450 to Km 16.850 on RHS (400 m), from Km 16.850 to Km 18.100 on RHS (1250 m) for a total length of 7.90m through open trench method and three road crossings at Km 11.400, Km 14.100 & Km 16.850 through HDD method in the State of Karnataka by Municipal Commissioner, Puttur City Municipal Council - reg.

Reference: The Executive Engineer, NH Division, Mangalore letter No. EE/NHD/MNG/AE-1/NH-275/water pipe line/NOC/Compliance/2022-23/1711 dated 28-11-2022.

The Executive Engineer, NH Division, Mangalore vide letter cited under reference above (Annexure I), has submitted proposal seeking permission for the above mentioned proposal by Municipal Commissioner, Puttur City Municipal Council.

2. The proposal has been examined as per Ministry's Guidelines vide letter no. RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and is generally found in order.

3. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

Regional Officer

Office of the Regional Officer, (Civil)

No. 32, 2nd Floor, KSCFL Building, Race Course Road, BENGALURU-560 001
Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

Enclosed: As above.

Copy to : (i) The Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.
(ii) Municipal Commissioner, Puttur City Municipal Council for information.

(Sandesh K)

Asst. Engineer (C)

For Regional Officer-MoRTH

(Sandesh K)

Asst. Engineer (C)

For Regional Officer-MoRTH

FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject: Proposal seeking permission for laying of water pipeline for drinking water scheme along NH 275 from Kabaka Km 10.200 to Km 10.850 on LHS (650 m), from Km 10.850 to Km 11.100 on LHS (250 m), from Km 11.100 to Km 11.400 on LHS (300 m), from Km 11.400 to Km 12.000 (600 m) on LHS, Km 12.000 to Km 12.400 (400 m) on LHS, from Km 12.400 to Km 13.600 (1200 m) on LHS, Km 13.600 to Km 14.150 on LHS (550 m), from Km 14.150 to Km 16.200 on LHS (2050 m), and from Km 16.200 to Km 16.450 on RHS (250 m), from Km 16.450 to Km 16.850 on RHS (400 m), from Km 16.850 to Km 18.100 on RHS (1250 m) for a total length of 7.90m through open trench method and three road crossings at Km 11.400, Km 14.100 & Km 16.850 through HDD method in the State of Karnataka by Municipal Commissioner, Puttur City Municipal Council - Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	a) Application No.	
	b) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	c) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

annexure-1

Sl.No. 96(R)

GOVERNMENT OF KARNATAKA
(Public Works Department)
NATIONAL HIGHWAYS

Office of the Executive Engineer, National Highway Division,
Ashoknagar Post, Urva Store Mangalore-575006.

Phone No.0824-2450415

Fax No.0824-2980415

Email : eenhdmng@gmail.com

No.EE/NHD/MNG/AE-1/NH-275/Water pipe line/NOC/Compliance/2022-23/1711-13

Office of the Executive Engineer,
National Highway Division
P.O. Ashoknagar, Urva Store
Mangaluru - 575006,
Date: 28-11-2022

To,

The Chief Engineer
Regional Officer,
M.O.R.T.& H.,
No. 32, 2nd Floor,
KSCFL Building,
D. Devaraj Urs Road
(Race Course Road)
Bengaluru - 560001.

O/o. THE CE-RC
MORT&H, BENGALURU

Diary No.: 3078

Date: 29-11-2022

Pl. put up

AE on file please

Sir,

Sub: Request for permission to lay Water pipe line by open trench method and road crossing only HDD method from KUID & FCL, Puttur Division, Drinking Water Scheme along NH-275 Kabaka from Km.10.200 to Km.10.850 on LHS (650), from Km 10.850 to Km 11.100 on LHS (250), from Km 11.100 to Km 11.400 on LHS (300), from Km 11.400 to Km 12.000 on LHS (600) from Km 12.000 to Km 12.400 on LHS (400), from Km 12.400 to Km 13.600 on LHS (1200), from Km 13.600 to Km 14.150 on LHS (550), from Km 14.150 to Km 16.200 on LHS(2050) from 16.200 to Km 16.450 on RHS(250) from Km 16.450 to Km 16.850 on RHS (400) from Km 16.850 to Km 18.100 on RHS (1250) and Three Road crossings at Km 11.400, Km 14.100 & Km 16.850 for the total length of 7.90 kms, in the State of Karnataka - Resubmission of proposal - reg.

Ref: 1. Chief Engineer - Regional officer, MoRT&H, KSCFL Building, Bangalore letter No:RW/BNG/PER.CASES/MNG.DVN/2013/ 1280 Dated:22.03.2022.
2. Assistant Executive Engineer, National Highway Sub Division, Mangalore letter no.704 dated:16.11.2022

With reference to the above subject, the proposal for seeking permission for laying Water pipe line by KUID & FCL, Puttur Division for Drinking Water Scheme along NH-275 in Kabaka from Km.9.900 to Km.10.850 on RHS, Kodipadi cross Km 11.400 to Km 13.600 on RHS, Deraje Cross Km 14.700 to Puttur Police Station Km 18.100 on RHS and from Kabaka Km 10.200 to Ashwini Circle Km 15.00 on LHS, KSRTC Depo Km 17.200 to Puttur Police Station Km 18.100 on LHS for the total length of 12.250 kms RHS & LHS open trenching method permission and Four road crossing at Km 10.220, Km 10.850, Km 12.00 & Km 16.850 by HDD method in Puttur Town in the State of Karnataka has been returned with the observations by the Regional officer (Civil), MORT&H, Bangalore vide letter cited under ref(1).

In view of the above, the revised proposal along with compliance for the observation raised has been re-submitted by Commissioner, City Municipal, Puttur, Dakshina Kannada District vide letter No :KIUWMIP/PIU-PTR/CR.09/ 2018-19/247 dated:16.11.2022 to the Assistant Executive Engineer, National Highway Sub Division, Mangalore.

Accordingly the following compliance to the observation are submitted by the Assistant Executive Engineer, National Highway Sub Division, Mangalore vide letter cited under ref (3).

Sl. No.	Observation	Compliance
1	The laying of water pipeline is proposed on both side of NH. The proposal needs to be examined in light of future widening to 2 lane + Paved shoulder and 4 laning for which the entire available land in ROW is required. Further, corridor of impact of widening work w.r.t. the available ROW may also be examined.	Now the laying of water pipeline is proposed on one side of National Highway. Resubmitted modified all drawings, check list etc.
2	The proposed work becomes a obstruction for the widening of NH road in near future. This will hamper future improvement of National Highway. Hence, lying of pipeline on alternate route or in single side of National Highway may be explored.	Now the laying of water pipeline is proposed on one side of National Highway.
3.	In the enclosed proposal, the chainages mentioned in the proposed drawings and in the license fee calculation is not matching and for calculation of license fee all the proposed pipelines needs to be considered. As such the Executive Engineer, National Highway Division, Mangalore is requested to examine the proposals thoroughly as per Ministry's guidelines and see that the proposal is properly prepared in the file format and submitted to this office, to avoid delay in processing the proposals.	The chainages of proposed drawings and license fee calculation is now corrected and resubmitted by the KUID & FCL, Puttur Division. The license fees calculation sheet and BG calculation sheets are enclosed in Annexure - I and Annexure - II. The proposal is verified and herewith submitted.

The proposal along with compliance and revised layout drawings etc are submitted herewith in 3 sets for kind perusal and needful.



The proposal is submitted for further needful action.

Encl: Proposal - 2 sets

Yours faithfully,

Executive Engineer
National Highway Division
Mangaluru.

S/L NO	TYPE	PIPELINE	MATERIAL	DIAMETER (mm)
1	PROPOSED	→	HDPE	75
2	PROPOSED	→	HDPE	110
3	PROPOSED	→	DI	150
4	PROPOSED	→	HDPE	160
5	PROPOSED	→	DI (K)	200
6	PROPOSED	→	DI (K)	250
TOTAL (m)				

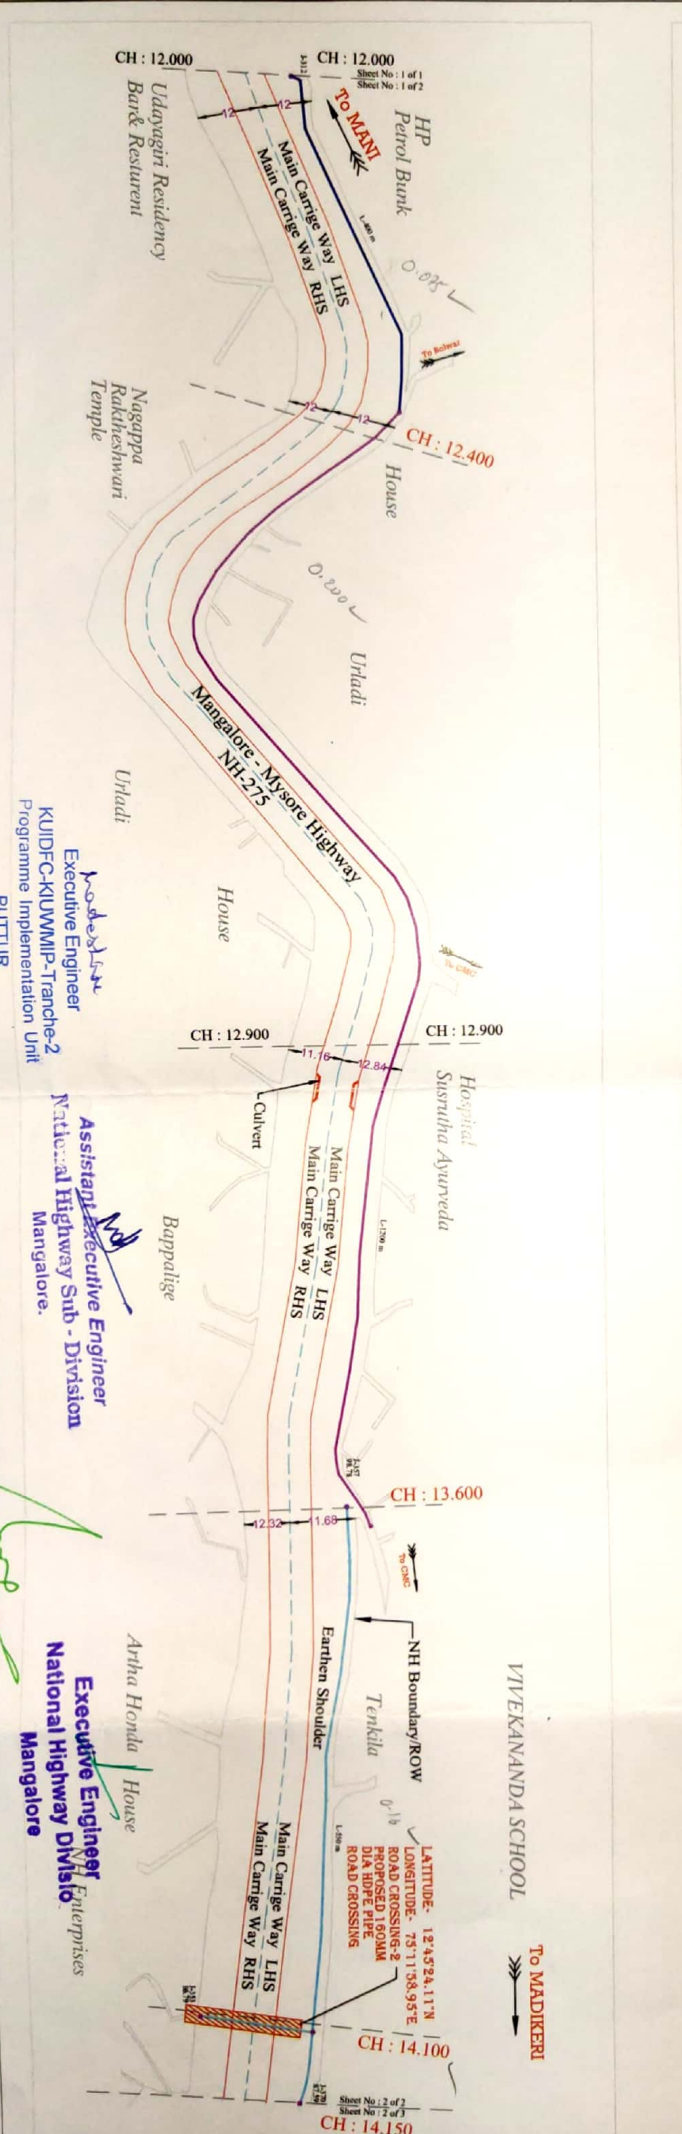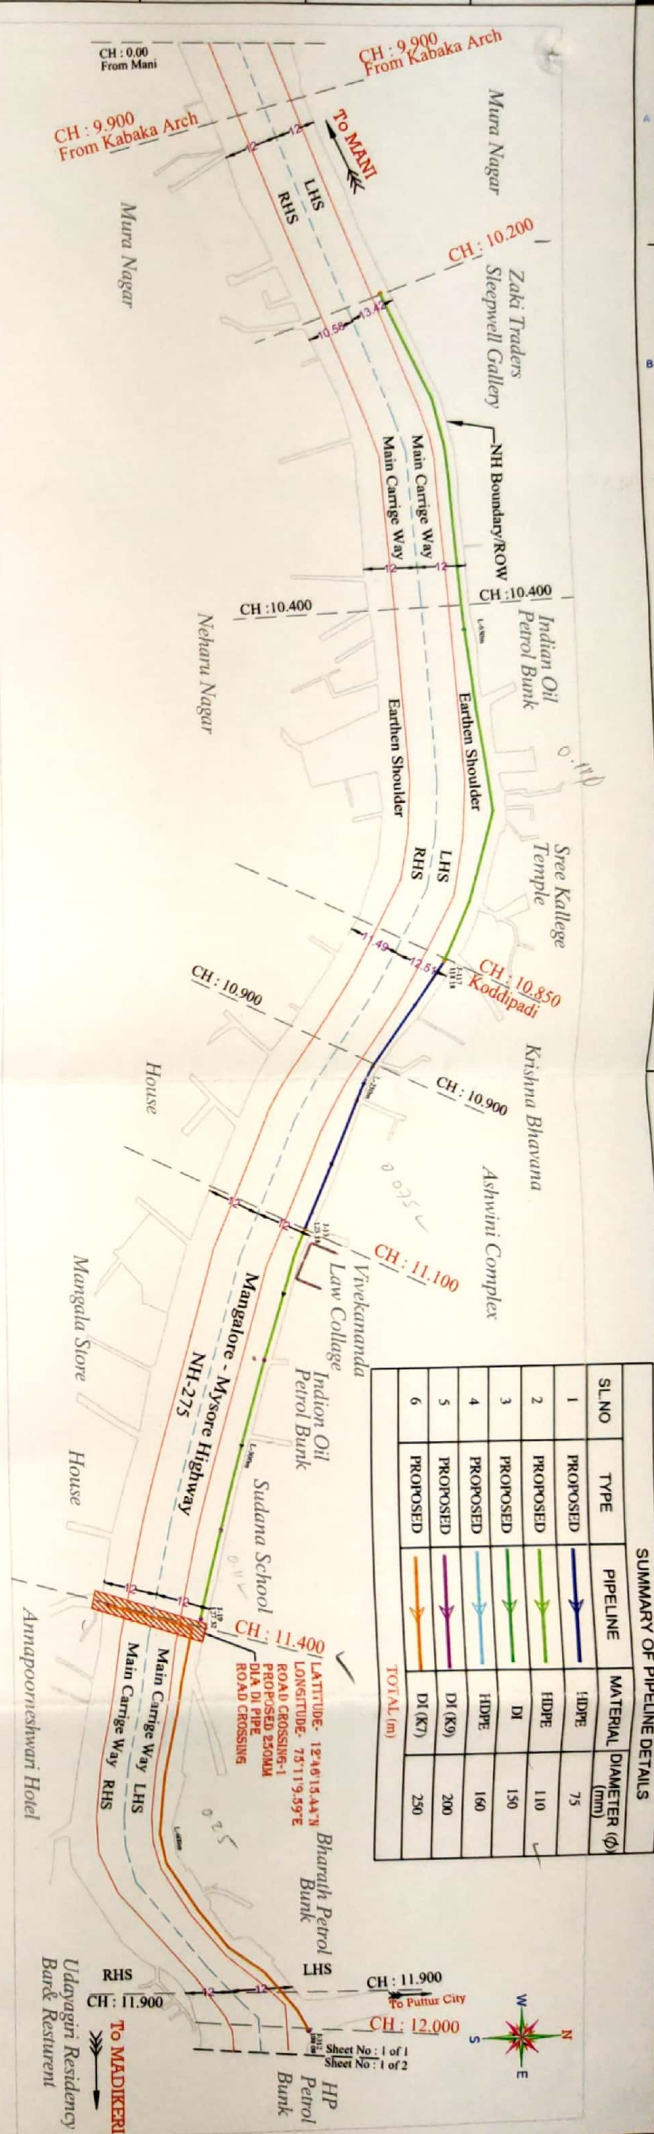

Employer : PUTTUR CITY MUNICIPAL COUNCIL (PCMC)

Contractor : SPPL-SIPL-DRS JV

PMC : Egi India Consulting Engineers Pvt Ltd.

Project : Construction of Water & Sewerage Services for Operation and Management of 24x7 Puttur City Municipal Corporation in Karnataka

PMU : KARNATAKA URBAN INFRASTRUCTURE DEVELOPMENT AND FINANCE CORPORATION KUIDFC - KIUWMIP (TR-2)

Executive Engineer
National Highway Sub-Division
Mangalore

Assistant Executive Engineer
National Highway Sub-Division
Mangalore

Executive Engineer
National Highway Division
Mangalore


PRINCIPAL COMMISSIONER

PROPOSED PIPELINE ALIGNMENT DWG FOR NH-275

SCALE: 1:1000


DATE

Sheet No: 1 of 1

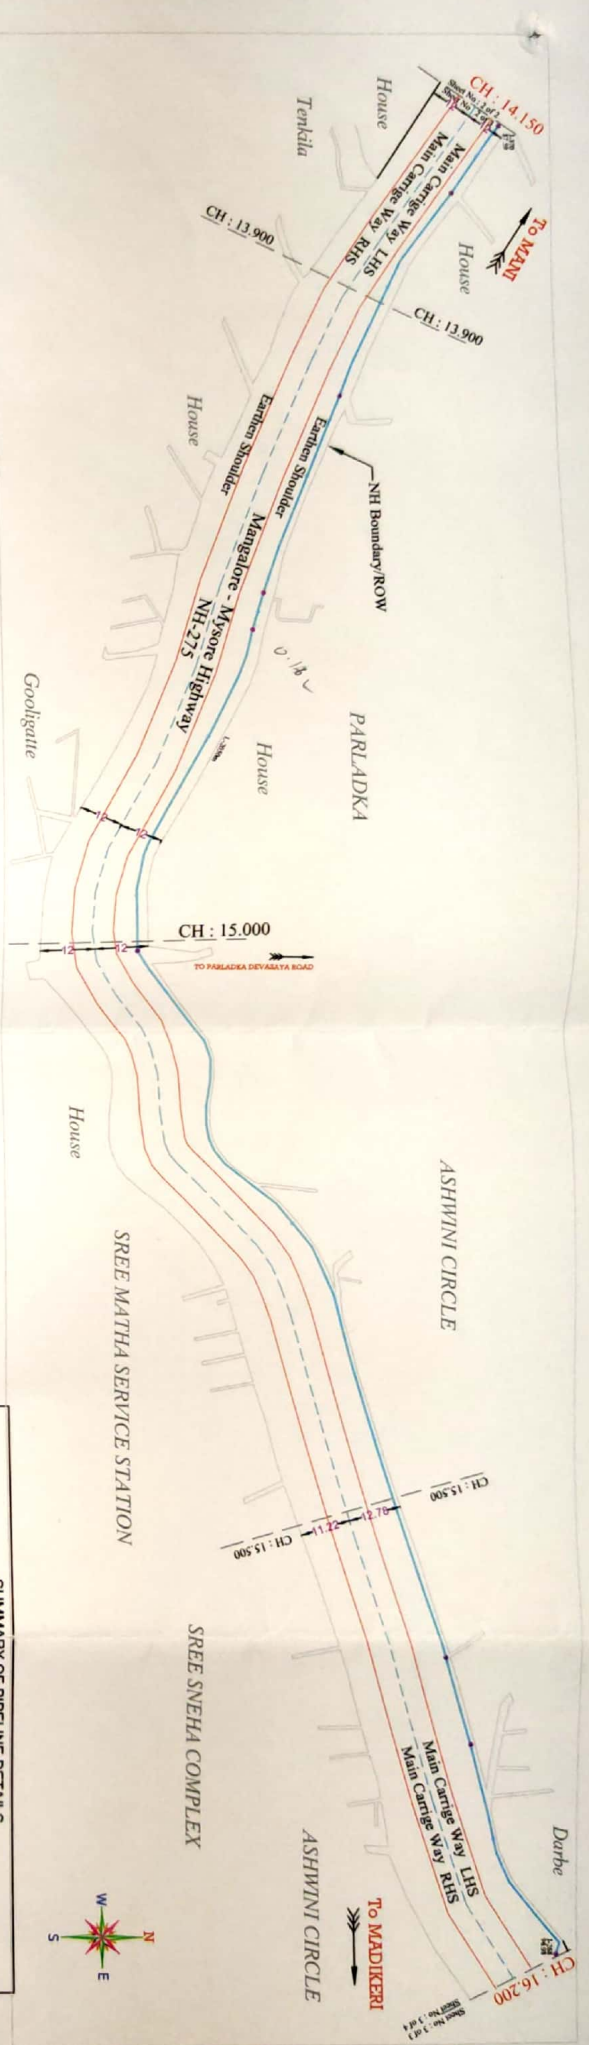

SUMMARY OF PIPELINE DETAILS

SL NO	TYPE	PIPELINE	MATERIAL	DIAMETER (Ø) (mm)	LENGTH (m)
1	PROPOSED	→	HDPE	75	650.00
2	PROPOSED	→	HDPE	110	2450.00
3	PROPOSED	→	DI	150	400.00
4	PROPOSED	→	HDPE	160	2600.00
5	PROPOSED	→	DI (K9)	200	1200.00
6	PROPOSED	→	DI (K7)	250	600.00
TOTAL (m)					7900.00

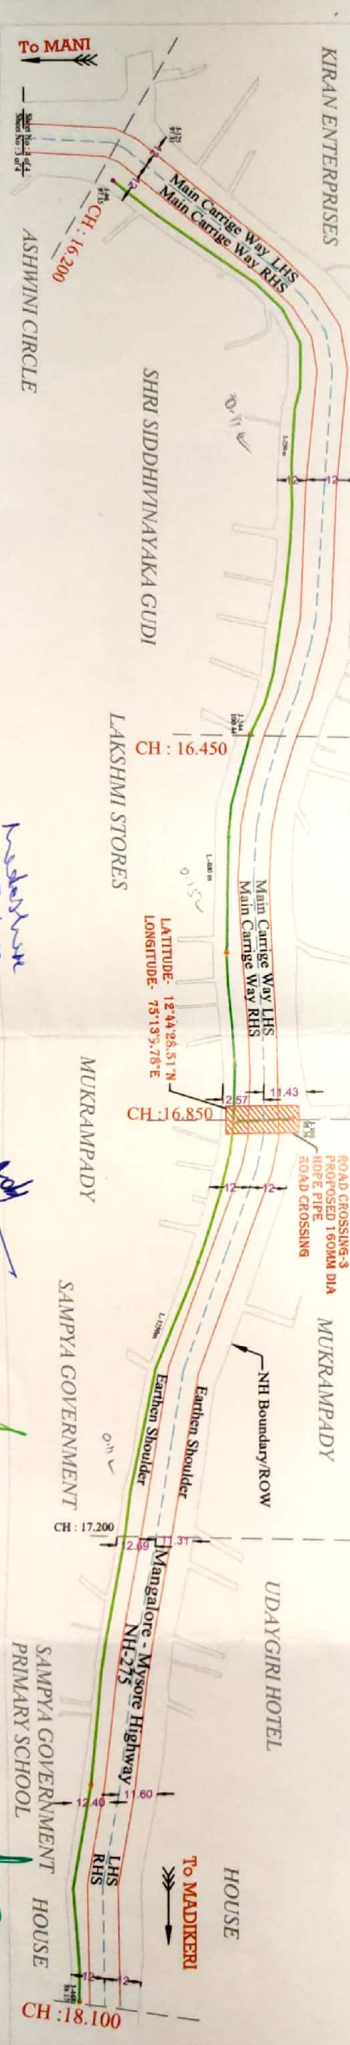

Employer : PUTTUR CITY MUNICIPAL COUNCIL (PCMC)

Contractor : SPPL-SIPL-DRS JV

PMC : Egis India Consulting Engineers Pvt Ltd
First Floor, Mangalore city corporation commercial complex, Malikarjuna Kadri, Mangalore-575 002, Karnataka, India.

Project : Construction of Works & Services for Operational Management of 24x7 Water Supply System for Puttur Town in Karnataka

Executive Engineer
KUIDC-KIUVWMP-Tranche-2
Programme Implementation Unit
PUTTUR

Assistant Executive Engineer
National Highway Sub-Division
Mangalore

Municipal Commissioner
Puttur City Municipal Corporation

Executive Engineer
National Highway Division
Mangalore

TITLE : PROPOSED PIPELINE ALIGNMENT DWG FOR NH-275

SCALE : 1:1000

Sl	DATE	DESCRIPTION	TYPE	NAME	VERSION	FOR APPROVAL
01	01/08/2024	ISSUED FOR TENDERS	P	001	0	Submission Purpose

KARNATAKA URBAN INFRASTRUCTURE DEVELOPMENT AND FINANCE CORPORATION KUIDC - KIUVWMP (TR-2)

suez

FIGURE-1 INSTALLATION OF CARRING AND CASINGS PIPE FOR CROSSING THE ROAD



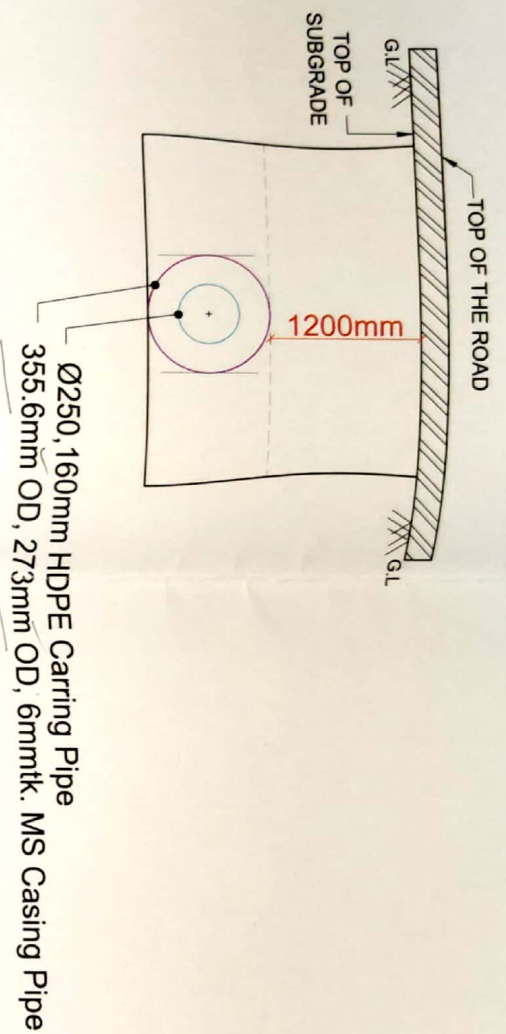


FIGURE-2 INSTALLATION OF WATER PIPELINE FOR OPEN TRENCH

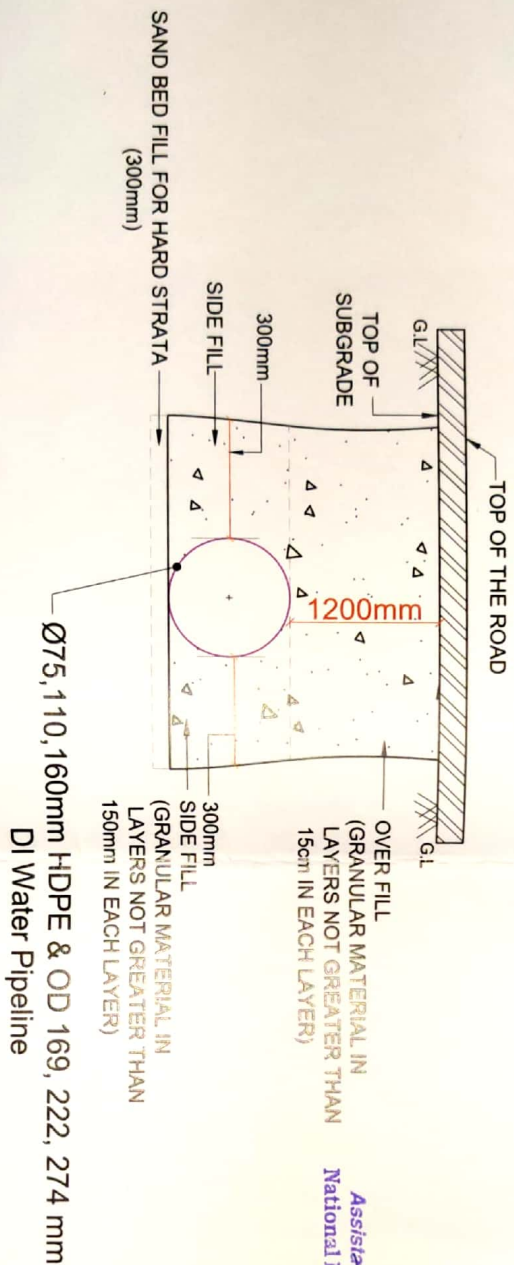

KEY PLAN

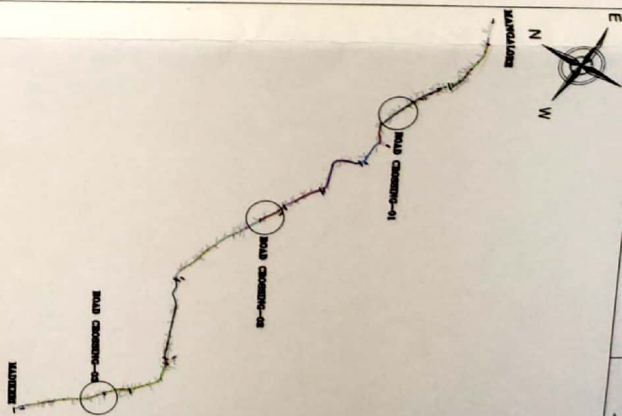

Executive Engineer
National Highway Division
Mangalore

Assistant Executive Engineer
National Highway Sub-Division
Mangalore

Executive Engineer
KUIDEC-KIUMMIP-Tranche-2
Programme Implementation Unit
PUTTUR

MUNICIPAL COMMISSIONER
Puttur City Municipal Council

Employer:
PUTTUR CITY MUNICIPAL COUNCIL
(PCMC)

Contractor:
SPPL-SPL-DRS JV
suez

NOTE :-
1. ALL DIMENSION ARE IN MM & LEVEL ARE IN METER.
2. ** MARKED TO BE SUIT AS PER SITE.

PMC:
egis india
Egis India Consulting Engineers Pvt Ltd
First Floor, Mangalore city corporation
commercial complex, Mallikartha Kadri,
Mangaluru - 575 002.
Karnataka, India

Project:
Construction of Works & Services for Operation
and Management of 24x7 Water Supply System
for Puttur Town in Karnataka
(Contract Package No. 02PTR01)
Document owner:
SPPL-SPL-DRS JV
SCALE: 1:50

REV	DATE	PREPARED BY	CHECKED BY	VALIDATED BY	C.R.	FOR APPROVAL
1	15/11/2023	SPPL-SPL-DRS JV	SPPL-SPL-DRS JV	SPPL-SPL-DRS JV	SPPL-SPL-DRS JV	SPPL-SPL-DRS JV

PROJECT NO.	ISSUED	DESIGNED	UNIT ACTIVITY NO.	TYPE	LOCATION	NUMBER	REV	VERSION	DATE
Y-400013	SUEZ	IP	000	DN	200	003	B	0	FA

SECTION OF PIPELINE INSTALLATION