



भारतीय राष्ट्रीय राजमार्ग प्राधिकरण
(सडक परिवहन और राजमार्ग मंत्रालय, भारत सरकार)
NATIONAL HIGHWAYS AUTHORITY OF INDIA
(MINISTRY OF ROAD TRANSPORT AND HIGHWAYS, GOVT. OF INDIA)



परियोजना निदेशक कार्यालय, परियोजना कार्यान्वयन इकाई

201ई/ऐ, द्वितीय तल, डी-21, कॉर्पोरेट पार्क, (नजदीक द्वारका सेक्टर-8 मेट्रो स्टेशन) सेक्टर-21, द्वारका, नई दिल्ली-110075

OFFICE OF THE PROJECT DIRECTOR, PROJECT IMPLEMENTATION UNIT

201E/A, Second Floor, D21, Corporate Park (Near Dwarka Sector- 8 Metro Station), Sector-21, Dwarka New Delhi-110075

दूरभाष/Phone No. : +91-9717892100, +91-9717623100 ईमेल/E-mail : piudwarka@nhai.org, piudwarka@gmail.com

NHAI/PIU/UER-II/PKG-02/01/2887

Date: 29.06.2022

To,

Senior Technical Director,
NIC, Transport Bhawan,
New Delhi - 110 001
E-mail: pk.jain@nic.in
mansoor@nic.in for uploading in Ministry's website

Sub.: ROW permission for laying underground 66 KV electricity cable on Package-2 of Urban Extension Road, NH-344M area.

(i) Chainage No. 21+580 km. to Chainage No. 23+800, Length=2220 m. (LHS)

Sir,

Please find enclosed herewith the proposal, mentioned under subject above. It is requested to upload the instant proposal on the Ministry's website to invite public comments within 30 days, if any.

2. As per Ministry's Circular no.-RW/NH-33044/29/2015S&R(R) dated 22.11.2016, the proposal shall put out in the public domain for 30 days for seeking claims and objections (on grounds of public inconvenience, safety and general public interest).

3. In view of the above, before approval of the competent authority, the comments/objections of affected public is hereby invited (as per form A) with reference to the Ministry's circular no.-RW/NH-33044/29/2015S&R(R) dated 22.11.2016 due to subject work. The objections/comments may be addressed to the below mentioned address upto 29.07.2022, beyond due date, no comments/ objections will be accepted.

The Regional Officer, Regional Office -Delhi
National Highways Authority of India
G 5&6 , Sector 10 , Dwarka, New Delhi - 110075.
Phone : 011- 25074100 /200
Email : rodelhi@nhai.org

Encl: As above

Yours faithfully,

(Piyush Agarwal)
Manager (Tech)
For PD, PIU-Dwarka

Copy to:

1. The RO-Delhi, NHAI HQ, New Delhi for kind information please.
2. Web-admin. NHAI HQ, New Delhi (web-admin@nhai.org) for uploading on NHAI's website.
3. BSES Rajdhani Power Limited, Guru Gobind Singh Hospital Grid, Raghubir Nagar, New Delhi-110027

मुख्यालय : जी-5 एवं 6, सेक्टर-10, द्वारका, नई दिल्ली-110075

Head Office : Plot No. : G-5 & 6, Sector-10, Dwarka, New Delhi-110075 Website : <http://www.nhai.org>

FORM- A

Form for inviting public comments on the application for relaxation in the guidelines/ norms for access permission to fuel stations, private properties, rest areas complexes and other such facilities along National Highways.

The comments by the general public needs to be given within 30 days of uploading the online application for comment.

S.N.	Item	Details
1.	Name of the person who desires to give comments.	
2.	Address of the person	
	Details of the application for access permission against which comments are being given (name of applicant and other details like site address etc.)	ROW permission for laying underground 66 KV electricity cable on Package-2 of Urban Extension Road, NH-344M area. (i)Chainage No. 21+580 km. to Chainage No. 23+800, Length=2220 m. (LHS)
3.	(a) Application No.	
	(b) Name of the Applicant (who applied to access Permission)	BSES Rajdhani Power Limited, Guru Gobind Singh Hospital Grid, Raghbir Nagar, New Delh-110027
	(c) Details of application	
4.	Whether the specific permission, if given, shall cause any damage to Highway? If yes, please give details.	
5.	Whether specific permission, if given, shall adversely affect safety and convenience of the traffic on the Highways? If yes, please give the details	
6.	Whether specific permission, if given shall adversely affect hygiene or cause nuisance and pollution on the highway? If yes, please give the details.	

BSES RAJDHANI POWER LIMITED*... a Joint Venture of BSES with govt. of NCT, Delhi*

Office of GM (P&C) EHV West, Guru Govind Singh Hospital Grid, Raghubir Nagar, New Delhi-110027

No.: GM/P&C/EHV/West/2022/59

Dated: 19.02.2022

To,

Sh. PIYUSH AGARWAL
DY. MANAGER (TECH), NHAI
201E/A, 2ND FLOOR
D21, CORPORATE PARK
SEC-21, DWARKA
NEW DELHI-110 075.



Subject: - ROW for laying 66 KV infeed 400 KV Mundaka – Nilothi Grid along NHAI utility corridor (Mundka inds Metro stn to Bakkarwala) NHAI package -2 vide scheme no EW21NF4011

Dear Sir,

We have plan system improvement scheme to cater west circle load demand. Most of development plans are under execution in vicinity of Mundaka area.

Consider existing load demand and future growth, we are strengthening our EHV network and better connectivity with 400 kv Mundaka grid. i.e. Major source for west delhi

Hence request to provide ROW laying of 66 KV infeed 400 KV Mundaka - Nilothi along NHAI utility corridor (Mundka inds Metro stn to Bakkarwala) NHAI package -2 vide scheme no EW21NF4011. Cable laying will be done by composite type i.e open cut and trenchless method.

Scheme No:- EW21NF4011

Type of laying: - Composite (open trench (1.5mtr X 1.5Mtr) & Trenchless)

Length of NHAI Corridor use :- 2.5 Km

This is highest priority project and execution already started from Nilothi Grid and Mundaka Grid end.

Hence requesting to provide ROW of NHAI utility corridor to lay 66 kv cable. This will be very helpful to cater upcoming summer peak.

- Enclose 1. Route Map
2. NHAI Package


Thanking You,


(Yogesh Kawale)


GM (P&C) EHV West

Contact No. 8882691429

Handwritten notes and signatures:
SG-Tarun
Take comments from AE
23/02/2022

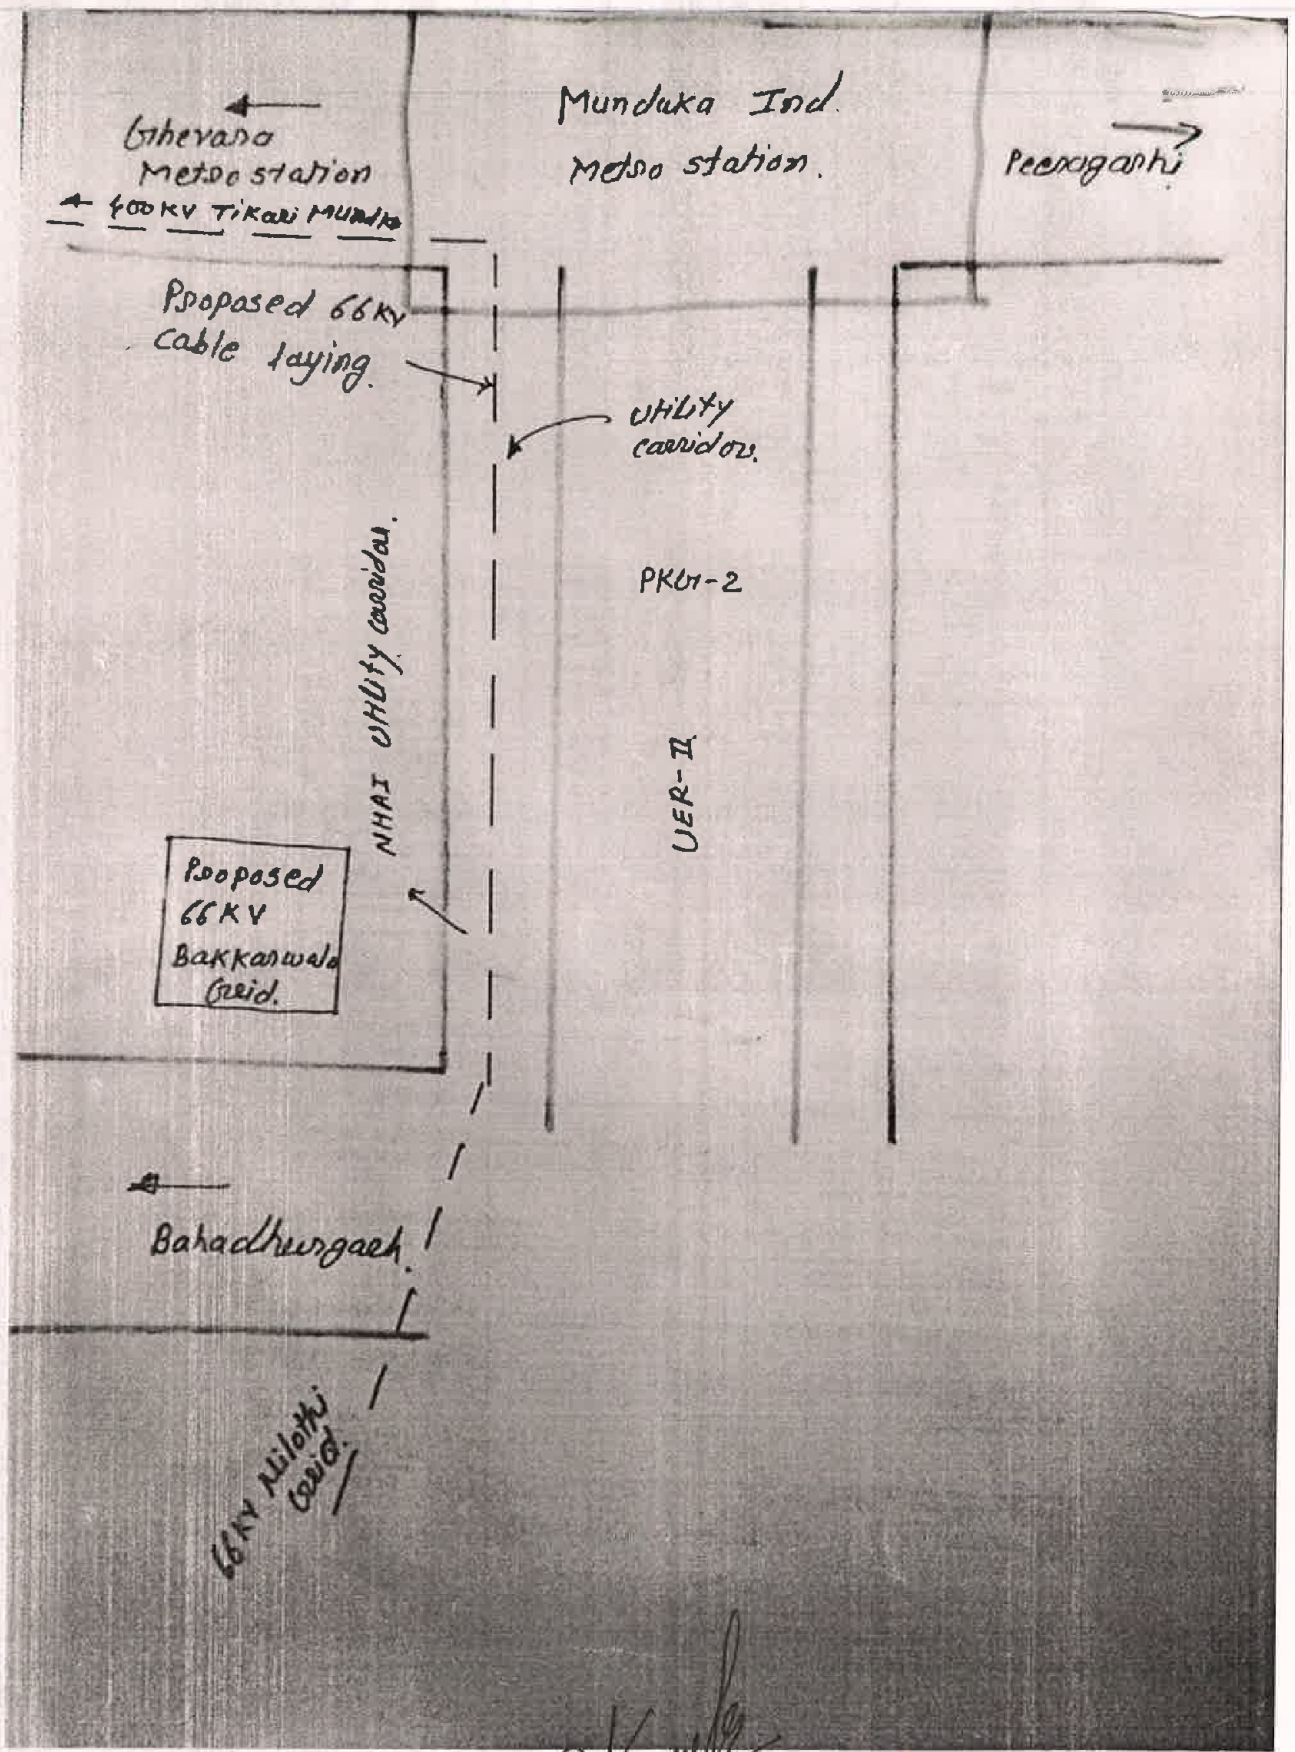

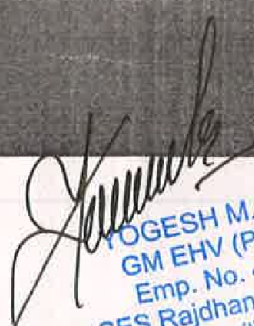
YOGESH M. KAWALE
GM EHV (P&C) West
Emp. No. 41017415
BSES Rajdhani Power Limited
A Joint Venture with Govt. of NCT Delhi

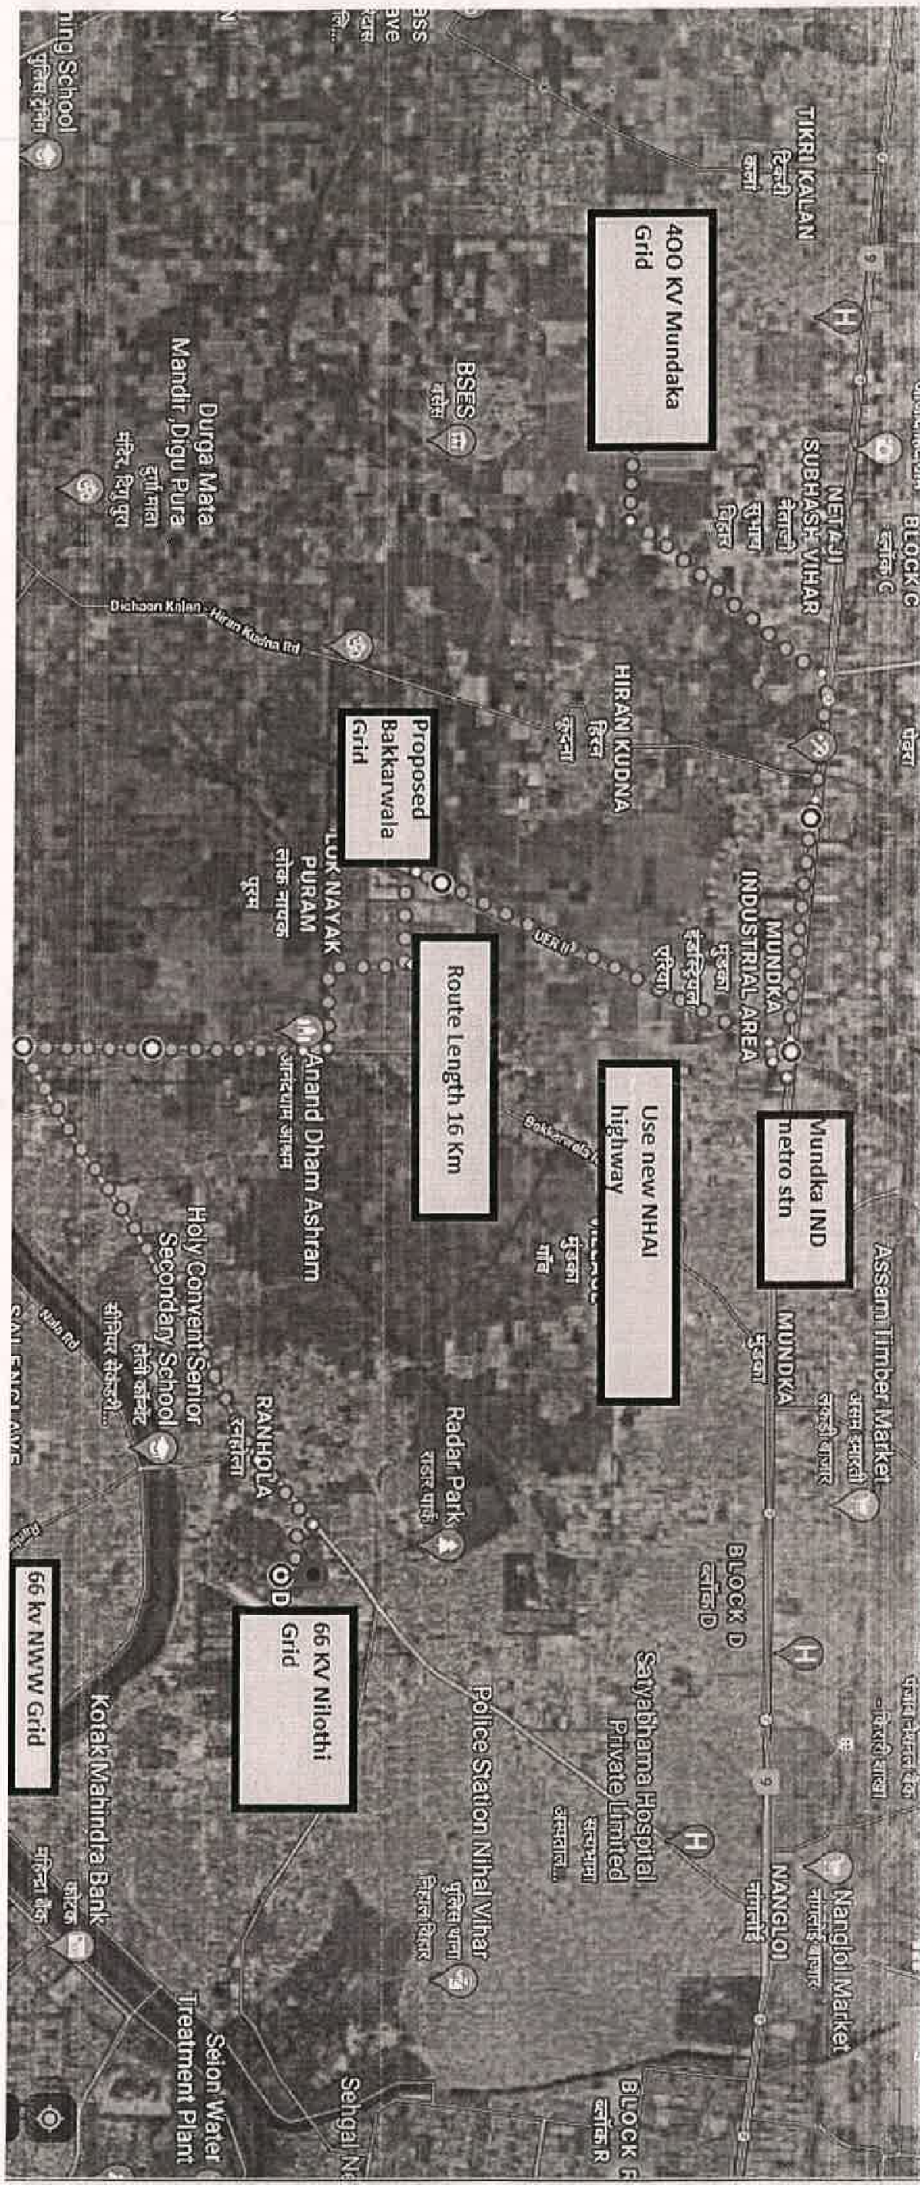

Vijay
VIJAYESH M. KAWALE
 GM EHV (P&C) West
 Emp. No. 41017415
BSES Rajdhani Power Limited
 A Joint Venture with Govt. of NCT Delhi

