



Government of India

Ministry of Road Transport & Highways

Office of the Regional Officer

No. 32, 2nd Floor, KSCFL Building, Race Course Road, BENGALURU-560 001

Email: robengaluru@gmail.com; Telephone: 080-22267457, 080-22265765

No.RW/BNG/ PER.CASES/ HUBLI DVN/2021

Dated:15.12.2023

Notice inviting Public Comments on the Proposal for approval of overhead Crossing of 400KV DC line Gadag - Narendra (New) solar power transmission line at km 62.170 near Mushikeri village Gajendragad taluk, Gadag district of NH-367 Bhanapura - Gaddanakeri section in Karnataka State- Reg.

Reference: Executive Engineer, NH Division, Hubli letter No. ENH/HBL/PB-3/Gadag-Narendra/2023-24/1517 dated 15.11.2023.

The Executive Engineer, NH Division, Hubli vide letter cited under reference above, has submitted proposal seeking Permission for approval of overhead Crossing of 400KV DC line Gadag - Narendra (New) solar power transmission line at km 62.170 near Mushikeri village Gajendragad taluk, Gadag district of NH-367 Bhanapura - Gaddanakeri section in Karnataka State.

2. The proposal has been examined as per Ministry's Guidelines vide letter no.RW/NH-33044/29/2015/S&R(R) dated 22.11.2016 and dated 17.04.2023 is generally found in order.

3. In view of above, as per Ministry's said guidelines Para 4, public comments are invited on the above proposal making claims and raising objections (on grounds of public inconvenience, safety and general public interest) if any within 30 days on public portal i.e., website of Ministry of Road Transport and Highways (morth.nic.in) in Form-A (copy enclosed) for "Accommodation of Public and Industrial Utility Services along and across National Highways".

Comment Inviting Authority

The Regional Officer-Civil

Ministry of Road Transport & Highways

No.32, 2nd Floor, Race Course Road, Bangalore-560 001

Email: robengaluru@gmail.com; Telephone: 080-22217457, 080-22105765

Encl:As above

[Signature]
o/c (Sandesh.K)
Asst. Engineer(C)
for Regional Officer

Copy to: (i) The Senior Technical Director, NIC, Transport Bhawan, New Delhi- 110001 for uploading on Ministry's website.
(ii) The Executive Engineer, National Highway Division Hubli, for information.

[Signature]
o/c (Sandesh.K)
Asst. Engineer(C)
for Regional Officer

FORM A

Form for seeking claims and objections (on grounds of public inconvenience, safety and general public interest) on the application for Accommodation of Public and Industrial Utility Services along and across National Highways.

Subject: Proposal for approval of overhead Crossing of 400KV DC line Gadag - Narendra (New) solar power transmission line at km 62.170 near Mushikeri village Gajendragad taluk, Gadag district of NH-367 Bhanapura - Gaddanakeri section in Karnataka State- Reg.

The claims and objections (on grounds of public inconvenience, safety and general public interest) by the general public needs to be given within 30 days of uploading the online application for comments.

Sl. No	Item	Details
1	Name of the person who is desiring to give claims and objections (on grounds of public inconvenience, safety and general public interest)	
2	Address of the person	
3	Details of the application for Accommodation of Public and Industrial Utility Services along and across National Highways against which claims and objections are being given (name of applicant and other details like site address etc.)	
	a) Application No.	
	b) Name of applicant (who applied to Accommodation of Public and Industrial Utility Services along and across National Highways)	
	c) Details of Application	
4	The claims and objections (on grounds of public inconvenience, safety and general public interest)	

hndt ..

Office of the
Executive Engineer,
National Highway Division,
Vishweshvar Nagar, HUBLI - 32.
Dated:

To,

The Regional Officer,
MORT&H, No.32 (2nd Floor),
KSCFL Building, Race Course Road,
Bengaluru - 560 001.

O/o. THE CE-RO
MORT&H, BENGALURU

Diary No.: 1670

Date: 28-11-2023

115 NOV 2023

Sir,

- Sub : Overhead crossing of 400KV D/C Gadag- Narendra Solar transmission line at Km. 62.170 near Mushigeri village in Gajendragad Taluka Gadag District of NH-367 Bhanapur Gaddanakeri section in the State of Karnataka- Reg..
- Ref : 1. Your office letter No:RW/BNG/PER-CASES/HBL DVS/N/2021/801,
Dated: 08-09-2023
2. This office letter No: 1150, Dated: 14-09-2023.
3. The Assistant Executive Engineer, N.H.Sub Dn Yalaburga office letter No:260, Dated: 27-10-2023.

With reference to the above subject, the proposal of permission to Overhead crossing of 400KV D/C Gadag- Narendra Solar transmission line at Km. 62.170 near Mushigeri village in Gajendragad Taluka Gadag District of NH-367 Bhanapur Gaddanakeri section in the State of Karnataka has been submitted to your office at reference (1) above. The proposal was returned to comply the observations and resubmit the proposal along with license fee and BG calculations.

Further vide reference(3) above, the Assistant Executive Engineer, N.H.Sub Dn Yalaburga has reported that, Gadag Narendra Transmission Limited have Re-submitted the proposal duly attending the observations raised by your office. Below are the detail of observations and compliance.

Sl.No	Observations	Compliance
1	In this submitted proposal it is not clear that the Agency seeking permission for the Public or Industrail utility. As such it is requested to confirm the same and to submit the Liense fee calculation and bank guarantee calculation and bank guarantee calculation accordingly as per the Ministry's extent guidelines dated 24-04-2023 along with area rate list issued by the completent authority duly signed by the Executive Egnineer, N.H.Division, Hubli.	The above said line is Public utility. The details of license fee calculation alongwith BG fee calculation Land rates of Mushigeri village is attached herewith for kind perusal. The proposal is signed by Executive Engineer, N.H. Division, Hubli.
2	Details provided in the checklist such as ROW, proposed Length of overhead cable et., is to be vefified w.r.t the site condition and all the pages are to be certified by the Executive Egnineer, N.H.Division, Hubli.	Checklist Details such as ROW, proposed Length of overhead cable etc. has been verified and all the pages have been certified by Executive Engineer, N.H. Division, Hubli.

..2..

3	The details drawing of the proposal mentioning NH ROW, vertical and horizontal clearance of the proposed overhead cable duly signed by the Executive Engineer, N.H.Division, Hubli.	The Drawing of the proposal mentioning NH ROW, vertical and horizontal clearance of the proposed overhead cable has been duly signed by Assistant Executive Engineer, N.H.Sub Dn Yalaburga.
4	The Executive Engineer, N.H. Division, Hubli is requested to ensure that the Horizontal and Vertical clearance of the above overhead proposal are maintained in accordance with IRC standard (i.e IRC:32-1969) and to certify the same.	Noted and it will be maintained in accordance with the IRC standards by the agency.
5	The agreement is to be made between "The Regional Officer, MoRT & H Bangalore (Authority) and the Licensee leaving date /month / year blank without and topographical errors along with witness signature.	Noted and attached herewith for kind reference.
6	Further all the undertakings mentioned in the Checklist as per the Ministry norms needs to be submitted in original.	All the Undertakings mentioned in the checklist are submitted in original.

Hence the above proposal is resubmitted duly attending the observations for kind perusal and further needful.


Yours faithfully,

Executive Engineer,
N.H. Division, Hubli

GADAG TRANSMISSION LIMITED

NATIONAL HIGHWAY-367 CROSSING PROPOSAL

SINGLE LINE DIAGRAM OF 400KV D/C TWIN HTLS GADAG TRANSMISSION LINE
BETWEEN AP-49/1 - AP-49/2 LENGTH=250 MTR

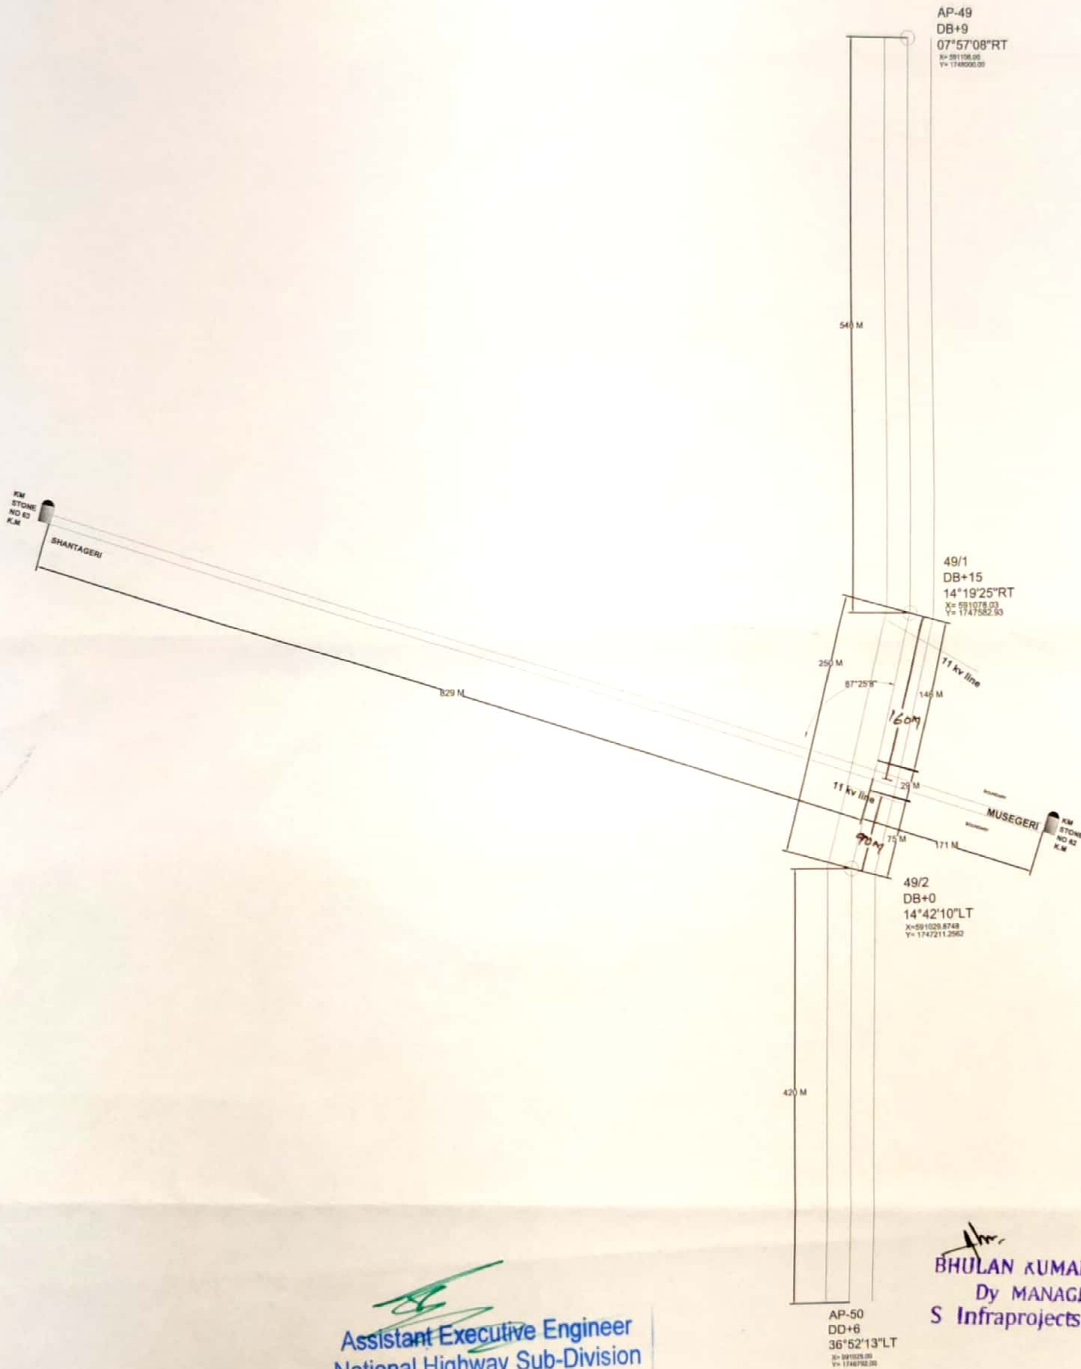

Assistant Executive Engineer
National Highway Sub-Division
YELBURGA-583236

BHULAN KUMAR JENA
Dy MANAGER
S Infraprojects Pvt Ltd



Assistant Ex. Engineer
N.H. Sub-Division Velburga

Executive Engineer
N. H. Division Hubli